

# Service Manual

## Air Conditioner



### Indoor Unit

CS-E7LKEW

CS-E7LKEW

CS-E9LKEW

CS-E9LKEW

CS-E12LKEW

CS-E12LKEW

CS-E15LKEW

CS-E18LKEW

CS-E21LKEW

CS-XE7LKEW

CS-XE7LKEW

CS-XE9LKEW

CS-XE9LKEW

CS-XE12LKEW

CS-XE12LKEW

CS-XE15LKEW

CS-XE18LKEW

CS-XE21LKEW

### Outdoor Unit

CU-E7LKE

CU-E7LKE-3

CU-E9LKE

CU-E9LKE-3

CU-E12LKE

CU-E12LKE-3

CU-E15LKE

CU-E18LKE

CU-E21LKE

CU-E7LKE

CU-E7LKE-3

CU-E9LKE

CU-E9LKE-3

CU-E12LKE

CU-E12LKE-3

CU-E15LKE

CU-E18LKE

CU-E21LKE

Please file and use this manual together with the service manual for Model No. CU-2E18CBPG, CU-3E23CBPG, CU-4E27CBPG, Order No. RAC0209005C2, Model No. CU-3E18EBE, Order No. RAC0602011C2 and Model No. CU-2E15GBE, Order No. MAC0704001A2.

### WARNING

This service information is designed for experienced repair technicians only and is not designed for use by the general public. It does not contain warnings or cautions to advise non-technical individuals of potential dangers in attempting to service a product. Products powered by electricity should be serviced or repaired only by experienced professional technicians. Any attempt to service or repair the product or products dealt with in this service information by anyone else could result in serious injury or death.

### PRECAUTION OF LOW TEMPERATURE


In order to avoid frostbite, be assured of no refrigerant leakage during the installation or repairing of refrigeration circuit.


# TABLE OF CONTENTS

	PAGE		PAGE
<b>1 Safety Precautions</b>	<b>3</b>	13.9. Mild Dry Cooling Operation	81
<b>2 Specifications</b>	<b>5</b>	<b>14 Protection Control</b>	<b>82</b>
<b>3 Features</b>	<b>27</b>	14.1. Protection Control For All Operations	82
<b>4 Location of Controls and Components</b>	<b>28</b>	14.2. Protection Control For Cooling & Soft Dry Operation	84
4.1. Indoor Unit	28	14.3. Protection Control For Heating Operation	85
4.2. Outdoor Unit	28	<b>15 Servicing Mode</b>	<b>87</b>
4.3. Remote Control	29	15.1. Auto OFF/ON Button	87
<b>5 Dimensions</b>	<b>30</b>	15.2. Remote Control Button	88
5.1. Indoor Unit	30	<b>16 Troubleshooting Guide</b>	<b>89</b>
5.2. Outdoor Unit	32	16.1. Refrigeration Cycle System	89
<b>6 Refrigeration Cycle Diagram</b>	<b>33</b>	16.2. Breakdown Self Diagnosis Function	91
6.1. CU-E7LKE CU-E9LKE CU-E12LKE CU-E15LKE	33	16.3. Error Codes Table	92
6.2. CU-E7LKE-3 CU-E9LKE-3 CU-E12LKE-3	34	16.4. Self-diagnosis Method	94
6.3. CU-E18LKE CU-E21LKE	35	<b>17 Disassembly and Assembly Instructions</b>	<b>124</b>
<b>7 Block Diagram</b>	<b>36</b>	17.1. CS-E7LK CS-E9LK CS-E12LK CS-E15LK	124
7.1. CU-E7LKE CU-E9LKE CU-E15LKE	36	17.2. CS-E18LK CS-E21LK	128
7.2. CU-E12LKE	37	17.3. Outdoor Electronic Controller Removal Procedure	133
7.3. CU-E7LKE-3 CU-E9LKE-3 CU-E12LKE-3	38	<b>18 Technical Data</b>	<b>135</b>
7.4. CU-E18LKE CU-E21LKE	39	18.1. Operation Characteristics	135
<b>8 Wiring Connection Diagram</b>	<b>40</b>	18.2. Sensible Capacity Chart	171
8.1. Indoor Unit	40	<b>19 Exploded View and Replacement Parts List</b>	<b>173</b>
8.2. Outdoor Unit	42	19.1. Indoor Unit	173
<b>9 Electronic Circuit Diagram</b>	<b>46</b>	19.2. Outdoor Unit	181
9.1. Indoor Unit	46		
9.2. Outdoor Unit	48		
<b>10 Printed Circuit Board</b>	<b>52</b>		
10.1. Indoor Unit	52		
10.2. Outdoor Unit	55		
<b>11 Installation Instruction</b>	<b>58</b>		
11.1. Select the Best Location	58		
11.2. Indoor Unit	59		
11.3. Outdoor Unit	62		
<b>12 Operation and Control</b>	<b>65</b>		
12.1. Basic Function	65		
12.2. Indoor Fan Motor Operation	66		
12.3. Outdoor Fan Motor Operation	67		
12.4. Airflow Direction	67		
12.5. Quiet operation (Cooling Mode/Cooling area of Dry Mode)	69		
12.6. Quiet operation (Heating)	69		
12.7. Powerful Mode Operation	70		
12.8. Timer Control	70		
12.9. Auto Restart Control	70		
12.10. Indication Panel	70		
12.11. Patrol Operation	71		
12.12. e-ion Operation	73		
12.13. Mild Dry Cooling Operation	75		
12.14. ECO Patrol Operation	76		
<b>13 Operation Control (For Multi Split Connection)</b>	<b>80</b>		
13.1. Cooling operation	80		
13.2. Soft Dry Operation	80		
13.3. Heating Operation	80		
13.4. Automatic Operation	80		
13.5. Indoor Fan Motor Operation	81		
13.6. Powerful Mode Operation	81		
13.7. Auto restart control	81		
13.8. Indication Panel	81		


# 1 Safety Precautions

- Read the following "SAFETY PRECAUTIONS" carefully before perform any servicing.
- Electrical work must be installed or serviced by a licensed electrician. Be sure to use the correct rating of the power plug and main circuit for the model installed.
- The caution items stated here must be followed because these important contents are related to safety. The meaning of each indication used is as below. Incorrect installation or servicing due to ignoring of the instruction will cause harm or damage, and the seriousness is classified by the following indications.






 <b>WARNING</b>	This indication shows the possibility of causing death or serious injury.
--	---

 <b>CAUTION</b>	This indication shows the possibility of causing injury or damage to properties.
--	--

- The items to be followed are classified by the symbols:

	This symbol denotes item that is PROHIBITED from doing.
---	---

- Carry out test run to confirm that no abnormality occurs after the servicing. Then, explain to user the operation, care and maintenance as stated in instructions. Please remind the customer to keep the operating instructions for future reference.

 <b>WARNING</b>	
1. Do not modify the machine, part, material during repairing service.	
2. If wiring unit is supplied as repairing part, do not repair or connect the wire even only partial wire break. Exchange the whole wiring unit.	
3. Do not wrench the fasten terminal. Pull it out or insert it straightly.	
4. Engage authorized dealer or specialist for installation and servicing. If installation or servicing done by the user is defective, it will cause water leakage, electrical shock or fire.	
5. Install according to this installation instructions strictly. If installation is defective, it will cause water leakage, electrical shock or fire.	
6. Use the attached accessories parts and specified parts for installation and servicing. Otherwise, it will cause the set to fall, water leakage, fire or electrical shock.	
7. Install at a strong and firm location which is able to withstand the set's weight. If the strength is not enough or installation is not properly done, the set will drop and cause injury.	
8. For electrical work, follow the local national wiring standard, regulation and the installation instruction. An independent circuit and single outlet must be used. If electrical circuit capacity is not enough or defect found in electrical work, it will cause electrical shock or fire.	
9. This equipment is strongly recommended to be installed with Earth Leakage Circuit Breaker (ELCB) or Residual Current Device (RCD). Otherwise, it may cause electrical shock and fire in case equipment breakdown or insulation breakdown.	
10. Do not use joint cable for indoor/outdoor connection cable. Use the specified indoor/outdoor connection cable, refer to installation instruction CONNECT THE CABLE TO THE INDOOR UNIT and connect tightly for indoor/outdoor connection. Clamp the cable so that no external force will be acted on the terminal. If connection or fixing is not perfect, it will cause heat up or fire at the connection.	
11. Wire routing must be properly arranged so that control board cover is fixed properly. If control board cover is not fixed perfectly, it will cause heat-up or fire at connection point of terminal, fire or electrical shock.	
12. When install or relocate air conditioner, do not let any substance other than the specified refrigerant, eg. air etc. mix into refrigeration cycle (piping). (Mixing of air etc. will cause abnormal high pressure in refrigeration cycle and result in explosion, injury etc.).	
13. Do not install outdoor unit near handrail of veranda. When installing air-conditioner unit at veranda of high rise building, child may climb up to outdoor unit and cross over the handrail and causing accident.	
14. This equipment must be properly earthed. Earth line must not be connected to gas pipe, water pipe, earth of lightning rod and telephone. Otherwise, it may cause electrical shock in case equipment breakdown or insulation breakdown.	
15. Keep away from small children, the thin film may cling to nose and mouth and prevent breathing.	
16. Do not use unspecified cord, modified cord, joint cord or extension cord for power supply cord. Do not share the single outlet with other electrical appliances. Poor contact, poor insulation or over current will cause electrical shock or fire.	
17. Tighten the flare nut with torque wrench according to specified method. If the flare nut is over-tightened, after a long period, the flare may break and cause refrigerant gas leakage.	



## WARNING

- |  |  |
|--|--|
| 18. For R410A models, when connecting the piping, do not use any existing (R22) pipes and flare nuts. Using such same may cause abnormally high pressure in the refrigeration cycle (piping), and possibly result in explosion and injury. Use only R410A materials.<br>Thickness of copper pipes used with R410A must be more than 0.8mm. Never use copper pipes thinner than 0.8mm.<br>It is desirable that the amount of residual oil is less than 40 mg/10m. |  |
| 19. During installation, install the refrigerant piping properly before run the compressor. (Operation of compressor without fixing refrigeration piping and valves at opened condition will cause suck-in of air, abnormal high pressure in refrigeration cycle and result in explosion, injury etc.).  |  |
| 20. During pump down operation, stop the compressor before remove the refrigeration piping. (Removal of refrigeration piping while compressor is operating and valves are opened condition will cause suck-in of air, abnormal high pressure in refrigeration cycle and result in explosion, injury etc.).   |  |
| 21. After completion of installation or service, confirm there is no leakage of refrigerant gas. It may generate toxic gas when the refrigerant contacts with fire.  |  |
| 22. Ventilate if there is refrigerant gas leakage during operation. It may cause toxic gas when the refrigerant contacts with fire.  |  |
| 23. Do not insert your fingers or other objects into the unit, high speed rotating fan may cause injury.   |  |
| 24. Must not use other parts except original parts describe in catalog and manual.   |  |



## CAUTION

- |  |  |
|--|--|
| 1. Do not install the unit at place where leakage of flammable gas may occur. In case gas leaks and accumulates at surrounding of the unit, it may cause fire.   |  |
| 2. Carry out drainage piping as mentioned in installation instructions. If drainage is not perfect, water may enter the room and damage the furniture.   |  |
| 3. Tighten the flare nut with torque wrench according to specified method. If the flare nut is over-tightened, after a long period, the flare may break and cause refrigerant gas leakage.   |  |
| 4. Do not touch outdoor unit air inlet and aluminium fin. It may cause injury.   |  |
| 5. Select an installation location which is easy for maintenance.  |  |
| 6. Pb free solder has a higher melting point than standard solder; typically the melting point is 50°F - 70°F (30°C - 40°C) higher. Please use a high temperature solder iron. In case of the soldering iron with temperature control, please set it to 700 ± 20°F (370 ± 10°C). Pb free solder will tend to splash when heated too high (about 1100°F / 600°C).   |  |
| 7. Power supply connection to the air conditioner. Connect the power supply cord of the air conditioner to the mains using one of the following methods.<br>Power supply point shall be the place where there is ease for access for the power disconnection in case of emergency. In some countries, permanent connection of this room air conditioner to the power supply is prohibited.<br>i. Power supply connection to the receptacle using a power plug. Use an approved 15/16A (3/4~1.75HP), 16A (2.0HP), 20A (2.5HP) or 25A (3.0HP) power plug with earth pin for the connection to the socket.<br>ii. Power supply connection to a circuit breaker for the permanent connection. Use an approved 16A (3/4~2.0HP), 20A (2.5HP) or 25A (3.0HP) circuit breaker for the permanent connection. It must be a double pole switch with a minimum 3.0 mm contact gap. |  |
| 8. Do not release refrigerant during piping work for installation, servicing, reinstallation and during repairing a refrigerant parts.<br>Take care of the liquid refrigerant, it may cause frostbite.   |  |
| 9. Installation or servicing work: It may need two people to carry out the installation or servicing work.   |  |
| 10. Do not install this appliance in a laundry room or other location where water may drip from the ceiling, etc.  |  |
| 11. Do not sit or step on the unit, you may fall down accidentally.  |  |
| 12. Do not touch the sharp aluminium fin, sharp parts may cause injury.  |  |



## 2 Specifications

MODEL				INDOOR	CS-E7LKEW, CS-XE7LKEW			CS-E9LKEW, CS-XE9LKEW		
				OUTDOOR	CU-E7LKE			CU-E9LKE		
Performance Test Condition					EUROVENT			EUROVENT		
Power Supply				Phase, Hz	Single, 50			Single, 50		
				V	230			230		
					Min.	Mid.	Max.	Min.	Mid.	Max.
Cooling	Capacity			kW	0.70	2.05	2.40	0.80	2.50	3.00
				BTU/h	2390	6990	8180	2730	8530	10200
				Kcal/h	600	1760	2060	690	2150	2580
	Running Current			A	—	2.2	—	—	2.5	—
	Input Power			W	170	470	580	175	535	730
	Annual Consumption			kWh	—	235	—	—	268	—
	EER			W/W	4.12	4.36	4.14	4.57	4.67	4.11
				Kcal/hW	3.53	3.74	3.55	3.94	4.02	3.53
	Power Factor			%	—	93	—	—	93	—
	Indoor Noise (H / L / QLo)			dB-A	37 / 24 / 20			39 / 25 / 20		
				Power Level dB	53 / 40 / 36			55 / 41 / 36		
	Outdoor Noise (H / L)			dB-A	45 / -			46 / -		
Power Level dB				60 / -			61 / -			
Heating	Capacity			kW	0.70	2.80	4.00	0.80	3.40	5.00
				BTU/h	2390	9550	13600	2730	11600	17100
				Kcal/h	600	2410	3440	690	2920	4300
	Running Current			A	—	3.0	—	—	3.4	—
	Input Power			W	160	635	1.02k	165	735	1.30k
	COP			W/W	4.38	4.41	3.92	4.85	4.63	3.85
				Kcal/hW	3.75	3.80	3.37	4.18	3.97	3.31
	Power Factor			%	—	92	—	—	94	—
	Indoor Noise (H / L / QLo)			dB-A	38 / 25 / 20			40 / 27 / 20		
				Power Level dB	54 / 41 / 36			56 / 43 / 36		
	Outdoor Noise (H / L)			dB-A	46 / -			47 / -		
				Power Level dB	61 / -			62 / -		
Low Temp. : Capacity (kW) / I.Power (W) / COP					2.90 / 900 / 3.22			3.62 / 1.15k / 3.15		
Extr Low Temp. : Capacity (kW) / I.Power (W) / COP					2.35 / 930 / 2.53			2.88 / 1.18k / 2.44		
Max Current (A) / Max Input Power (W)					4.7 / 1.02k			5.8 / 1.30k		
Starting Current (A)					3.0			3.4		
Compressor		Type			Hermetic Motor			Hermetic Motor		
		Motor Type			Brushless (6-poles)			Brushless (6-poles)		
		Output Power		W	650			700		
Indoor Fan	Type				Cross-flow Fan			Cross-flow Fan		
	Material				ASG20K1			ASG20K1		
	Motor Type				Transistor (8-poles)			Transistor (8-poles)		
	Input Power			W	—			—		
	Output Power			W	40			40		
	Speed	QLo	Cool	rpm	590			630		
			Heat	rpm	630			670		
		Lo	Cool	rpm	670			730		
			Heat	rpm	730			820		
		Me	Cool	rpm	860			950		
			Heat	rpm	910			1030		
		Hi	Cool	rpm	1050			1180		
			Heat	rpm	1090			1240		
	SHi	Cool	rpm	1110			1240			
		Heat	rpm	1150			1280			

MODEL				INDOOR	CS-E7LKEW, CS-XE7LKEW	CS-E9LKEW, CS-XE9LKEW		
				OUTDOOR	CU-E7LKE	CU-E9LKE		
Outdoor Fan	Type				Propeller Fan	Propeller Fan		
	Material				PP	PP		
	Motor Type				Induction (6-poles)	Induction (6-poles)		
	Input Power			W	62	65		
	Output Power			W	25	25		
	Speed	Hi		rpm	770	770		
Moisture Removal				L/h (Pt/h)	1.3 (2.7)	1.5 (3.2)		
Indoor Airflow				QLo	Cool	m³/min (ft³/min)	5.6 (198)	4.9 (173)
					Heat	m³/min (ft³/min)	6.0 (212)	5.3 (187)
				Lo	Cool	m³/min (ft³/min)	6.5 (230)	6.0 (212)
					Heat	m³/min (ft³/min)	7.2 (254)	7.1 (251)
				Me	Cool	m³/min (ft³/min)	8.7 (307)	8.7 (307)
					Heat	m³/min (ft³/min)	9.3 (328)	9.6 (339)
				Hi	Cool	m³/min (ft³/min)	10.9 (385)	11.3 (400)
					Heat	m³/min (ft³/min)	11.4 (400)	11.7 (410)
				SHi	Cool	m³/min (ft³/min)	11.6 (410)	11.7 (410)
Heat	m³/min (ft³/min)	12.0 (424)	12.1 (427)					
Outdoor Airflow				Hi	Cool	m³/min (ft³/min)	33.9 (1200)	29.8 (1050)
					Heat	m³/min (ft³/min)	33.9 (1200)	29.8 (1050)
Refrigeration Cycle				Control Device			Check Valve & Capillary Tube	Check Valve & Capillary Tube
				Refrigerant Oil		cm³	RB68A or Freol Alpha 68M (320)	RB68A or Freol Alpha 68M (320)
				Refrigerant Type		g (oz)	R410A, 830 (29.3)	R410A, 950 (33.5)
Dimension				Height (I/D / O/D)		mm (inch)	290 (11-7/16) / 540 (21-9/32)	290 (11-7/16) / 540 (21-9/32)
				Width (I/D / O/D)		mm (inch)	870 (34-9/32) / 780 (30-23/32)	870 (34-9/32) / 780 (30-23/32)
				Depth (I/D / O/D)		mm (inch)	204 (8-1/16) / 289 (11-13/32)	204 (8-1/16) / 289 (11-13/32)
Weight				Net (I/D / O/D)		kg (lb)	9 (20) / 33 (73)	9 (20) / 34 (75)
Piping	Pipe Diameter (Liquid / Gas)			mm (inch)		6.35 (1/4) / 9.52 (3/8)		6.35 (1/4) / 9.52 (3/8)
	Standard Length			m (ft)		5 (16.4)		5 (16.4)
	Length Range (min - max)			m (ft)		3 (9.8) ~ 15 (49.2)		3 (9.8) ~ 15 (49.2)
	I/D & O/D Height Different			m (ft)		15.0 (49.2)		15.0 (49.2)
	Additional Gas Amount			g/m (oz/ft)		20 (0.2)		20 (0.2)
	Length for Additional Gas			m (ft)		7.5 (24.6)		7.5 (24.6)
Drain Hose				Inner Diameter		mm		16
				Length		mm		650
Indoor Heat Exchanger				Fin Material				Aluminium (Pre Coat)
				Fin Type				Slit Fin
				Row x Stage x FPI				2 x 15 x 17
				Size (W x H x L)		mm		610 x 315 x 25.4
Outdoor Heat Exchanger				Fin Material				Aluminium
				Fin Type				Corrugated Fin
				Row x Stage x FPI				1 x 20 x 19
				Size (W x H x L)		mm		22 x 508 x 708.4
								36.4 x 504 x 713 684
Air Filter				Material				Polypropelene
				Type				One-touch
Power Supply						Outdoor Power Supply		Outdoor Power Supply
Power Supply Cord				A		Nil		Nil
Thermostat						Electronic Control		Electronic Control
Protection Device						Electronic Control		Electronic Control

MODEL			INDOOR	CS-E7LKEW, CS-XE7LKEW		CS-E9LKEW, CS-XE9LKEW	
			OUTDOOR	CU-E7LKE		CU-E9LKE	
				Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
Indoor Operation Range	Cooling	Maximum		32	23	32	23
		Minimum		16	11	16	11
	Heating	Maximum		30	—	30	—
		Minimum		16	—	16	—
Outdoor Operation Range	Cooling	Maximum		43	26	43	26
		Minimum		5	4	5	4
	Heating	Maximum		24	18	24	18
		Minimum		-5	-6	-5	-6

1. Cooling capacities are based on indoor temperature of 27°C Dry Bulb (80.6°F Dry Bulb), 19.0°C Wet Bulb (66.2°F Wet Bulb) and outdoor air temperature of 35°C Dry Bulb (95°F Dry Bulb), 24°C Wet Bulb (75.2°F Wet Bulb)
2. Heating capacities are based on indoor temperature of 20°C Dry Bulb (68°F Dry Bulb) and outdoor air temperature of 7°C Dry Bulb (44.6°F Dry Bulb), 6°C Wet Bulb (42.8°F Wet Bulb)
3. Heating low temperature capacity, Input Power and COP measured at 230 V, indoor temperature 20°C, outdoor 2/1°C
4. Heating extreme low temperature capacity, Input Power and COP measured at 230 V, indoor temperature 20°C, outdoor -7/-8°C
5. Specifications are subjected to change without prior notice for further improvement.

MODEL				INDOOR	CS-E12LKEW, CS-XE12LKEW			CS-E15LKEW, CS-XE15LKEW		
				OUTDOOR	CU-E12LKE			CU-E15LKE		
Performance Test Condition					EUROVENT			EUROVENT		
Power Supply				Phase, Hz	Single, 50			Single, 50		
				V	230			230		
					Min.	Mid.	Max.	Min.	Mid.	Max.
Cooling	Capacity			kW	0.80	3.50	4.00	0.80	4.20	5.00
				BTU/h	2730	11900	13600	2730	14300	17100
				Kcal/h	690	3010	3440	690	3610	4300
	Running Current			A	—	3.9	—	—	5.7	—
	Input Power			W	185	860	1.13k	195	1.26k	1.57k
	Annual Consumption			kWh	—	430	—	—	630	—
	EER			W/W	4.32	4.07	3.54	4.10	3.33	3.18
				Kcal/hW	3.73	3.50	3.04	3.54	2.87	2.74
	Power Factor			%	—	96	—	—	96	—
	Indoor Noise (H / L / QLo)			dB-A	42 / 28 / 20			43 / 31 / 25		
				Power Level dB	58 / 44 / 36			59 / 47 / 41		
	Outdoor Noise (H / L)			dB-A	48 / -			49 / -		
				Power Level dB	63 / -			64 / -		
Heating	Capacity			kW	0.80	4.00	6.00	0.80	5.30	6.80
				BTU/h	2730	13600	20500	2730	18100	23200
				Kcal/h	690	3440	5160	690	4560	5850
	Running Current			A	—	4.4	—	—	6.6	—
	Input Power			W	175	950	1.71k	185	1.44k	1.94k
	COP			W/W	4.57	4.21	3.51	4.32	3.68	3.51
				Kcal/hW	3.94	3.62	3.02	3.73	3.17	3.02
	Power Factor			%	—	94	—	—	95	—
	Indoor Noise (H / L / QLo)			dB-A	42 / 33 / 20			43 / 35 / 29		
				Power Level dB	58 / 49 / 36			59 / 51 / 45		
	Outdoor Noise (H / L)			dB-A	50 / -			51 / -		
				Power Level dB	65 / -			66 / -		
	Low Temp. : Capacity (kW) / I.Power (W) / COP					4.47 / 1.48k / 3.02			4.92 / 1.72k / 2.86	
Extr Low Temp. : Capacity (kW) / I.Power (W) / COP					3.46 / 1.49k / 2.32			3.94 / 1.83k / 2.15		
Max Current (A) / Max Input Power (W)					7.8 / 1.71k			9.0 / 1.94k		
Starting Current (A)					4.4			6.6		
Compressor		Type			Hermetic Motor			Hermetic Motor		
		Motor Type			Brushless (4-poles)			Brushless (6-poles)		
		Output Power		W	700			700		
Indoor Fan	Type				Cross-flow Fan			Cross-flow Fan		
	Material				ASG20K1			ASG20K1		
	Motor Type				Transistor (8-poles)			Transistor (8-poles)		
	Input Power			W	—			—		
	Output Power			W	40			40		
	Speed	QLo	Cool	rpm	630			730		
			Heat	rpm	670			900		
		Lo	Cool	rpm	830			870		
			Heat	rpm	1010			1080		
		Me	Cool	rpm	1040			1070		
			Heat	rpm	1150			1210		
		Hi	Cool	rpm	1260			1270		
			Heat	rpm	1300			1350		
	SHi	Cool	rpm	1320			1340			
		Heat	rpm	1340			1370			

MODEL				INDOOR	CS-E12LKEW, CS-XE12LKEW	CS-E15LKEW, CS-XE15LKEW	
				OUTDOOR	CU-E12LKE	CU-E15LKE	
Outdoor Fan	Type				Propeller Fan	Propeller Fan	
	Material				PP	PP	
	Motor Type				DC Motor (8-poles)	Induction (6-poles)	
	Input Power			W	—	70	
	Output Power			W	40	30	
	Speed	Hi		rpm	830	850	
	Moisture Removal			L/h (Pt/h)	2.0 (4.2)	2.4 (5.1)	
Indoor Airflow			QLo	Cool	m³/min (ft³/min)	4.9 (173)	6.0 (212)
				Heat	m³/min (ft³/min)	5.3 (187)	8.1 (286)
			Lo	Cool	m³/min (ft³/min)	7.2 (254)	7.7 (272)
				Heat	m³/min (ft³/min)	9.4 (332)	10.2 (360)
			Me	Cool	m³/min (ft³/min)	9.7 (343)	10.1 (357)
				Heat	m³/min (ft³/min)	11.0 (389)	11.7 (413)
			Hi	Cool	m³/min (ft³/min)	12.5 (440)	12.5 (440)
				Heat	m³/min (ft³/min)	12.8 (450)	13.4 (475)
			SHi	Cool	m³/min (ft³/min)	13.1 (463)	13.3 (470)
				Heat	m³/min (ft³/min)	13.3 (470)	13.6 (480)
Outdoor Airflow			Hi	Cool	m³/min (ft³/min)	31.0 (1090)	31.4 (1110)
				Heat	m³/min (ft³/min)	31.0 (1090)	31.4 (1110)
Refrigeration Cycle		Control Device			Check Valve & Capillary Tube		Check Valve & Capillary Tube
		Refrigerant Oil		cm³	RB68A or Freol Alpha 68M (320)		RB68A or Freol Alpha 68M (400)
		Refrigerant Type		g (oz)	R410A, 980 (34.6)		R410A, 1.01k (35.7)
Dimension		Height (I/D / O/D)		mm (inch)	290 (11-7/16) / 540 (21-9/32)		290 (11-7/16) / 540 (21-9/32)
		Width (I/D / O/D)		mm (inch)	870 (34-9/32) / 780 (30-23/32)		870 (34-9/32) / 780 (30-23/32)
		Depth (I/D / O/D)		mm (inch)	204 (8-1/16) / 289 (11-13/32)		204 (8-1/16) / 289 (11-13/32)
Weight		Net (I/D / O/D)		kg (lb)	9 (20) / 34 (75)		9 (20) / 34 (75)
Piping	Pipe Diameter (Liquid / Gas)			mm (inch)	6.35 (1/4) / 9.52 (3/8)		6.35 (1/4) / 12.70 (1/2)
	Standard Length			m (ft)	5 (16.4)		5 (16.4)
	Length Range (min - max)			m (ft)	3 (9.8) ~ 15 (49.2)		3 (9.8) ~ 15 (49.2)
	I/D & O/D Height Different			m (ft)	15.0 (49.2)		15.0 (49.2)
	Additional Gas Amount			g/m (oz/ft)	20 (0.2)		20 (0.2)
	Length for Additional Gas			m (ft)	7.5 (24.6)		7.5 (24.6)
Drain Hose		Inner Diameter		mm	16		16
		Length		mm	650		650
Indoor Heat Exchanger		Fin Material			Aluminium (Pre Coat)		Aluminium (Pre Coat)
		Fin Type			Slit Fin		Slit Fin
		Row x Stage x FPI			2 x 15 x 21		2 x 15 x 21
		Size (W x H x L)		mm	610 x 315 x 25.4		610 x 315 x 25.4
Outdoor Heat Exchanger		Fin Material			Aluminium		Aluminium
		Fin Type			Corrugated Fin		Corrugated Fin
		Row x Stage x FPI			2 x 24 x 17		2 x 24 x 17
		Size (W x H x L)		mm	36.4 x 504 x 713 684		36.4 x 504 x 713 684
Air Filter		Material			Polypropelene		Polypropelene
		Type			One-touch		One-touch
Power Supply					Outdoor Power Supply		Outdoor Power Supply
Power Supply Cord				A	Nil		Nil
Thermostat					Electronic Control		Electronic Control
Protection Device					Electronic Control		Electronic Control

MODEL			INDOOR	CS-E12LKEW, CS-XE12LKEW		CS-E15LKEW, CS-XE15LKEW	
			OUTDOOR	CU-E12LKE		CU-E15LKE	
				Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
Indoor Operation Range	Cooling	Maximum		32	23	32	23
		Minimum		16	11	16	11
	Heating	Maximum		30	—	30	—
		Minimum		16	—	16	—
Outdoor Operation Range	Cooling	Maximum		43	26	43	26
		Minimum		5	4	5	4
	Heating	Maximum		24	18	24	18
		Minimum		-5	-6	-5	-6

1. Cooling capacities are based on indoor temperature of 27°C Dry Bulb (80.6°F Dry Bulb), 19.0°C Wet Bulb (66.2°F Wet Bulb) and outdoor air temperature of 35°C Dry Bulb (95°F Dry Bulb), 24°C Wet Bulb (75.2°F Wet Bulb)
2. Heating capacities are based on indoor temperature of 20°C Dry Bulb (68°F Dry Bulb) and outdoor air temperature of 7°C Dry Bulb (44.6°F Dry Bulb), 6°C Wet Bulb (42.8°F Wet Bulb)
3. Heating low temperature capacity, Input Power and COP measured at 230 V, indoor temperature 20°C, outdoor 2/1°C
4. Heating extreme low temperature capacity, Input Power and COP measured at 230 V, indoor temperature 20°C, outdoor -7/-8°C
5. Specifications are subjected to change without prior notice for further improvement.

MODEL				INDOOR		CS-E7LKEW, CS-XE7LKEW			CS-E9LKEW, CS-XE9LKEW		
				OUTDOOR		CU-E7LKE-3			CU-E9LKE-3		
Performance Test Condition						EUROVENT			EUROVENT		
Power Supply				Phase, Hz		Single, 50			Single, 50		
				V		230			230		
						Min.	Mid.	Max.	Min.	Mid.	Max.
Cooling	Capacity			kW	0.70	2.05	2.40	0.80	2.50	3.00	
				BTU/h	2390	6990	8180	2730	8530	10200	
				Kcal/h	600	1760	2060	690	2150	2580	
	Running Current			A	—	2.2	—	—	2.5	—	
	Input Power			W	170	470	580	175	535	730	
	Annual Consumption			kWh	—	235	—	—	268	—	
	EER			W/W	4.12	4.36	4.14	4.57	4.67	4.11	
				Kcal/hW	3.53	3.74	3.55	3.94	4.02	3.53	
	Power Factor			%	—	93	—	—	93	—	
	Indoor Noise (H / L / QLo)			dB-A	37 / 24 / 20			39 / 25 / 20			
				Power Level dB	53 / 40 / 36			55 / 41 / 36			
	Outdoor Noise (H / L)			dB-A	45 / -			46 / -			
				Power Level dB	60 / -			61 / -			
Heating	Capacity			kW	0.70	2.80	4.00	0.80	3.40	5.00	
				BTU/h	2390	9550	13600	2730	11600	17100	
				Kcal/h	600	2410	3440	690	2920	4300	
	Running Current			A	—	3.0	—	—	3.4	—	
	Input Power			W	160	635	1.02k	165	735	1.30k	
	COP			W/W	4.38	4.41	3.92	4.85	4.63	3.85	
				Kcal/hW	3.75	3.80	3.37	4.18	3.97	3.31	
	Power Factor			%	—	92	—	—	94	—	
	Indoor Noise (H / L / QLo)			dB-A	38 / 25 / 20			40 / 27 / 20			
				Power Level dB	54 / 41 / 36			56 / 43 / 36			
	Outdoor Noise (H / L)			dB-A	46 / -			47 / -			
				Power Level dB	61 / -			62 / -			
	Low Temp. : Capacity (kW) / I.Power (W) / COP					2.90 / 900 / 3.22			3.62 / 1.15k / 3.15		
Extr Low Temp. : Capacity (kW) / I.Power (W) / COP					2.35 / 930 / 2.53			2.88 / 1.18k / 2.44			
Max Current (A) / Max Input Power (W)					4.7 / 1.02k			5.8 / 1.30k			
Starting Current (A)					3.0			3.4			
Compressor		Type				Hermetic Motor			Hermetic Motor		
		Motor Type				Brushless (6-poles)			Brushless (6-poles)		
		Output Power		W		650			700		
Indoor Fan	Type					Cross-flow Fan			Cross-flow Fan		
	Material					ASG20K1			ASG20K1		
	Motor Type					Transistor (8-poles)			Transistor (8-poles)		
	Input Power			W		—			—		
	Output Power			W		40			40		
	Speed	QLo	Cool	rpm	590	630					
			Heat	rpm	630	670					
		Lo	Cool	rpm	670	730					
			Heat	rpm	730	820					
		Me	Cool	rpm	860	950					
			Heat	rpm	910	1030					
		Hi	Cool	rpm	1050	1180					
			Heat	rpm	1090	1240					
SHi	Cool	rpm	1110	1240							
	Heat	rpm	1150	1280							

MODEL				INDOOR	CS-E7LKEW, CS-XE7LKEW	CS-E9LKEW, CS-XE9LKEW		
				OUTDOOR	CU-E7LKE-3	CU-E9LKE-3		
Outdoor Fan	Type				Propeller Fan	Propeller Fan		
	Material				PP	PP		
	Motor Type				Induction (6-poles)	Induction (6-poles)		
	Input Power			W	62	65		
	Output Power			W	25	25		
	Speed	Hi		rpm	770	770		
Moisture Removal				L/h (Pt/h)	1.3 (2.7)	1.5 (3.2)		
Indoor Airflow				QLo	Cool	m³/min (ft³/min)	5.6 (198)	4.9 (173)
					Heat	m³/min (ft³/min)	6.0 (212)	5.3 (187)
				Lo	Cool	m³/min (ft³/min)	6.5 (230)	6.0 (212)
					Heat	m³/min (ft³/min)	7.2 (254)	7.1 (251)
				Me	Cool	m³/min (ft³/min)	8.7 (307)	8.7 (307)
					Heat	m³/min (ft³/min)	9.3 (328)	9.6 (339)
				Hi	Cool	m³/min (ft³/min)	10.9 (385)	11.3 (400)
					Heat	m³/min (ft³/min)	11.4 (400)	11.7 (410)
				SHi	Cool	m³/min (ft³/min)	11.6 (410)	11.7 (410)
					Heat	m³/min (ft³/min)	12.0 (424)	12.1 (427)
Outdoor Airflow				Hi	Cool	m³/min (ft³/min)	33.9 (1200)	29.8 (1050)
					Heat	m³/min (ft³/min)	33.9 (1200)	29.8 (1050)
Refrigeration Cycle				Control Device			Check Valve & Capillary Tube	
				Refrigerant Oil		cm³	RB68A or Freol Alpha 68M (320)	
				Refrigerant Type		g (oz)	R410A, 830 (29.3)	
Dimension				Height (I/D / O/D)		mm (inch)	290 (11-7/16) / 540 (21-9/32)	
				Width (I/D / O/D)		mm (inch)	870 (34-9/32) / 780 (30-23/32)	
				Depth (I/D / O/D)		mm (inch)	204 (8-1/16) / 289 (11-13/32)	
Weight				Net (I/D / O/D)		kg (lb)	9 (20) / 33 (73)	
							9 (20) / 34 (75)	
Piping	Pipe Diameter (Liquid / Gas)			mm (inch)	6.35 (1/4) / 9.52 (3/8)		6.35 (1/4) / 9.52 (3/8)	
	Standard Length			m (ft)	5 (16.4)		5 (16.4)	
	Length Range (min - max)			m (ft)	3 (9.8) ~ 15 (49.2)		3 (9.8) ~ 15 (49.2)	
	I/D & O/D Height Different			m (ft)	15.0 (49.2)		15.0 (49.2)	
	Additional Gas Amount			g/m (oz/ft)	20 (0.2)		20 (0.2)	
	Length for Additional Gas			m (ft)	7.5 (24.6)		7.5 (24.6)	
Drain Hose				Inner Diameter		mm	16	
				Length		mm	650	
Indoor Heat Exchanger				Fin Material			Aluminium (Pre Coat)	
				Fin Type			Slit Fin	
				Row x Stage x FPI			2 x 15 x 17	
				Size (W x H x L)		mm	610 x 315 x 25.4	
Outdoor Heat Exchanger				Fin Material			Aluminium	
				Fin Type			Corrugated Fin	
				Row x Stage x FPI			1 x 20 x 19	
				Size (W x H x L)		mm	32 x 508 x 708	
Air Filter				Material			Polypropelene	
				Type			One-touch	
Power Supply					Outdoor Power Supply		Outdoor Power Supply	
Power Supply Cord				A	Nil		Nil	
Thermostat					Electronic Control		Electronic Control	
Protection Device					Electronic Control		Electronic Control	



MODEL			INDOOR	CS-E7LKEW, CS-XE7LKEW		CS-E9LKEW, CS-XE9LKEW	
			OUTDOOR	CU-E7LKE-3		CU-E9LKE-3	
				Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
Indoor Operation Range	Cooling	Maximum		32	23	32	23
		Minimum		16	11	16	11
	Heating	Maximum		30	—	30	—
		Minimum		16	—	16	—
Outdoor Operation Range	Cooling	Maximum		43	26	43	26
		Minimum		5	4	5	4
	Heating	Maximum		24	18	24	18
		Minimum		-15	-16	-15	-16

1. Cooling capacities are based on indoor temperature of 27°C Dry Bulb (80.6°F Dry Bulb), 19.0°C Wet Bulb (66.2°F Wet Bulb) and outdoor air temperature of 35°C Dry Bulb (95°F Dry Bulb), 24°C Wet Bulb (75.2°F Wet Bulb)
2. Heating capacities are based on indoor temperature of 20°C Dry Bulb (68°F Dry Bulb) and outdoor air temperature of 7°C Dry Bulb (44.6°F Dry Bulb), 6°C Wet Bulb (42.8°F Wet Bulb)
3. Heating low temperature capacity, Input Power and COP measured at 230 V, indoor temperature 20°C, outdoor 2/1°C
4. Heating extreme low temperature capacity, Input Power and COP measured at 230 V, indoor temperature 20°C, outdoor -7/-8°C
5. Specifications are subjected to change without prior notice for further improvement.

MODEL				INDOOR	CS-E12LKEW, CS-XE12LKEW			
				OUTDOOR	CU-E12LKE-3			
Performance Test Condition					EUROVENT			
Power Supply				Phase, Hz	Single, 50			
				V	230			
					Min.	Mid.		Max.
Cooling	Capacity			kW	0.80	3.50		4.00
				BTU/h	2730	11900		13600
				Kcal/h	690	3010		3440
	Running Current			A	—	4.1		—
	Input Power			W	185	905		1.18k
	Annual Consumption			kWh	—	453		—
	EER			W/W	4.32	3.87		3.39
				Kcal/hW	3.73	3.33		2.92
	Power Factor			%	—	96		—
	Indoor Noise (H / L / QLo)			dB-A	42 / 28 / 20			
				Power Level dB	58 / 44 / 36			
	Outdoor Noise (H / L)			dB-A	48 / -			
				Power Level dB	63 / -			
Heating	Capacity			kW	0.80	4.40		6.70
				BTU/h	2730	15000		22800
				Kcal/h	690	3780		5760
	Running Current			A	—	5.1		—
	Input Power			W	175	1.09k		1.93k
	COP			W/W	4.57	4.04		3.47
				Kcal/hW	3.94	3.47		2.98
	Power Factor			%	—	93		—
	Indoor Noise (H / L / QLo)			dB-A	42 / 33 / 20			
				Power Level dB	58 / 49 / 36			
	Outdoor Noise (H / L)			dB-A	50 / -			
				Power Level dB	65 / -			
	Low Temp. : Capacity (kW) / I.Power (W) / COP					4.85 / 1.67k / 2.90		
Extr Low Temp. : Capacity (kW) / I.Power (W) / COP					3.75 / 1.68k / 2.23			
Max Current (A) / Max Input Power (W)					8.9 / 1.93k			
Starting Current (A)					5.1			
Compressor		Type			Hermetic Motor			
		Motor Type			Brushless (6-poles)			
		Output Power		W	700			
Indoor Fan	Type				Cross-flow Fan			
	Material				ASG20K1			
	Motor Type				Transistor (8-poles)			
	Input Power			W	—			
	Output Power			W	40			
	Speed	QLo	Cool	rpm	630			
			Heat	rpm	670			
		Lo	Cool	rpm	830			
			Heat	rpm	1010			
		Me	Cool	rpm	1040			
			Heat	rpm	1150			
		Hi	Cool	rpm	1260			
			Heat	rpm	1300			
		SHi	Cool	rpm	1320			
			Heat	rpm	1340			

MODEL				INDOOR	CS-E12LKEW, CS-XE12LKEW			
				OUTDOOR	CU-E12LKE-3			
Outdoor Fan	Type				Propeller Fan			
	Material				PP			
	Motor Type				Induction (6-poles)			
	Input Power			W	70			
	Output Power			W	30			
	Speed	Hi		rpm	830			
Moisture Removal				L/h (Pt/h)	2.0 (4.2)			
Indoor Airflow				QLo	Cool	m³/min (ft³/min)	4.9 (173)	
					Heat	m³/min (ft³/min)	5.3 (187)	
				Lo	Cool	m³/min (ft³/min)	7.2 (254)	
					Heat	m³/min (ft³/min)	9.4 (332)	
				Me	Cool	m³/min (ft³/min)	9.7 (343)	
					Heat	m³/min (ft³/min)	11.0 (389)	
				Hi	Cool	m³/min (ft³/min)	12.5 (440)	
					Heat	m³/min (ft³/min)	12.8 (450)	
				SHi	Cool	m³/min (ft³/min)	13.1 (463)	
					Heat	m³/min (ft³/min)	13.3 (470)	
Outdoor Airflow				Hi	Cool	m³/min (ft³/min)	31.0 (1090)	
					Heat	m³/min (ft³/min)	31.0 (1090)	
Refrigeration Cycle				Control Device		Check Valve & Capillary Tube		
				Refrigerant Oil		cm³	RB68A or Freol Alpha 68M (320)	
				Refrigerant Type		g (oz)	R410A, 970 (34.2)	
Dimension				Height (I/D / O/D)		mm (inch)		290 (11-7/16) / 540 (21-9/32)
				Width (I/D / O/D)		mm (inch)		870 (34-9/32) / 780 (30-23/32)
				Depth (I/D / O/D)		mm (inch)		204 (8-1/16) / 289 (11-13/32)
Weight				Net (I/D / O/D)		kg (lb)	9 (20) / 34 (75)	
Piping	Pipe Diameter (Liquid / Gas)			mm (inch)		6.35 (1/4) / 9.52 (3/8)		
	Standard Length			m (ft)		5 (16.4)		
	Length Range (min - max)			m (ft)		3 (9.8) ~ 15 (49.2)		
	I/D & O/D Height Different			m (ft)		15.0 (49.2)		
	Additional Gas Amount			g/m (oz/ft)		20 (0.2)		
	Length for Additional Gas			m (ft)		7.5 (24.6)		
Drain Hose				Inner Diameter		mm		16
				Length		mm		650
Indoor Heat Exchanger				Fin Material				Aluminium (Pre Coat)
				Fin Type				Slit Fin
				Row x Stage x FPI				2 x 15 x 21
				Size (W x H x L)		mm		610 x 315 x 25.4
Outdoor Heat Exchanger				Fin Material				Aluminium
				Fin Type				Corrugated Fin
				Row x Stage x FPI				2 x 24 x 17
				Size (W x H x L)		mm		36.4 x 504 x 713 684
Air Filter				Material				Polypropelene
				Type				One-touch
Power Supply						Outdoor Power Supply		
Power Supply Cord				A		Nil		
Thermostat						Electronic Control		
Protection Device						Electronic Control		

MODEL		INDOOR	CS-E12LKEW, CS-XE12LKEW	
		OUTDOOR	CU-E12LKE-3	
			Dry Bulb	Wet Bulb
Indoor Operation Range	Cooling	Maximum	32	23
		Minimum	16	11
	Heating	Maximum	30	—
		Minimum	16	—
Outdoor Operation Range	Cooling	Maximum	43	26
		Minimum	5	4
	Heating	Maximum	24	18
		Minimum	-15	-16

1. Cooling capacities are based on indoor temperature of 27°C Dry Bulb (80.6°F Dry Bulb), 19.0°C Wet Bulb (66.2°F Wet Bulb) and outdoor air temperature of 35°C Dry Bulb (95°F Dry Bulb), 24°C Wet Bulb (75.2°F Wet Bulb)
2. Heating capacities are based on indoor temperature of 20°C Dry Bulb (68°F Dry Bulb) and outdoor air temperature of 7°C Dry Bulb (44.6°F Dry Bulb), 6°C Wet Bulb (42.8°F Wet Bulb)
3. Heating low temperature capacity, Input Power and COP measured at 230 V, indoor temperature 20°C, outdoor 2/1°C
4. Heating extreme low temperature capacity, Input Power and COP measured at 230 V, indoor temperature 20°C, outdoor -7/-8°C
5. Specifications are subjected to change without prior notice for further improvement.

MODEL				INDOOR		CS-E18LKEW, CS-XE18LKEW			CS-E21LKEW, CS-XE21LKEW							
				OUTDOOR		CU-E18LKE			CU-E21LKE							
Performance Test Condition						EUROVENT			EUROVENT							
Power Supply				Phase, Hz		Single, 50			Single, 50							
				V		230			230							
						Min.	Mid.	Max.	Min.	Mid.	Max.					
Cooling	Capacity			kW	0.90		5.00		6.00		0.90		6.30		7.10	
				BTU/h	3070		17100		20500		3070		21500		24200	
				Kcal/h	770		4300		5160		770		5420		6110	
	Running Current			A	—		6.7		—		—		9.8		—	
	Input Power			W	215		1.47k		2.03k		215		2.21k		2.54k	
	Annual Consumption			kWh	—		735		—		—		1105		—	
	EER			W/W	4.19		3.40		2.96		4.19		2.85		2.80	
				Kcal/hW	3.58		2.93		2.54		3.58		2.45		2.41	
	Power Factor			%	—		95		—		—		98		—	
	Indoor Noise (H / L / QLo)			dB-A	44 / 37 / 34					45 / 37 / 34						
				Power Level dB	60 / 53 / 50					61 / 53 / 50						
	Outdoor Noise (H / L)			dB-A	47 / -					48 / -						
				Power Level dB	61 / -					62 / -						
Heating	Capacity			kW	0.90		5.80		8.00		0.90		7.20		8.50	
				BTU/h	3070		19800		27300		3070		24600		29000	
				Kcal/h	770		4990		6880		770		6190		7310	
	Running Current			A	—		7.0		—		—		9.3		—	
	Input Power			W	245		1.54k		2.60k		245		2.10k		2.75k	
	COP			W/W	3.67		3.77		3.08		3.67		3.43		3.09	
				Kcal/hW	3.14		3.24		2.65		3.14		2.95		2.66	
	Power Factor			%	—		96		—		—		98		—	
	Indoor Noise (H / L / QLo)			dB-A	44 / 37 / 34					45 / 37 / 34						
				Power Level dB	60 / 53 / 50					61 / 53 / 50						
	Outdoor Noise (H / L)			dB-A	47 / -					49 / -						
				Power Level dB	61 / -					63 / -						
	Low Temp. : Capacity (kW) / I.Power (W) / COP					5.80 / 2.35k / 2.47					6.16 / 2.43k / 2.53					
Extr Low Temp. : Capacity (kW) / I.Power (W) / COP					4.98 / 2.41k / 2.07					5.24 / 2.54k / 2.06						
Max Current (A) / Max Input Power (W)					11.7 / 2.60k					12.1 / 2.75k						
Starting Current (A)					7.0					9.8						
Compressor		Type				Hermetic Motor				Hermetic Motor						
		Motor Type				Brushless (4-poles)				Brushless (4-poles)						
		Output Power		W		900				900						
Indoor Fan	Type					Cross-flow Fan				Cross-flow Fan						
	Material					ASG30K1				ASG30K1						
	Motor Type					Transistor (8-poles)				Transistor (8-poles)						
	Input Power			W		—				—						
	Output Power			W		40				40						
	Speed		QLo	Cool	rpm	960				960						
				Heat	rpm	1040				1040						
			Lo	Cool	rpm	1040				1050						
				Heat	rpm	1120				1120						
			Me	Cool	rpm	1160				1180						
				Heat	rpm	1240				1290						
			Hi	Cool	rpm	1280				1320						
				Heat	rpm	1360				1460						
			SHi	Cool	rpm	1390				1460						
				Heat	rpm	1430				1480						

MODEL				INDOOR	CS-E18LKEW, CS-XE18LKEW	CS-E21LKEW, CS-XE21LKEW	
				OUTDOOR	CU-E18LKE	CU-E21LKE	
Outdoor Fan	Type				Propeller Fan	Propeller Fan	
	Material				PP	PP	
	Motor Type				PWM (8-poles)	PWM (8-poles)	
	Input Power			W	74.8	74.8	
	Output Power			W	40	40	
	Speed	Hi	Cool	rpm	660	700	
			Heat	rpm	640	680	
Moisture Removal				L/h (Pt/h)	2.8 (5.9)	3.5 (7.4)	
Indoor Airflow			QLo	Cool	m³/min (ft³/min)	12.00 (424)	12.00 (424)
				Heat	m³/min (ft³/min)	13.20 (466)	13.20 (466)
			Lo	Cool	m³/min (ft³/min)	13.20 (466)	13.30 (470)
				Heat	m³/min (ft³/min)	14.30 (505)	14.30 (505)
			Me	Cool	m³/min (ft³/min)	14.90 (526)	15.10 (533)
				Heat	m³/min (ft³/min)	16.00 (565)	16.20 (572)
			Hi	Cool	m³/min (ft³/min)	16.30 (575)	17.30 (610)
				Heat	m³/min (ft³/min)	17.90 (630)	18.50 (655)
			SHi	Cool	m³/min (ft³/min)	18.10 (639)	19.10 (675)
				Heat	m³/min (ft³/min)	18.50 (653)	19.40 (685)
Outdoor Airflow			Hi	Cool	m³/min (ft³/min)	40.0 (1410)	42.8 (1510)
				Heat	m³/min (ft³/min)	38.6 (1360)	41.5 (1460)
Refrigeration Cycle		Control Device			Expansion Valve		
		Refrigerant Oil		cm³	RB68A or Freol Alpha 68M (400)		
		Refrigerant Type		g (oz)	R410A, 1.15k (40.6)		
Dimension		Height (I/D / O/D)		mm (inch)	290 (11-7/16) / 750 (29-17/32)		
		Width (I/D / O/D)		mm (inch)	1070 (42-5/32) / 875 (34-15/32)		
		Depth (I/D / O/D)		mm (inch)	235 (9-9/32) / 345 (13-19/32)		
Weight		Net (I/D / O/D)		kg (lb)	12 (26) / 48 (106)		
Piping	Pipe Diameter (Liquid / Gas)			mm (inch)	6.35 (1/4) / 12.70 (1/2)		
	Standard Length			m (ft)	5.0 (16.4)		
	Length Range (min - max)			m (ft)	3 (9.8) ~ 20 (65.5)		
	I/D & O/D Height Different			m (ft)	15.0 (49.2)		
	Additional Gas Amount			g/m (oz/ft)	20 (0.2)		
	Length for Additional Gas			m (ft)	10.0 (32.8)		
Drain Hose		Inner Diameter		mm	16		
		Length		mm	650		
Indoor Heat Exchanger		Fin Material			Aluminium (Pre Coat)		
		Fin Type			Slit Fin		
		Row x Stage x FPI			2 x 15 x 19		
		Size (W x H x L)		mm	810 x 315 x 25.4		
Outdoor Heat Exchanger		Fin Material			Aluminium (Pre Coat)		
		Fin Type			Corrugated Fin		
		Row x Stage x FPI			2 x 34 x 17		
		Size (W x H x L)		mm	36.4 x 714 x 794 823		
Air Filter		Material			Polypropelene		
		Type			One-touch		
Power Supply					Outdoor Power Supply		
Power Supply Cord				A	Nil		
Thermostat					Electronic Control		

MODEL			INDOOR	CS-E18LKEW, CS-XE18LKEW		CS-E21LKEW, CS-XE21LKEW	
			OUTDOOR	CU-E18LKE		CU-E21LKE	
Protection Device				Electronic Control		Electronic Control	
				Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
Indoor Operation Range	Cooling	Maximum		32	23	32	23
		Minimum		16	11	16	11
	Heating	Maximum		30	—	30	—
		Minimum		16	—	16	—
Outdoor Operation Range	Cooling	Maximum		43	26	43	26
		Minimum		5	4	5	4
	Heating	Maximum		24	18	24	18
		Minimum		-5	-6	-5	-6

1. Cooling capacities are based on indoor temperature of 27°C Dry Bulb (80.6°F Dry Bulb), 19.0°C Wet Bulb (66.2°F Wet Bulb) and outdoor air temperature of 35°C Dry Bulb (95°F Dry Bulb), 24°C Wet Bulb (75.2°F Wet Bulb)
2. Heating capacities are based on indoor temperature of 20°C Dry Bulb (68°F Dry Bulb) and outdoor air temperature of 7°C Dry Bulb (44.6°F Dry Bulb), 6°C Wet Bulb (42.8°F Wet Bulb)
3. Heating low temperature capacity, Input Power and COP measured at 230 V, indoor temperature 20°C, outdoor 2/1°C
4. Heating extreme low temperature capacity, Input Power and COP measured at 230 V, indoor temperature 20°C, outdoor -7/-8°C
5. Specifications are subjected to change without prior notice for further improvement.

• **Multi Split Combination Possibility:**

- A single outdoor unit enables air conditioning of up to two separate rooms for CU-2E15GBE, CU-2E18CBPG.
- A single outdoor unit enables air conditioning of up to three separate rooms for CU-3E18EBE, CU-3E23CBPG.
- A single outdoor unit enables air conditioning of up to four separate rooms for CU-4E27CBPG

CONNECTABLE INDOOR UNIT			OUTDOOR UNIT													
			CU-2E15GBE		CU-2E18CBPG		CU-3E18EBE			CU-3E23CBPG			CU-4E27CBPG			
ROOM			A	B	A	B	A	B	C	A	B	C	A	B	C	D
Type																
Wall	2.2kW	CS-E7LKEW	●	●	●	●	●	●	●	●	●	●	●	●	●	●
	2.8kW	CS-E9LKEW	●	●	●	●	●	●	●	●	●	●	●	●	●	●
	3.2kW	CS-E12LKEW	●	●	●	●	●	●	●	●	●	●	●	●	●	●
	4.0kW	CS-E15LKEW	—	—	—	—	●	●	●	●	●	●	●	●	●	●
	5.0kW	CS-E18LKEW	—	—	—	—	●	●	●	●	●	●	●	●	●	●
Capacity range of connectable indoor units			From 4.4kW to 5.6kW		From 4.4kW to 6.4kW		From 5.0kW to 9.0kW			From 5.0kW to 10kW			From 5.0kW to 13.6kW			
Pipe length	1-room maximum pipe length (m)		20		20		25			25			25			
	Allowable elevation (m)		10		10		15			15			15			
	Total allowable pipe length (m)		30		30		50			50			70			
	Total pipe length for maximum chargeless length (m)		20		20		30			30			40			
	Additional gas amount over chargeless length (m)		20		20		20			20			20			

Note: "●" : Available

Remarks for CU-2E15GBE / CU-2E18CBPG

- At least two indoor units must be connected.
- The total nominal cooling capacity of indoor units that will be connected to outdoor unit must be within connectable capacity range of indoor unit. (as shown in the table above)  
Example: The indoor units' combination below is possible to connect to CU-2E15GBE. (Total nominal capacity of indoor units is between 4.4kW to 5.6kW)  
1) Two CS-E7LKEW only (Total nominal cooling capacity is 4.4kW)  
2) One CS-E7LKEW and one CS-E9LKEW. (Total nominal cooling capacity is 5.0kW)

Remarks for CU-3E18EBE / CU-3E23CBPG / CU-4E27CBPG

- At least two indoor units must be connected.
- The total nominal cooling capacity of indoor units that will be connected to outdoor unit must be within connectable capacity range of indoor unit. (as shown in the table above)  
Example: The indoor units' combination below is possible to connect to CU-3E23CBPG. (Total nominal capacity of indoor units is between 5.0kW to 10.0kW)  
1) Two CS-E9LKEW only (Total nominal cooling capacity is 5.6kW)  
2) Three CS-E12LKEW. (Total nominal cooling capacity is 9.6kW)

Outdoor Unit	Indoor unit combination		Operation mode	Capacity (kW)		Power input (kW)		Current (A)
	Operation	Class (kW)		Rating	min - max	Rating	min - max	
CU-2E15GBE	One-room Operation	2.2	Cooling	2.20	1.1 - 2.9	0.52	0.22 - 0.75	2.45
			Heating	3.20	0.7 - 4.8	0.85	0.17 - 1.41	3.75
		2.8	Cooling	2.80	1.1 - 3.5	0.75	0.22 - 1.00	3.50
			Heating	4.00	0.7 - 5.5	1.15	0.17 - 1.70	5.10
		3.2	Cooling	3.20	1.1 - 4.0	0.92	0.22 - 1.22	4.30
			Heating	4.50	0.7 - 6.2	1.25	0.17 - 1.81	5.55
	Two-room Operation	2.2 + 2.2	Cooling	4.50	1.5 - 5.0	1.23	0.25 - 1.35	5.75
			Heating	5.40	1.1 - 7.0	1.17	0.21 - 1.67	5.20
		2.2 + 2.8	Cooling	4.50	1.5 - 5.2	1.25	0.25 - 1.53	5.80
			Heating	5.40	1.1 - 7.0	1.23	0.21 - 1.72	5.45
		2.2 + 3.2	Cooling	4.50	1.5 - 5.2	1.25	0.25 - 1.53	5.80
			Heating	5.40	1.1 - 7.0	1.23	0.21 - 1.72	5.45
		2.8 + 2.8	Cooling	4.50	1.5 - 5.2	1.23	0.25 - 1.52	5.75
			Heating	5.40	1.1 - 7.0	1.17	0.21 - 1.67	5.20



Outdoor Unit	Indoor unit combination		Operation mode	Capacity (kW)		Power input (kW)		Current (A)
	Operation	Class (kW)		Rating	min - max	Rating	min - max	
CU-3E18EBE	One-room Operation	2.2	Cooling	2.20	1.8 - 2.9	0.50	0.34 - 0.81	2.5
			Heating	3.20	1.2 - 4.1	0.74	0.30 - 1.23	3.7
		2.8	Cooling	2.80	1.8 - 2.9	0.70	0.34 - 0.81	3.3
			Heating	4.00	1.2 - 4.3	1.05	0.30 - 1.23	5.0
		3.2	Cooling	3.20	1.8 - 3.8	0.80	0.34 - 1.36	3.7
			Heating	4.50	1.2 - 5.8	1.23	0.30 - 2.10	5.8
		4.0	Cooling	4.00	1.8 - 4.3	1.24	0.34 - 1.99	5.6
			Heating	5.60	1.2 - 6.8	1.72	0.30 - 2.93	7.7
		5.0	Cooling	5.00	1.9 - 5.7	1.55	0.34 - 2.13	6.8
			Heating	6.80	1.2 - 6.9	2.10	0.30 - 2.52	9.2
	Two-room Operation	2.2 + 2.2	Cooling	4.40	1.9 - 6.2	1.11	0.35 - 2.10	4.9
			Heating	5.80	1.4 - 7.0	1.45	0.31 - 2.55	6.4
		2.2 + 2.8	Cooling	5.00	1.9 - 6.2	1.41	0.35 - 2.10	6.2
			Heating	6.40	1.4 - 7.0	1.72	0.31 - 2.55	7.6
		2.2 + 3.2	Cooling	5.20	1.9 - 6.3	1.49	0.35 - 2.11	6.6
			Heating	6.80	1.4 - 7.3	1.84	0.31 - 2.52	8.2
		2.2 + 4.0	Cooling	5.20	1.9 - 6.4	1.45	0.35 - 2.11	6.4
			Heating	6.80	1.4 - 7.3	1.80	0.31 - 2.51	7.9
		2.2 + 5.0	Cooling	5.20	1.9 - 6.8	1.29	0.36 - 2.15	5.7
			Heating	6.80	1.4 - 8.0	1.52	0.31 - 2.20	6.7
		2.8 + 2.8	Cooling	5.20	1.9 - 6.2	1.54	0.35 - 2.10	6.8
			Heating	6.80	1.4 - 7.0	1.93	0.31 - 2.55	8.5
		2.8 + 3.2	Cooling	5.20	1.9 - 6.3	1.48	0.35 - 2.11	6.5
			Heating	6.80	1.4 - 7.3	1.84	0.31 - 2.52	8.1
		2.8 + 4.0	Cooling	5.20	1.9 - 6.4	1.44	0.35 - 2.11	6.4
			Heating	6.80	1.4 - 7.3	1.80	0.31 - 2.51	8.0
		2.8 + 5.0	Cooling	5.20	1.9 - 6.8	1.29	0.36 - 2.15	5.7
			Heating	6.80	1.4 - 8.0	1.52	0.31 - 2.20	6.7
		3.2 + 3.2	Cooling	5.20	1.9 - 6.4	1.45	0.35 - 2.12	6.4
			Heating	6.80	1.4 - 7.5	1.75	0.31 - 2.49	7.7
		3.2 + 4.0	Cooling	5.20	1.9 - 6.5	1.41	0.35 - 2.12	6.3
			Heating	6.80	1.4 - 7.5	1.75	0.31 - 2.47	7.8
		3.2 + 5.0	Cooling	5.20	1.9 - 6.9	1.25	0.36 - 2.15	5.5
			Heating	6.80	1.4 - 8.0	1.50	0.31 - 2.18	6.6
		4.0 + 4.0	Cooling	5.20	1.9 - 6.5	1.41	0.35 - 2.12	6.2
			Heating	6.80	1.4 - 7.6	1.71	0.31 - 2.47	7.5
		4.0 + 5.0	Cooling	5.20	1.9 - 6.9	1.25	0.36 - 2.16	5.5
			Heating	6.80	1.4 - 8.0	1.50	0.31 - 2.17	6.6
	Three-room Operation	2.2 + 2.2 + 2.2	Cooling	5.20	1.9 - 7.2	1.24	0.36 - 2.17	5.4
			Heating	6.78	1.5 - 8.1	1.53	0.32 - 2.12	6.7
		2.2 + 2.2 + 2.8	Cooling	5.20	1.9 - 7.2	1.24	0.36 - 2.17	5.4
			Heating	6.80	1.5 - 8.1	1.53	0.32 - 2.12	6.7
		2.2 + 2.2 + 3.2	Cooling	5.20	1.9 - 7.2	1.23	0.36 - 2.18	5.4
			Heating	6.80	1.4 - 8.3	1.49	0.32 - 2.11	6.5
		2.2 + 2.2 + 4.0	Cooling	5.20	1.8 - 7.3	1.23	0.36 - 2.18	5.4
			Heating	6.80	1.6 - 8.3	1.46	0.32 - 2.11	6.4
		2.2 + 2.8 + 2.8	Cooling	5.20	1.9 - 7.2	1.24	0.36 - 2.17	5.4
			Heating	6.80	1.5 - 8.1	1.53	0.32 - 2.12	6.7
		2.2 + 2.8 + 3.2	Cooling	5.20	1.9 - 7.2	1.23	0.36 - 2.18	5.4
			Heating	6.80	1.4 - 8.3	1.49	0.32 - 2.11	6.5
		2.2 + 2.8 + 4.0	Cooling	5.20	1.8 - 7.3	1.22	0.36 - 2.18	5.4
			Heating	6.80	1.6 - 8.3	1.42	0.32 - 2.11	6.5
		2.2 + 3.2 + 3.2	Cooling	5.20	1.8 - 7.3	1.22	0.36 - 2.18	5.4
			Heating	6.80	1.6 - 8.3	1.43	0.32 - 2.10	6.3
		2.8 + 2.8 + 2.8	Cooling	5.19	1.9 - 7.2	1.24	0.36 - 2.17	5.4
			Heating	6.80	1.5 - 8.1	1.53	0.32 - 2.12	6.7
		2.8 + 2.8 + 3.2	Cooling	5.20	1.9 - 7.2	1.23	0.36 - 2.18	5.4
			Heating	6.80	1.4 - 8.3	1.49	0.32 - 2.11	6.5

Outdoor Unit	Indoor unit combination		Operation mode	Capacity (kW)		Power input (kW)		Current (A)
	Operation	Class (kW)		Rating	min - max	Rating	min - max	
CU-3E23CBPG	One-room Operation	2.2	Cooling	2.20	1.9 - 2.7	0.45	0.38 - 0.62	2.25
			Heating	3.20	1.7 - 4.1	0.84	0.37 - 1.31	3.85
		2.8	Cooling	2.80	2.0 - 3.4	0.62	0.38 - 0.90	2.95
			Heating	4.00	1.7 - 4.3	1.21	0.37 - 1.40	5.40
		3.2	Cooling	3.20	2.0 - 3.9	0.72	0.38 - 1.09	3.40
			Heating	4.50	1.7 - 5.7	1.31	0.37 - 1.91	5.85
		4.0	Cooling	4.00	2.0 - 4.4	1.03	0.38 - 1.39	4.60
			Heating	5.60	1.8 - 7.2	1.90	0.37 - 2.92	8.35
		5.0	Cooling	5.00	2.1 - 5.2	1.61	0.40 - 1.80	7.15
			Heating	7.10	2.1 - 7.3	2.84	0.43 - 2.89	12.40
	Two-room Operation	2.2 + 2.2	Cooling	4.40	2.1 - 5.0	0.98	0.40 - 1.26	4.45
			Heating	6.30	1.8 - 8.6	1.41	0.40 - 2.57	6.25
		2.2 + 2.8	Cooling	5.00	2.1 - 6.1	1.23	0.40 - 1.88	5.50
			Heating	7.10	2.1 - 8.6	1.70	0.42 - 2.57	7.55
		2.2 + 3.2	Cooling	5.40	2.2 - 7.0	1.37	0.40 - 2.79	6.10
			Heating	7.50	2.2 - 8.7	1.74	0.42 - 2.97	7.75
		2.2 + 4.0	Cooling	6.20	2.2 - 7.1	1.82	0.40 - 2.79	8.00
			Heating	8.20	2.4 - 8.7	2.01	0.44 - 2.97	8.85
		2.2 + 5.0	Cooling	6.80	2.5 - 7.1	2.24	0.46 - 2.80	9.85
			Heating	8.60	3.2 - 9.0	2.16	0.53 - 2.96	9.50
		2.8 + 2.8	Cooling	5.60	2.2 - 6.9	1.55	0.40 - 2.78	6.85
			Heating	7.70	2.3 - 8.7	1.93	0.44 - 3.04	8.45
		2.8 + 3.2	Cooling	6.00	2.2 - 7.0	1.70	0.40 - 2.79	7.55
			Heating	8.00	2.4 - 8.8	1.97	0.44 - 3.02	8.60
		2.8 + 4.0	Cooling	6.80	2.2 - 7.1	2.39	0.46 - 2.79	10.50
			Heating	8.60	2.1 - 9.0	2.175	0.53 - 3.03	9.55
		2.8 + 5.0	Cooling	6.80	2.5 - 7.2	2.23	0.46 - 2.80	9.85
			Heating	8.60	3.2 - 9.0	2.15	0.53 - 3.01	9.50
		3.2 + 3.2	Cooling	6.40	2.2 - 7.3	1.86	0.40 - 2.81	8.15
			Heating	8.40	2.5 - 9.0	2.05	0.47 - 2.97	9.05
		3.2 + 4.0	Cooling	6.80	2.5 - 7.3	2.22	0.46 - 2.81	9.65
			Heating	8.60	3.2 - 9.0	2.09	0.53 - 2.97	9.20
		3.2 + 5.0	Cooling	6.80	2.6 - 7.4	2.12	0.46 - 2.82	9.30
			Heating	8.60	3.2 - 9.0	2.08	0.53 - 2.95	9.15
		4.0 + 4.0	Cooling	6.80	2.5 - 7.3	2.19	0.46 - 2.81	9.65
			Heating	8.60	3.2 - 9.0	2.08	0.53 - 2.97	9.15
		4.0 + 5.0	Cooling	6.80	2.7 - 7.4	2.11	0.48 - 2.82	9.30
			Heating	8.60	3.2 - 9.1	2.07	0.53 - 2.95	9.15
		5.0 + 5.0	Cooling	6.80	2.8 - 7.4	2.07	0.48 - 2.82	9.15
			Heating	8.60	3.5 - 9.1	2.07	0.59 - 2.94	9.15
	Three-room Operation	2.2 + 2.2 + 2.2	Cooling	6.60	2.2 - 7.7	1.85	0.41 - 2.45	8.10
			Heating	8.53	3.1 - 8.9	1.94	0.50 - 2.80	8.50
		2.2 + 2.2 + 2.8	Cooling	6.80	2.5 - 8.1	1.98	0.46 - 2.82	8.70
			Heating	8.60	3.2 - 8.9	1.98	0.51 - 2.80	8.70
		2.2 + 2.2 + 3.2	Cooling	6.80	2.5 - 8.1	1.99	0.46 - 2.79	8.80
			Heating	8.60	3.2 - 9.0	1.96	0.51 - 2.78	8.60
		2.2 + 2.2 + 4.0	Cooling	6.80	2.6 - 8.2	1.97	0.46 - 2.79	8.60
			Heating	8.60	3.2 - 8.8	1.94	0.51 - 2.76	8.50
		2.2 + 2.2 + 5.0	Cooling	6.80	2.8 - 8.3	1.96	0.49 - 2.79	8.60
			Heating	8.60	3.2 - 8.8	1.92	0.51 - 2.76	8.45
		2.2 + 2.8 + 2.8	Cooling	6.80	2.5 - 8.1	1.95	0.46 - 2.78	8.50
			Heating	8.60	3.2 - 9.0	1.93	0.51 - 2.73	8.45
		2.2 + 2.8 + 3.2	Cooling	6.80	2.6 - 8.1	1.98	0.46 - 2.79	8.70
			Heating	8.60	3.2 - 8.8	1.93	0.51 - 2.76	8.45
		2.2 + 2.8 + 4.0	Cooling	6.80	2.7 - 8.2	1.96	0.49 - 2.79	8.60
			Heating	8.60	3.2 - 9.0	1.91	0.51 - 2.76	8.35
		2.2 + 2.8 + 5.0	Cooling	6.80	2.8 - 8.3	1.95	0.49 - 2.79	8.50
			Heating	8.60	3.5 - 9.0	1.92	0.56 - 2.73	8.45
		2.2 + 3.2 + 3.2	Cooling	6.80	2.7 - 8.3	1.97	0.46 - 2.80	8.60
			Heating	8.60	3.2 - 9.1	1.91	0.50 - 2.71	8.35
		2.2 + 3.2 + 4.0	Cooling	6.80	2.8 - 8.3	1.95	0.49 - 2.80	8.50
			Heating	8.60	3.2 - 9.0	1.89	0.50 - 2.71	8.25
		2.8 + 2.8 + 2.8	Cooling	6.78	2.6 - 8.1	1.94	0.46 - 2.82	8.50
			Heating	8.58	3.2 - 9.0	1.91	0.51 - 2.76	8.35

Outdoor Unit	Indoor unit combination		Operation mode	Capacity (kW)		Power input (kW)		Current (A)
	Operation	Class (kW)		Rating	min - max	Rating	min - max	
CU-3E23CBPG	Three-room Operation	2.8 + 2.8 + 3.2	Cooling	6.80	2.7 - 8.2	1.96	0.49 - 2.79	8.60
			Heating	8.60	3.2 - 9.0	1.92	0.51 - 2.76	8.45
		2.8 + 2.8 + 4.0	Cooling	6.80	2.8 - 8.2	1.95	0.49 - 2.79	8.50
			Heating	8.60	3.3 - 9.0	1.90	0.53 - 2.76	8.35
		2.8 + 3.2 + 3.2	Cooling	6.80	2.7 - 8.3	1.96	0.49 - 2.80	8.60
			Heating	8.60	3.2 - 9.0	1.90	0.50 - 2.71	8.35
		2.8 + 3.2 + 4.0	Cooling	6.80	2.8 - 8.4	1.95	0.49 - 2.80	8.50
			Heating	8.60	3.5 - 9.1	1.88	0.56 - 2.71	8.30
		3.2 + 3.2 + 3.2	Cooling	6.78	2.8 - 8.5	1.96	0.49 - 2.80	8.60
			Heating	8.58	3.3 - 9.1	1.85	0.52 - 2.67	8.10
CU-4E27CBPG	One-room Operation	2.2	Cooling	2.20	1.9 - 2.7	0.45	0.38 - 0.62	2.25
			Heating	3.20	1.7 - 4.7	0.84	0.37 - 1.83	3.85
		2.8	Cooling	2.80	2.0 - 3.4	0.62	0.38 - 0.90	2.95
			Heating	4.00	1.7 - 4.8	1.21	0.37 - 1.90	5.40
		3.2	Cooling	3.20	2.0 - 3.9	0.72	0.38 - 1.09	3.40
			Heating	4.50	1.7 - 5.8	1.31	0.37 - 2.29	5.85
		4.0	Cooling	4.00	2.0 - 4.4	1.03	0.38 - 1.39	4.60
			Heating	5.60	1.8 - 7.2	1.90	0.37 - 3.56	8.35
		5.0	Cooling	5.00	2.1 - 5.2	1.61	0.40 - 1.80	7.15
			Heating	7.10	2.1 - 7.3	2.84	0.43 - 3.56	12.40
	Two-room Operation	2.2 + 2.2	Cooling	4.40	2.1 - 5.0	0.98	0.40 - 1.26	4.45
			Heating	6.40	1.8 - 9.4	1.48	0.40 - 3.55	6.50
		2.2 + 2.8	Cooling	5.00	2.1 - 6.1	1.23	0.40 - 1.88	5.50
			Heating	7.10	2.1 - 9.4	1.70	0.42 - 3.51	7.55
		2.2 + 3.2	Cooling	5.40	2.2 - 7.0	1.37	0.40 - 2.79	6.10
			Heating	7.50	2.2 - 9.8	1.74	0.42 - 3.49	7.65
		2.2 + 4.0	Cooling	6.20	2.2 - 7.1	1.82	0.40 - 2.79	8.00
			Heating	8.30	2.4 - 9.8	2.06	0.44 - 3.44	9.05
		2.2 + 5.0	Cooling	7.00	2.5 - 7.2	2.50	0.46 - 2.80	11.00
			Heating	8.80	3.2 - 9.9	2.26	0.53 - 3.40	9.90
		2.8 + 2.8	Cooling	5.60	2.2 - 6.9	1.55	0.40 - 2.78	6.85
			Heating	7.70	2.3 - 9.4	2.02	0.44 - 3.48	8.85
		2.8 + 3.2	Cooling	6.00	2.2 - 7.0	1.70	0.40 - 2.79	7.55
			Heating	8.10	2.4 - 9.8	1.98	0.44 - 3.46	8.70
		2.8 + 4.0	Cooling	6.80	2.2 - 7.1	2.28	0.40 - 2.79	10.00
			Heating	8.60	2.1 - 9.8	2.175	0.53 - 3.39	9.65
		2.8 + 5.0	Cooling	7.10	2.5 - 7.2	2.61	0.46 - 2.80	11.50
			Heating	9.00	3.2 - 9.9	2.39	0.53 - 3.37	10.50
		3.2 + 3.2	Cooling	6.40	2.2 - 7.3	1.86	0.40 - 2.81	8.15
			Heating	8.50	2.5 - 10.1	2.11	0.47 - 3.39	9.30
		3.2 + 4.0	Cooling	7.00	2.5 - 7.3	2.41	0.46 - 2.81	10.60
			Heating	8.80	3.2 - 10.1	2.23	0.53 - 3.34	9.85
		3.2 + 5.0	Cooling	7.40	2.6 - 7.4	2.82	0.46 - 2.88	12.30
			Heating	9.20	3.2 - 10.1	2.39	0.53 - 3.30	10.50
		4.0 + 4.0	Cooling	7.20	2.5 - 7.3	2.62	0.46 - 2.81	11.50
			Heating	9.10	3.2 - 10.1	2.36	0.53 - 3.32	10.30
		4.0 + 5.0	Cooling	7.30	2.7 - 7.4	2.67	0.48 - 2.82	11.70
			Heating	9.40	3.2 - 10.2	2.48	0.53 - 3.30	10.90
		5.0 + 5.0	Cooling	7.50	2.8 - 7.6	2.86	0.48 - 2.87	12.50
			Heating	9.40	3.5 - 10.2	2.47	0.59 - 3.29	10.90
	Three-room Operation	2.2 + 2.2 + 2.2	Cooling	6.60	2.2 - 7.8	1.66	0.41 - 2.49	7.40
			Heating	8.61	3.1 - 10.4	1.99	0.50 - 3.25	8.80
		2.2 + 2.2 + 2.8	Cooling	7.00	2.5 - 8.1	1.89	0.46 - 2.85	8.25
			Heating	8.80	3.2 - 10.4	2.01	0.51 - 3.22	8.85
		2.2 + 2.2 + 3.2	Cooling	7.30	2.5 - 8.2	1.98	0.46 - 2.79	8.70
			Heating	8.90	3.2 - 10.4	2.03	0.51 - 3.22	8.95
		2.2 + 2.2 + 4.0	Cooling	7.80	2.6 - 8.2	2.33	0.46 - 2.83	10.30
			Heating	9.20	3.2 - 10.4	2.15	0.51 - 3.18	9.50
		2.2 + 2.2 + 5.0	Cooling	8.00	2.8 - 8.3	2.46	0.49 - 2.82	10.80
			Heating	9.40	3.2 - 10.4	2.12	0.51 - 3.18	9.30
		2.2 + 2.8 + 2.8	Cooling	7.40	2.5 - 8.1	2.14	0.46 - 2.79	9.40
			Heating	9.00	3.2 - 10.4	2.09	0.51 - 3.19	9.20
		2.2 + 2.8 + 3.2	Cooling	7.60	2.6 - 8.2	2.24	0.46 - 2.84	9.85
			Heating	9.20	3.2 - 10.4	2.11	0.51 - 3.18	9.30
		2.2 + 2.8 + 4.0	Cooling	8.00	2.7 - 8.2	2.51	0.49 - 2.80	11.00
			Heating	9.40	3.2 - 10.4	2.16	0.51 - 3.14	9.50

Outdoor Unit	Indoor unit combination		Operation mode	Capacity (kW)		Power input (kW)		Current (A)
	Operation	Class (kW)		Rating	min - max	Rating	min - max	
CU-4E27CBPG	Three-room Operation	2.2 + 2.8 + 5.0	Cooling	8.00	2.8 - 8.3	2.46	0.49 - 2.80	10.80
			Heating	9.40	3.5 - 10.4	2.08	0.56 - 3.15	9.15
		2.2 + 3.2 + 3.2	Cooling	7.90	2.7 - 8.3	2.29	0.46 - 2.81	10.10
			Heating	9.30	3.2 - 10.5	2.13	0.50 - 3.18	9.40
		2.2 + 3.2 + 4.0	Cooling	8.00	2.8 - 8.4	2.38	0.49 - 2.84	10.40
			Heating	9.40	3.2 - 10.5	2.15	0.50 - 3.14	9.50
		2.2 + 3.2 + 5.0	Cooling	8.00	2.8 - 8.3	2.47	0.49 - 2.84	10.90
			Heating	9.40	3.7 - 10.5	2.17	0.62 - 3.14	9.55
		2.2 + 4.0 + 4.0	Cooling	8.00	2.8 - 8.4	2.38	0.49 - 2.81	10.40
			Heating	9.40	3.6 - 10.5	2.11	0.62 - 3.11	9.30
		2.2 + 4.0 + 5.0	Cooling	8.00	2.8 - 8.3	2.47	0.49 - 2.81	10.90
			Heating	9.40	3.9 - 10.5	2.12	0.66 - 3.11	9.30
		2.2 + 5.0 + 5.0	Cooling	8.00	2.9 - 8.4	2.43	0.49 - 2.83	10.70
			Heating	9.40	4.1 - 10.5	2.17	0.70 - 3.12	9.55
		2.8 + 2.8 + 2.8	Cooling	7.80	2.6 - 8.1	2.45	0.46 - 2.82	10.80
			Heating	9.24	3.2 - 10.4	2.17	0.51 - 3.16	9.55
		2.8 + 2.8 + 3.2	Cooling	8.00	2.7 - 8.2	2.51	0.49 - 2.81	11.00
			Heating	9.40	3.2 - 10.4	2.19	0.51 - 3.15	9.65
		2.8 + 2.8 + 4.0	Cooling	8.00	2.8 - 8.2	2.51	0.49 - 2.79	11.00
			Heating	9.40	3.3 - 10.4	2.14	0.53 - 3.13	9.40
		2.8 + 2.8 + 5.0	Cooling	8.00	2.8 - 8.3	2.46	0.49 - 2.79	10.80
			Heating	9.40	3.8 - 10.4	2.10	0.64 - 3.12	9.20
		2.8 + 3.2 + 3.2	Cooling	8.00	2.7 - 8.4	2.38	0.49 - 2.85	10.40
			Heating	9.40	3.2 - 10.5	2.17	0.50 - 3.15	9.55
		2.8 + 3.2 + 4.0	Cooling	8.00	2.8 - 8.4	2.38	0.49 - 2.82	10.40
			Heating	9.40	3.5 - 10.5	2.13	0.56 - 3.12	9.40
		2.8 + 3.2 + 5.0	Cooling	8.00	2.8 - 8.4	2.34	0.49 - 2.83	10.30
			Heating	9.40	3.9 - 10.5	2.15	0.66 - 3.12	9.50
		2.8 + 4.0 + 4.0	Cooling	8.00	2.8 - 8.4	2.38	0.49 - 2.80	10.40
			Heating	9.40	3.8 - 10.5	2.06	0.64 - 3.08	9.05
		2.8 + 4.0 + 5.0	Cooling	8.00	2.8 - 8.4	2.34	0.49 - 2.80	10.30
			Heating	9.40	4.0 - 10.5	2.10	0.68 - 3.08	9.20
		2.8 + 5.0 + 5.0	Cooling	8.00	2.9 - 8.5	2.34	0.52 - 2.80	10.30
			Heating	9.40	4.2 - 10.5	2.14	0.70 - 3.08	9.40
		3.2 + 3.2 + 3.2	Cooling	7.98	2.8 - 8.5	2.30	0.49 - 2.83	10.10
			Heating	9.39	3.3 - 10.5	2.16	0.52 - 3.18	9.50
		3.2 + 3.2 + 4.0	Cooling	8.00	2.8 - 8.4	2.39	0.49 - 2.80	10.50
			Heating	9.40	3.7 - 10.5	2.14	0.62 - 3.15	9.40
		3.2 + 3.2 + 5.0	Cooling	8.00	2.8 - 8.4	2.39	0.49 - 2.83	10.50
			Heating	9.40	4.0 - 10.5	2.13	0.68 - 3.12	9.40
		3.2 + 4.0 + 4.0	Cooling	8.00	2.8 - 8.4	2.39	0.49 - 2.82	10.50
			Heating	9.40	3.9 - 10.5	2.12	0.66 - 3.12	9.30
		3.2 + 4.0 + 5.0	Cooling	8.00	2.9 - 8.4	2.35	0.49 - 2.82	10.30
			Heating	9.40	4.1 - 10.5	2.10	0.70 - 3.10	9.20
		3.2 + 5.0 + 5.0	Cooling	8.00	2.9 - 8.5	2.35	0.52 - 2.81	10.30
			Heating	9.40	4.2 - 10.5	2.06	0.70 - 3.08	9.05
		4.0 + 4.0 + 4.0	Cooling	7.98	2.9 - 8.4	2.39	0.49 - 2.84	10.50
			Heating	9.39	4.0 - 10.5	2.10	0.68 - 3.08	9.20
		4.0 + 4.0 + 5.0	Cooling	8.00	2.9 - 8.4	2.39	0.52 - 2.81	10.50
			Heating	9.40	4.2 - 10.5	2.08	0.70 - 3.08	9.15
	Four-room Operation	2.2 + 2.2 + 2.2 + 2.2	Cooling	8.00	2.7 - 8.8	2.15	0.49 - 2.84	9.50
			Heating	9.40	3.2 - 10.5	2.08	0.55 - 3.14	9.15
		2.2 + 2.2 + 2.2 + 2.8	Cooling	8.00	2.8 - 8.8	2.14	0.49 - 2.88	9.40
			Heating	9.40	3.2 - 10.5	2.06	0.55 - 3.12	9.05
		2.2 + 2.2 + 2.2 + 3.2	Cooling	8.00	2.8 - 8.9	2.13	0.49 - 2.88	9.40
			Heating	9.40	3.4 - 10.5	2.12	0.59 - 3.18	9.30
		2.2 + 2.2 + 2.2 + 4.0	Cooling	8.00	2.8 - 8.9	2.11	0.49 - 2.87	9.30
			Heating	9.40	3.8 - 10.5	2.09	0.64 - 3.14	9.20
		2.2 + 2.2 + 2.2 + 5.0	Cooling	8.00	2.8 - 8.9	2.11	0.49 - 2.84	9.30
			Heating	9.40	4.0 - 10.5	2.12	0.68 - 3.11	9.30
		2.2 + 2.2 + 2.8 + 2.8	Cooling	8.00	2.8 - 8.8	2.13	0.49 - 2.87	9.40
			Heating	9.40	3.5 - 10.5	2.05	0.61 - 3.11	9.05
		2.2 + 2.2 + 2.8 + 3.2	Cooling	8.00	2.8 - 8.9	2.12	0.49 - 2.87	9.30
			Heating	9.40	3.7 - 10.5	2.10	0.62 - 3.16	9.20
		2.2 + 2.2 + 2.8 + 4.0	Cooling	8.00	2.8 - 8.9	2.09	0.49 - 2.84	9.20
			Heating	9.40	3.9 - 10.5	2.07	0.66 - 3.11	9.10

Outdoor Unit	Indoor unit combination		Operation mode	Capacity (kW)		Power input (kW)		Current (A)
	Operation	Class (kW)		Rating	min - max	Rating	min - max	
CU-4E27CBPG	Four-room Operation	2.2 + 2.2 + 2.8 + 5.0	Cooling	8.00	2.9 - 8.9	2.11	0.52 - 2.88	9.30
			Heating	9.40	4.1 - 10.5	2.09	0.70 - 3.10	9.20
		2.2 + 2.2 + 3.2 + 3.2	Cooling	8.00	2.8 - 8.9	2.09	0.50 - 2.87	9.20
			Heating	9.40	3.8 - 10.5	2.11	0.64 - 3.19	9.30
		2.2 + 2.2 + 3.2 + 4.0	Cooling	8.00	2.8 - 8.9	2.08	0.50 - 2.84	9.15
			Heating	9.40	4.0 - 10.5	2.08	0.68 - 3.15	9.15
		2.2 + 2.2 + 3.2 + 5.0	Cooling	8.00	2.9 - 9.0	2.04	0.52 - 2.86	8.95
			Heating	9.40	4.1 - 10.5	2.11	0.70 - 3.08	9.30
		2.2 + 2.2 + 4.0 + 4.0	Cooling	8.00	2.9 - 9.0	2.06	0.52 - 2.85	9.05
			Heating	9.40	4.1 - 10.5	2.05	0.70 - 3.11	9.05
		2.2 + 2.2 + 4.0 + 5.0	Cooling	8.00	2.9 - 9.0	2.02	0.52 - 2.88	8.85
			Heating	9.40	4.2 - 10.5	2.08	0.70 - 3.06	9.15
		2.2 + 2.8 + 2.8 + 2.8	Cooling	8.00	2.8 - 8.8	2.12	0.49 - 2.85	9.30
			Heating	9.40	3.8 - 10.5	2.04	0.64 - 3.08	8.95
		2.2 + 2.8 + 2.8 + 3.2	Cooling	8.00	2.8 - 8.9	2.10	0.49 - 2.85	9.20
			Heating	9.40	3.9 - 10.5	2.08	0.66 - 3.13	9.15
		2.2 + 2.8 + 2.8 + 4.0	Cooling	8.00	2.8 - 8.9	2.13	0.49 - 2.86	9.40
			Heating	9.40	4.0 - 10.5	2.05	0.68 - 3.08	9.05
		2.2 + 2.8 + 2.8 + 5.0	Cooling	8.00	2.9 - 8.9	2.11	0.52 - 2.86	9.30
			Heating	9.40	4.2 - 10.5	2.08	0.70 - 3.08	9.15
		2.2 + 2.8 + 3.2 + 3.2	Cooling	8.00	2.8 - 8.9	2.13	0.50 - 2.85	9.40
			Heating	9.40	4.0 - 10.5	2.09	0.68 - 3.18	9.20
		2.2 + 2.8 + 3.2 + 4.0	Cooling	8.00	2.9 - 9.0	2.07	0.52 - 2.86	9.15
			Heating	9.40	4.1 - 10.5	2.06	0.70 - 3.12	9.05
		2.2 + 2.8 + 3.2 + 5.0	Cooling	8.00	2.9 - 9.0	2.03	0.52 - 2.84	8.95
			Heating	9.40	4.2 - 10.5	2.09	0.70 - 3.08	9.20
		2.2 + 2.8 + 4.0 + 4.0	Cooling	8.00	2.9 - 9.0	2.04	0.52 - 2.87	8.95
			Heating	9.40	4.2 - 10.5	2.03	0.70 - 3.08	8.95
		2.2 + 3.2 + 3.2 + 3.2	Cooling	8.00	2.8 - 9.1	2.04	0.50 - 2.87	8.95
			Heating	9.40	4.0 - 10.6	2.11	0.68 - 3.12	9.30
		2.2 + 3.2 + 3.2 + 4.0	Cooling	8.00	2.9 - 9.1	2.02	0.52 - 2.84	8.85
			Heating	9.40	4.1 - 10.6	2.08	0.70 - 3.08	9.15
		2.2 + 3.2 + 3.2 + 5.0	Cooling	8.00	3.0 - 9.2	2.00	0.53 - 2.87	8.80
			Heating	9.40	4.2 - 10.6	2.11	0.70 - 3.06	9.30
		2.2 + 3.2 + 4.0 + 4.0	Cooling	8.00	2.9 - 9.1	2.09	0.52 - 2.86	9.20
			Heating	9.40	4.2 - 10.6	2.06	0.70 - 3.06	9.05
		2.8 + 2.8 + 2.8 + 2.8	Cooling	8.00	2.8 - 8.8	2.11	0.49 - 2.84	9.30
			Heating	9.40	3.9 - 10.5	2.03	0.66 - 3.08	8.95
		2.8 + 2.8 + 2.8 + 3.2	Cooling	8.00	2.8 - 8.9	2.09	0.49 - 2.87	9.20
			Heating	9.40	4.0 - 10.5	2.06	0.68 - 3.10	9.05
		2.8 + 2.8 + 2.8 + 4.0	Cooling	8.00	2.9 - 8.9	2.12	0.52 - 2.85	9.30
			Heating	9.40	4.1 - 10.5	2.04	0.70 - 3.07	8.95
		2.8 + 2.8 + 2.8 + 5.0	Cooling	8.00	2.9 - 8.9	2.11	0.52 - 2.85	9.30
			Heating	9.40	4.2 - 10.5	2.07	0.70 - 3.07	9.15
		2.8 + 2.8 + 3.2 + 3.2	Cooling	8.00	2.9 - 9.0	2.08	0.50 - 2.87	9.15
			Heating	9.40	4.0 - 10.5	2.07	0.68 - 3.14	9.15
		2.8 + 2.8 + 3.2 + 4.0	Cooling	8.00	2.9 - 9.0	2.05	0.52 - 2.88	9.05
			Heating	9.40	4.2 - 10.5	2.04	0.70 - 3.08	8.95
		2.8 + 2.8 + 4.0 + 4.0	Cooling	8.00	3.0 - 9.0	2.04	0.52 - 2.86	8.95
			Heating	9.40	4.2 - 10.5	2.02	0.70 - 3.07	8.85
		2.8 + 3.2 + 3.2 + 3.2	Cooling	8.00	2.9 - 9.1	2.03	0.52 - 2.86	8.95
			Heating	9.40	4.1 - 10.6	2.09	0.70 - 3.10	9.20
		2.8 + 3.2 + 3.2 + 4.0	Cooling	8.00	2.9 - 9.1	2.01	0.52 - 2.88	8.85
			Heating	9.40	4.2 - 10.6	2.07	0.70 - 3.08	9.15
		3.2 + 3.2 + 3.2 + 3.2	Cooling	8.00	2.9 - 9.2	2.00	0.53 - 2.85	8.80
			Heating	9.40	4.2 - 10.6	2.11	0.70 - 3.08	9.30
		3.2 + 3.2 + 3.2 + 4.0	Cooling	8.00	3.0 - 9.2	1.98	0.53 - 2.87	8.70
			Heating	9.40	4.2 - 10.6	2.08	0.70 - 3.06	9.10

Outdoor Unit	Operation	Indoor Units Capacity	COOLING OPERATION					HEATING OPERATION				
			Cooling Capacity			Running Current	Power Input	Heating Capacity			Running Current	Power Input
			Room A	Room B	Total			Room A	Room B	Total		
			kW	kW	kW			kW	kW	kW		
CU-2E18CBPG	1 room	2.2	2.20	-	2.20 (1.1 - 2.9)	2.45	520 (220 - 750)	3.20	-	3.20 (0.7 - 4.8)	3.75	850 (170 - 1,410)
		2.8	2.80	-	2.80 (1.1 - 3.5)	3.50	750 (220 - 1,000)	4.00	-	4.00 (0.7 - 5.5)	5.10	1,150 (170 - 1,700)
		3.2	3.20	-	3.20 (1.1 - 4.0)	4.30	920 (220 - 1,220)	4.50	-	4.50 (0.7 - 6.2)	5.55	1,250 (170 - 1,810)
	2 room	2.2 + 2.2	2.25	2.25	4.50 (1.5 - 5.0)	5.75	1,230 (250 - 1,350)	2.70	2.70	5.40 (1.1 - 7.0)	5.20	1,170 (210 - 1,670)
		2.2 + 2.8	2.00	2.50	4.50 (1.5 - 5.2)	5.75	1,230 (250 - 1,350)	2.40	3.00	5.40 (1.1 - 7.0)	5.20	1,170 (210 - 1,670)
		2.2 + 3.2	1.95	2.85	4.80 (1.5 - 5.3)	6.10	1,310 (250 - 1,540)	2.30	3.30	5.60 (1.1 - 7.0)	5.45	1,230 (210 - 1,720)
		2.8 + 2.8	2.40	2.40	4.80 (1.5 - 5.2)	6.10	1,310 (250 - 1,520)	2.80	2.80	5.60 (1.1 - 7.2)	5.55	1,250 (210 - 1,740)
		2.8 + 3.2	2.30	2.70	5.00 (1.5 - 5.3)	6.95	1,490 (250 - 1,540)	2.60	3.00	5.60 (1.1 - 7.2)	5.45	1,230 (210 - 1,720)
		3.2 + 3.2	2.60	2.60	5.20 (1.5 - 5.4)	7.10	1,520 (250 - 1,580)	2.80	2.80	5.60 (1.1 - 7.2)	5.35	1,210 (210 - 1,700)

## 3 Features

- **Inverter Technology**

- Wider output power range
- Energy saving
- Quick Cooling
- Quick Heating
- More precise temperature control

- **E-ion Air Purifying System with Patrol Sensor**

- Active e-ions are released to catch dust particles and bring them back the large positively charged filter

- **Environment Protection**

- Non-ozone depletion substances refrigerant (R410A)

- **Long Installation Piping**

- Long piping up to 15 meters (0.75 ~ 1.75HP) and 20 meters (2.0 ~ 2.25HP) during single split connection only

- **Easy to use remote control**

- **Quality Improvement**

- Random auto restart after power failure for safety restart operation
- Gas leakage protection
- Prevent compressor reverse cycle
- Inner protector to protect Compressor
- Noise prevention during soft dry operation

- **Operation Improvement**


- Quiet mode to reduce the indoor unit operating sound
- Powerful mode to reach the desired room temperature quickly
- 24-hour timer setting

- **Serviceability Improvement**


- Breakdown Self Diagnosis function

## 4 Location of Controls and Components

### 4.1. Indoor Unit

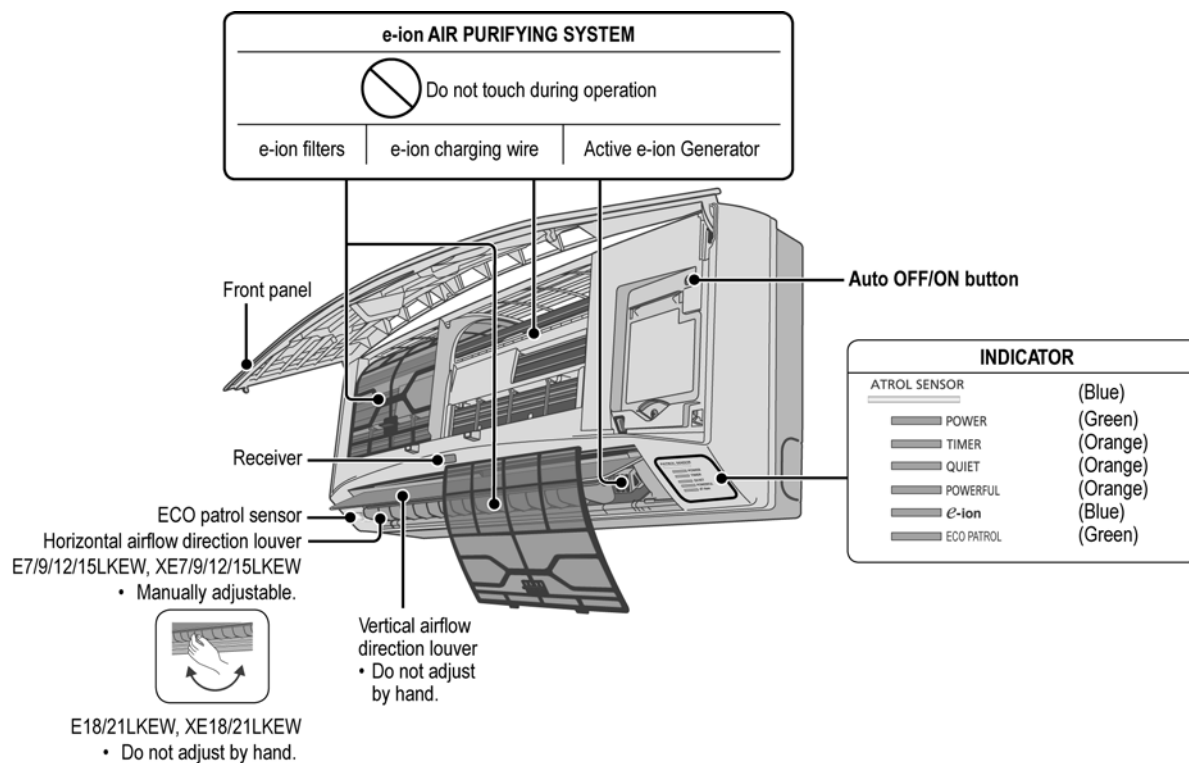


### 4.2. Outdoor Unit

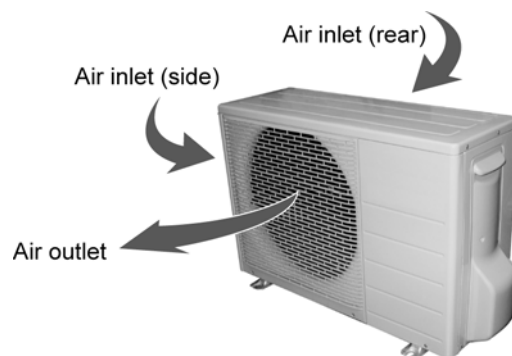




## 4.3. Remote Control

### 4.3.1. CS-E7LK CS-E9LK CS-E12LK CS-E15LK CS-XE7LK CS-XE9LK CS-XE12LK CS-XE15LK

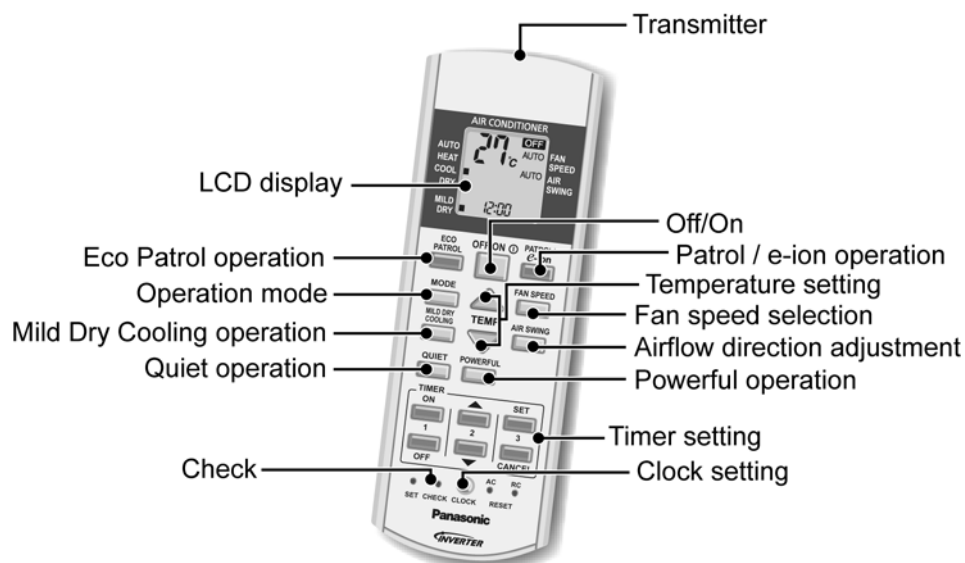


### 4.3.2. CS-E18LK CS-E21LK CS-XE18LK CS-XE21LK

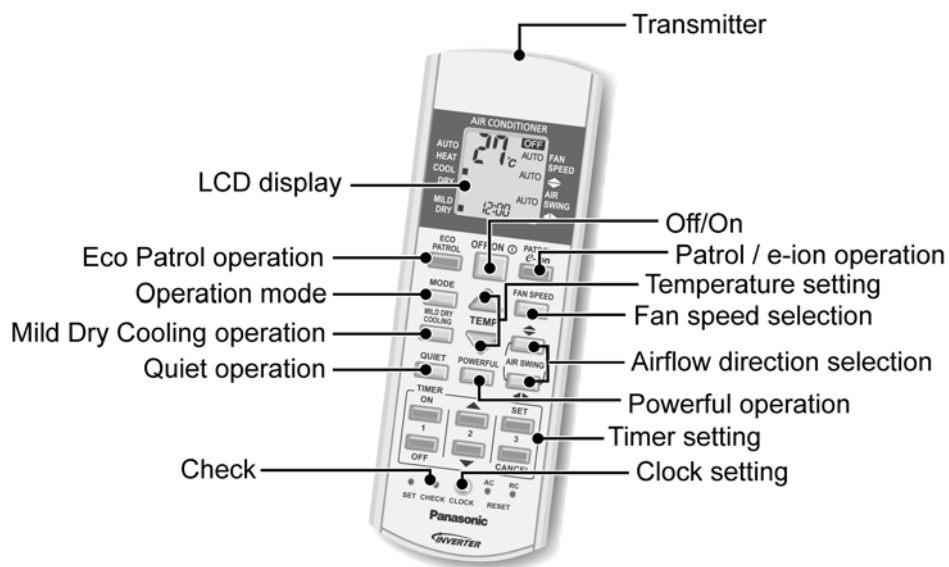


## 5 Dimensions

### 5.1. Indoor Unit

#### 5.1.1. CS-E7LK CS-E9LK CS-E12LK CS-E15LK CS-XE7LK CS-XE9LK CS-XE12LK CS-XE15LK

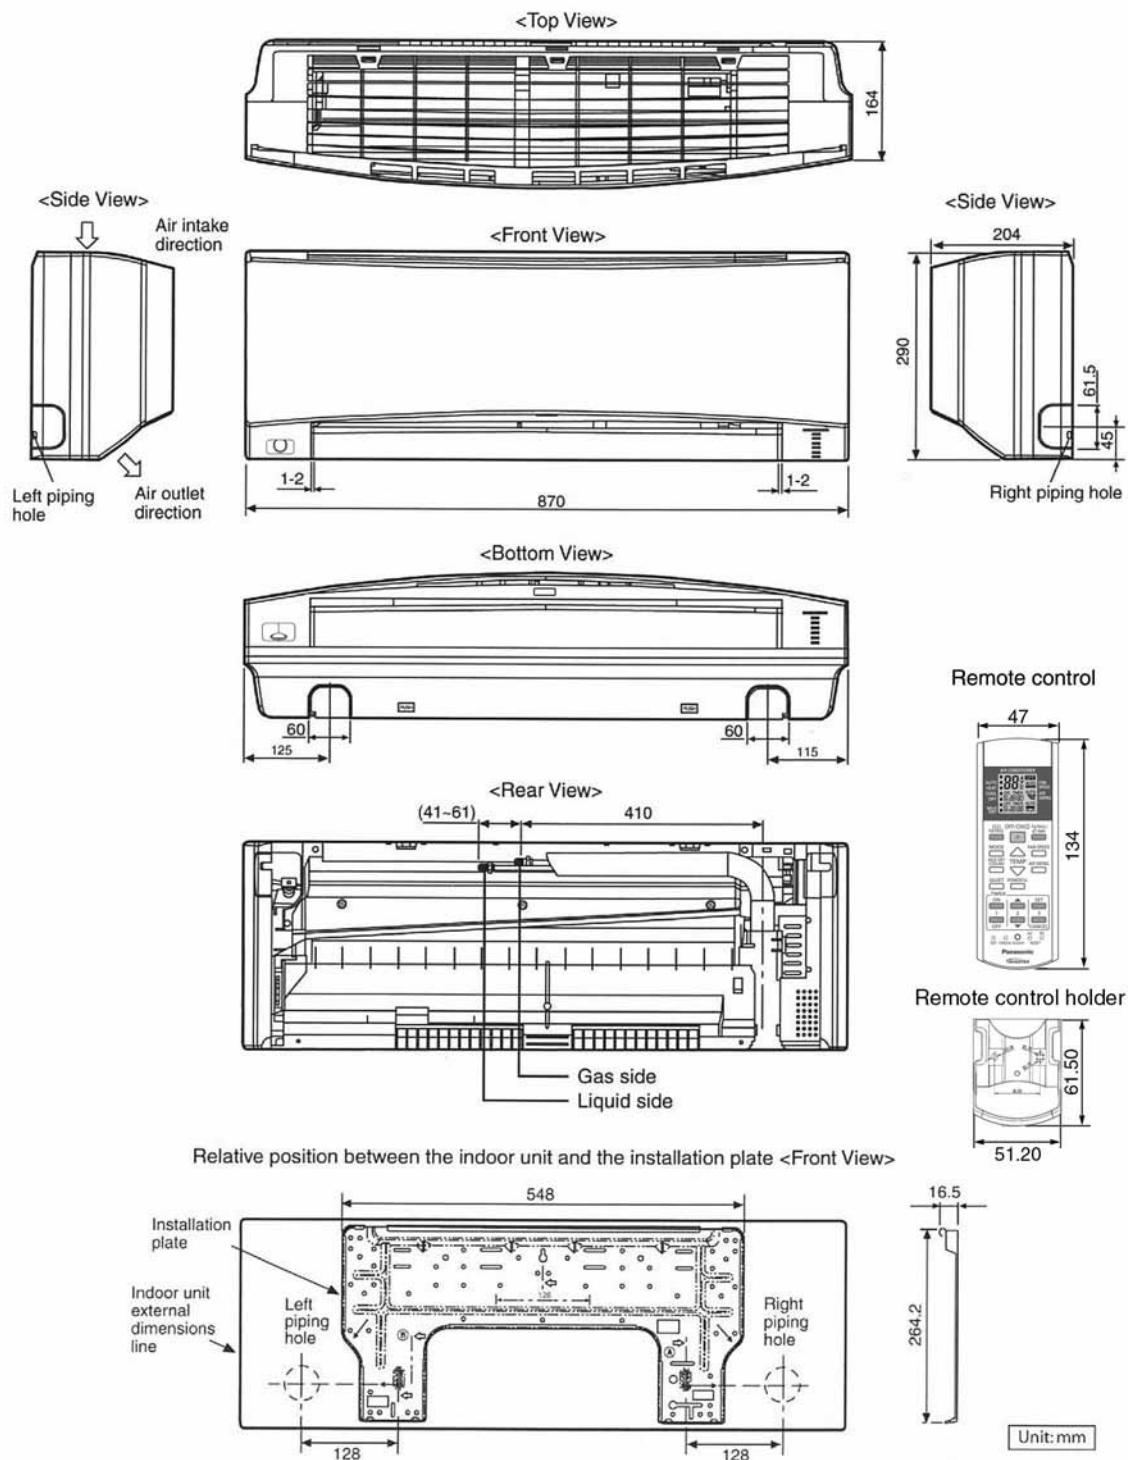


## 5.1.2. CS-E18LK CS-E21LK CS-XE18LK CS-XE21LK

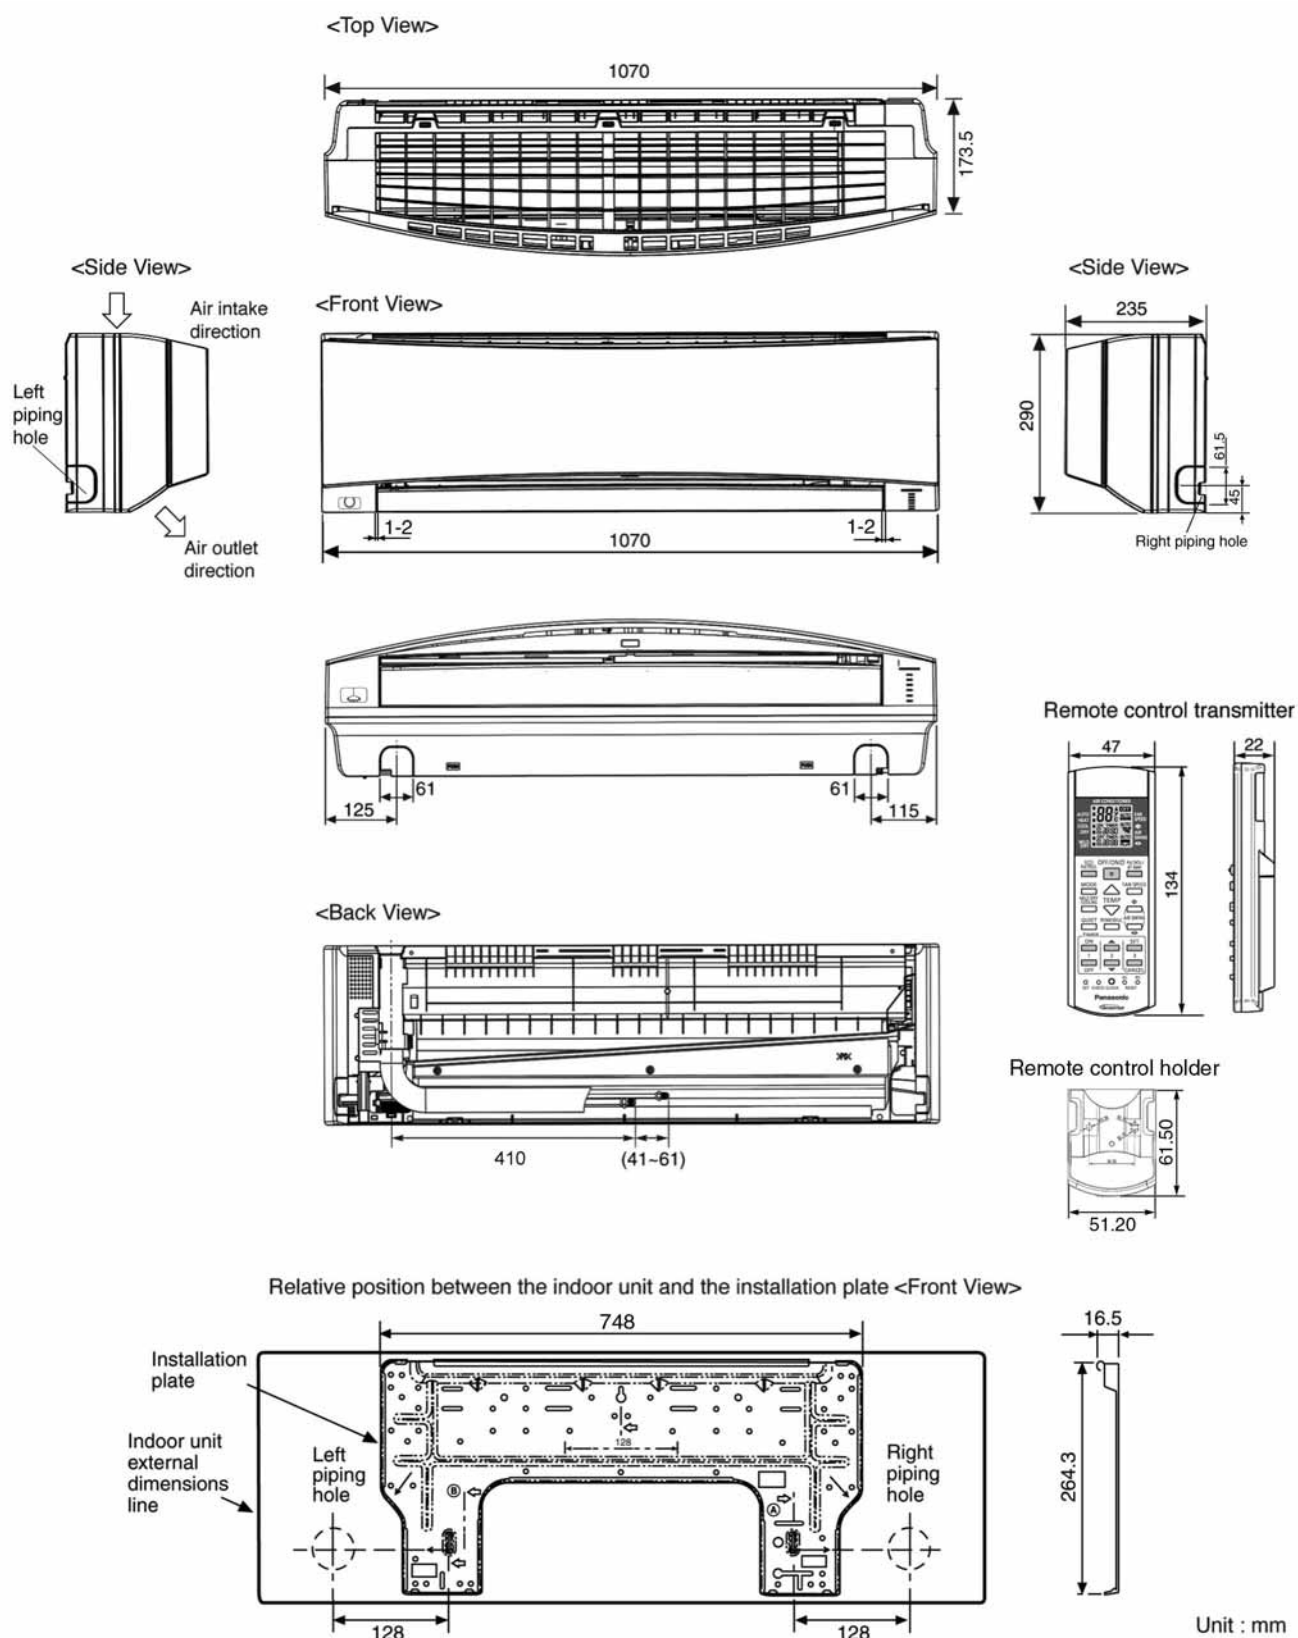


## 5.2. Outdoor Unit

### 5.2.1. CU-E7LKE CU-E9LKE CU-E12LKE CU-E15LKE CU-E7LKE-3 CU-E9LKE-3 CU-E12LKE-3

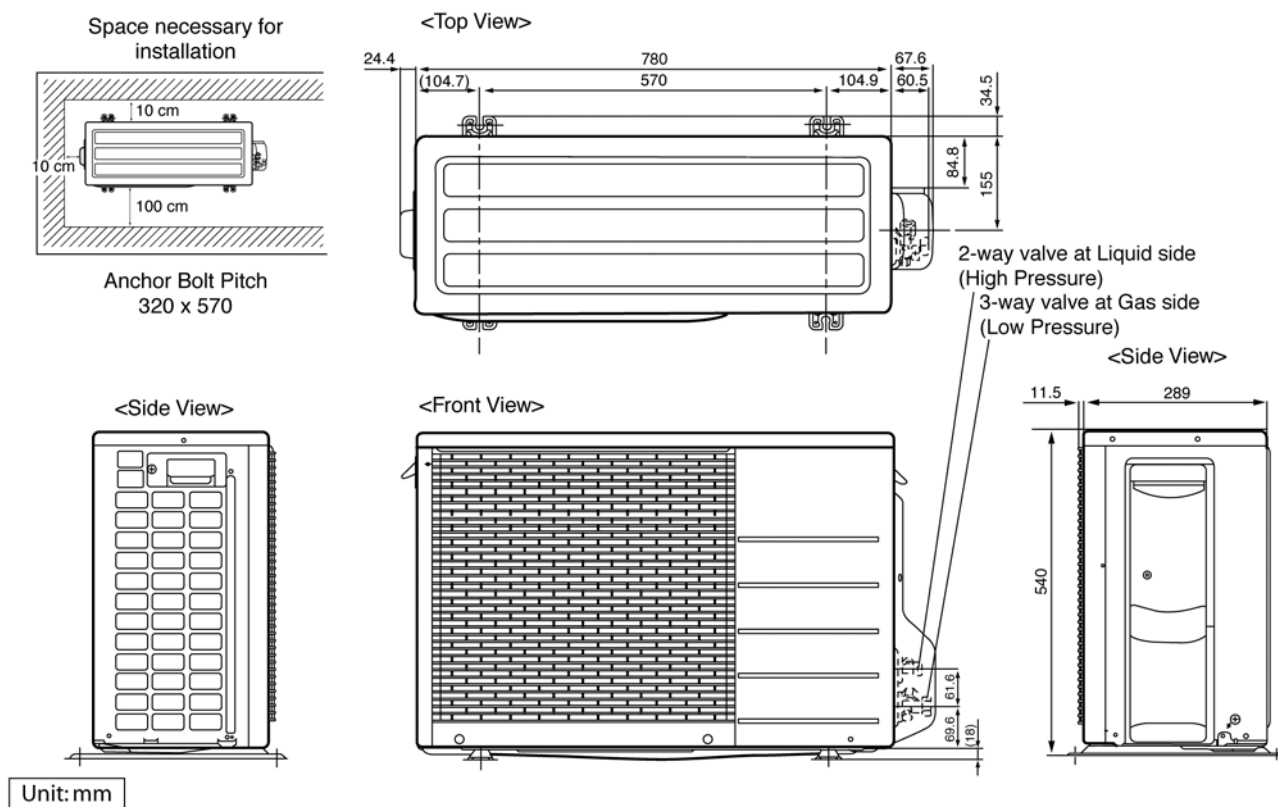


### 5.2.2. CU-E18LKE CU-E21LKE

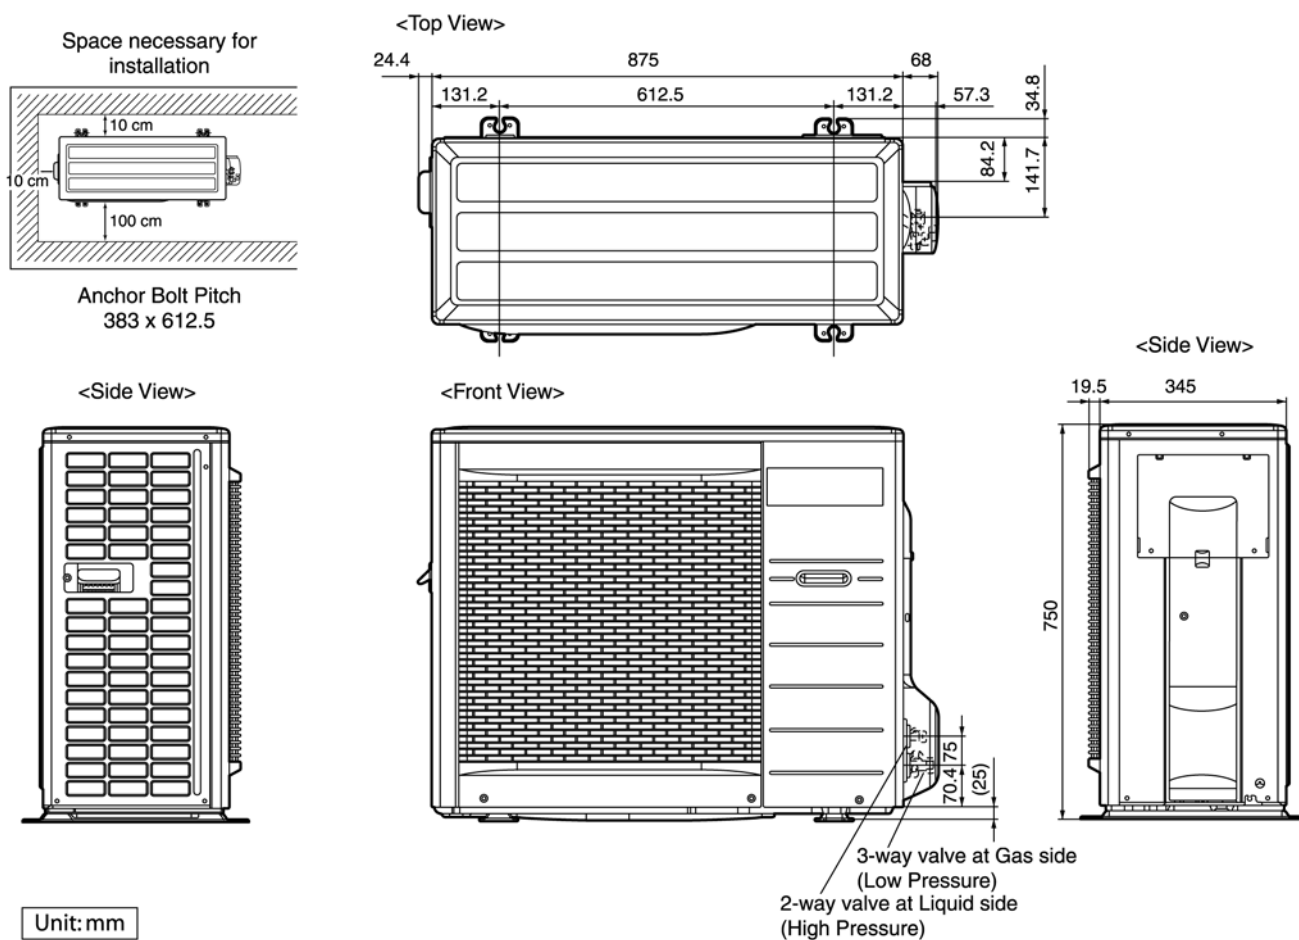


## 6 Refrigeration Cycle Diagram


### 6.1. CU-E7LKE CU-E9LKE CU-E12LKE CU-E15LKE

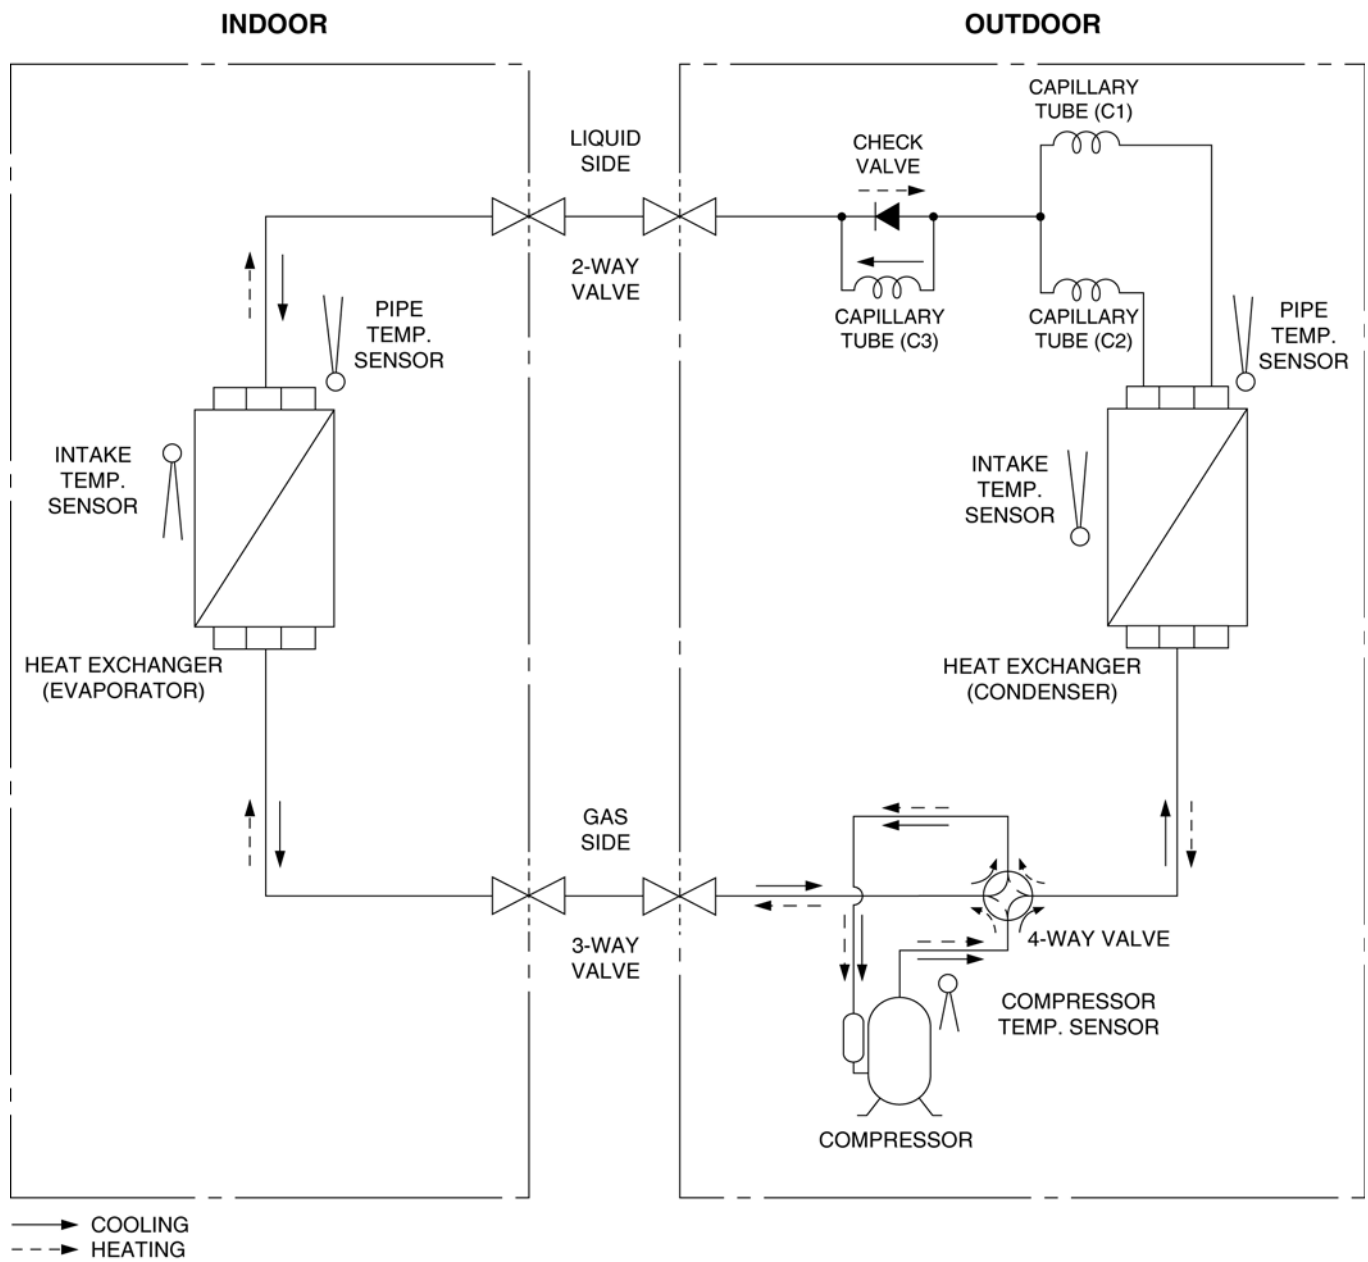

6.2. CU-E7LKE-3 CU-E9LKE-3 CU-E12LKE-3

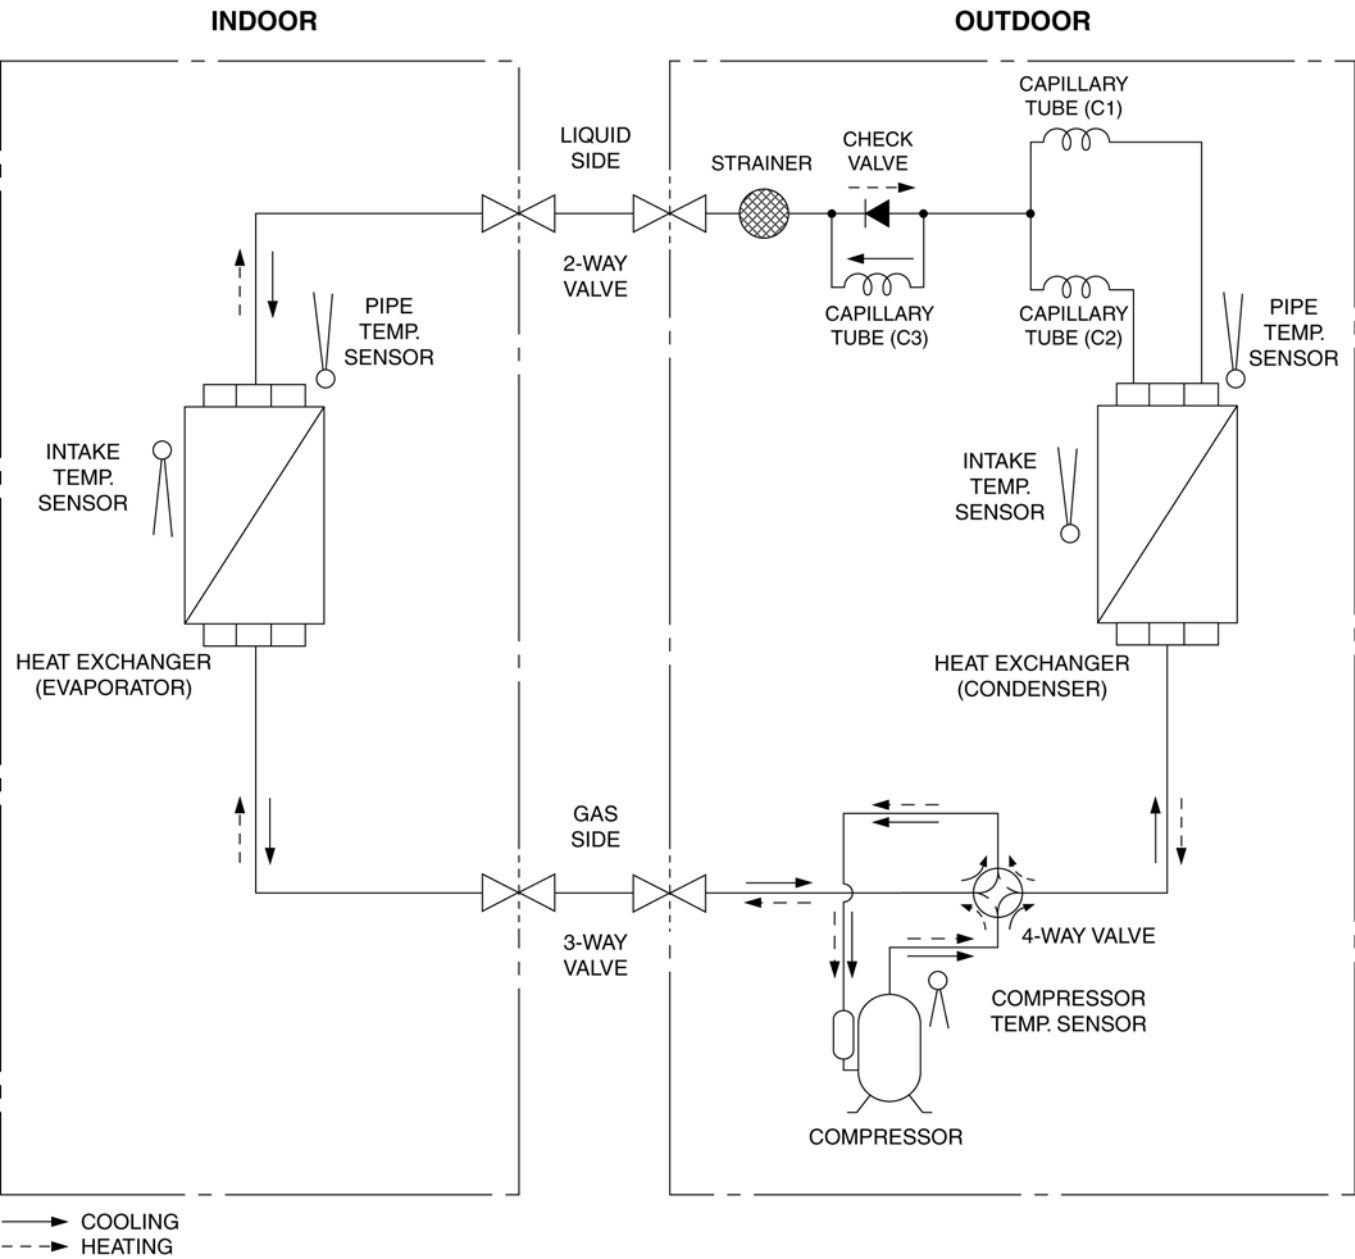


### 6.3. CU-E18LKE CU-E21LKE

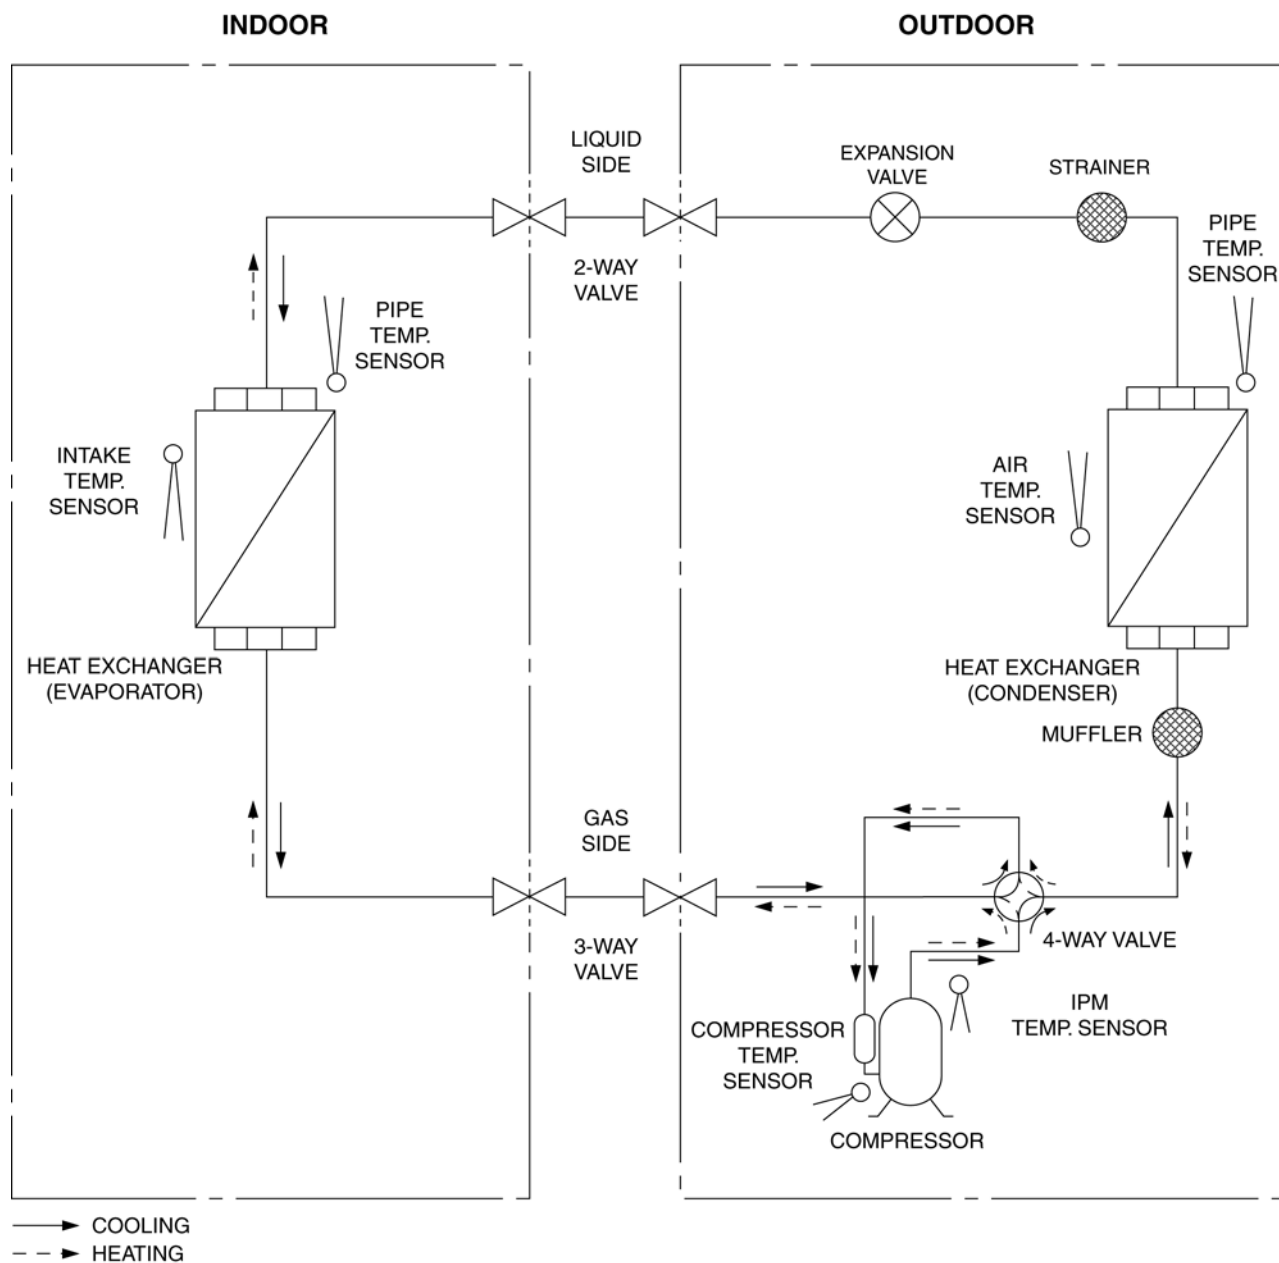


## 7 Block Diagram

### 7.1. CU-E7LKE CU-E9LKE CU-E15LKE

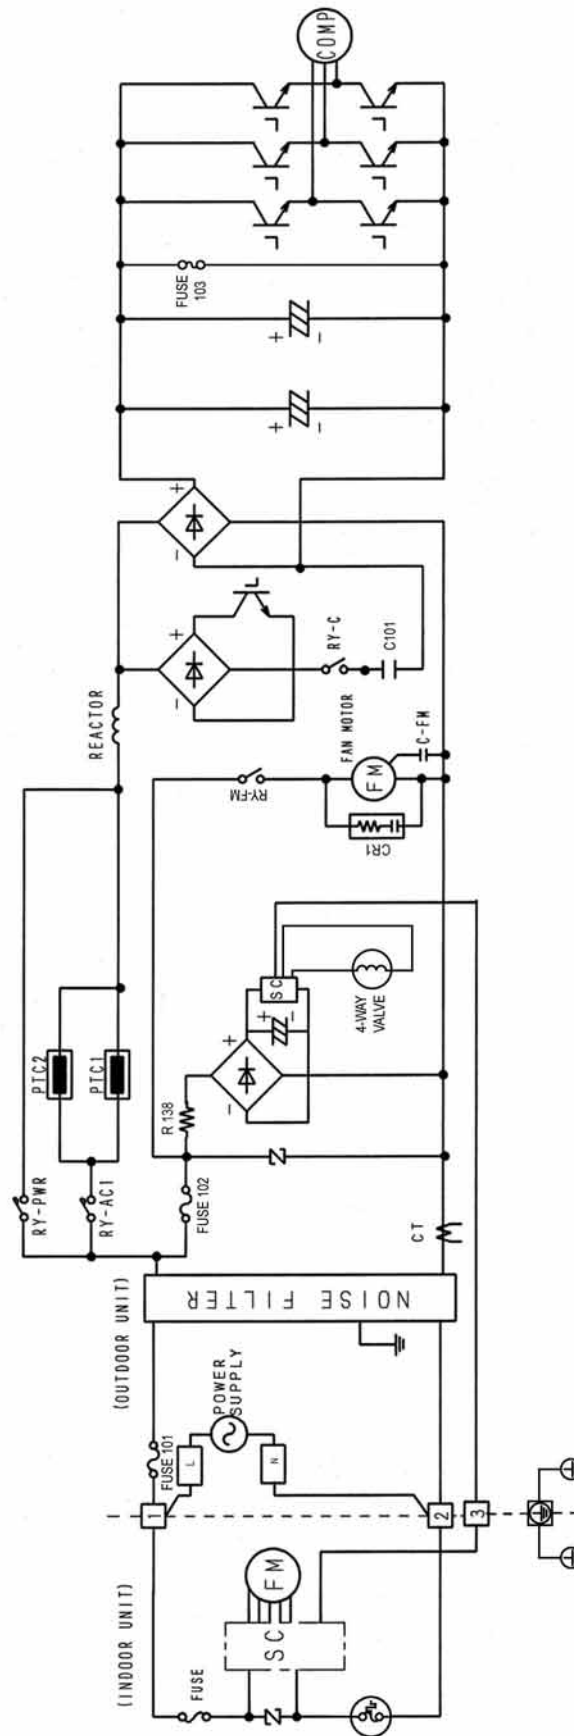





## 7.2. CU-E12LKE

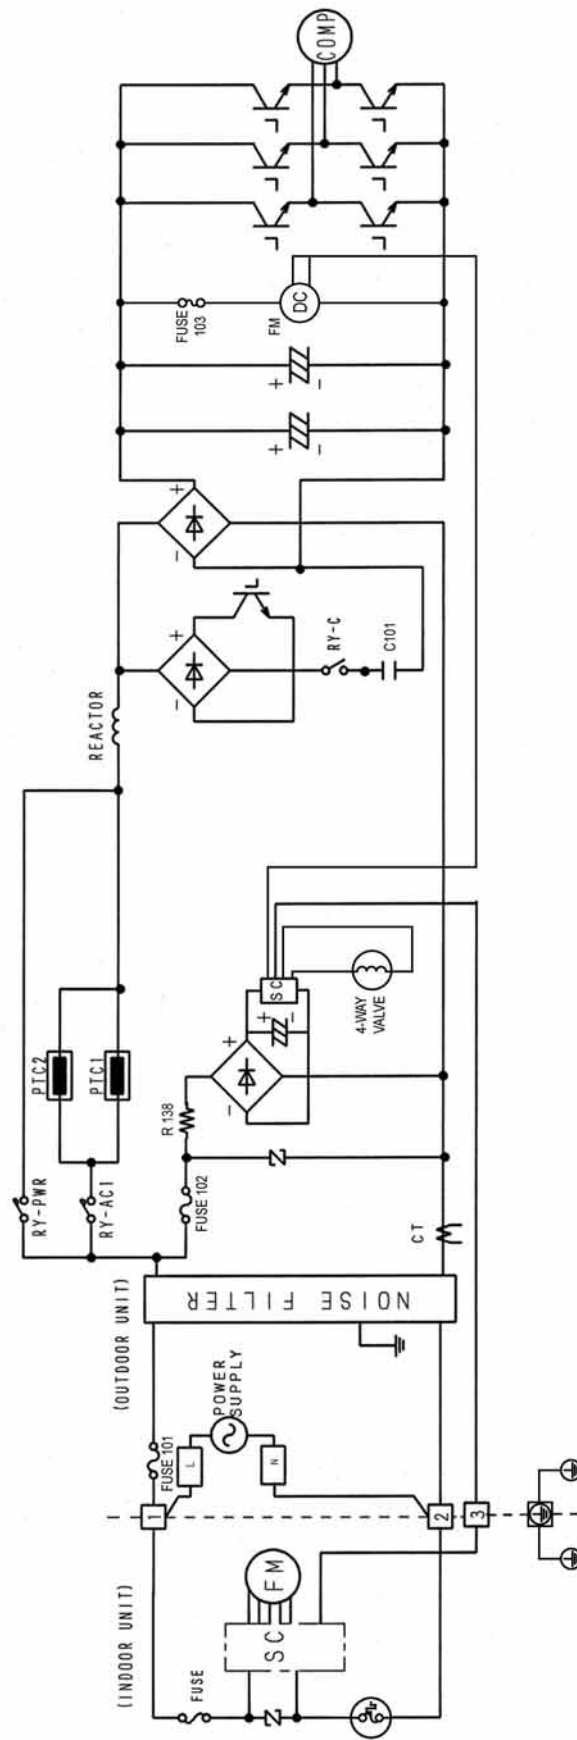

7.3. CU-E7LKE-3 CU-E9LKE-3 CU-E12LKE-3

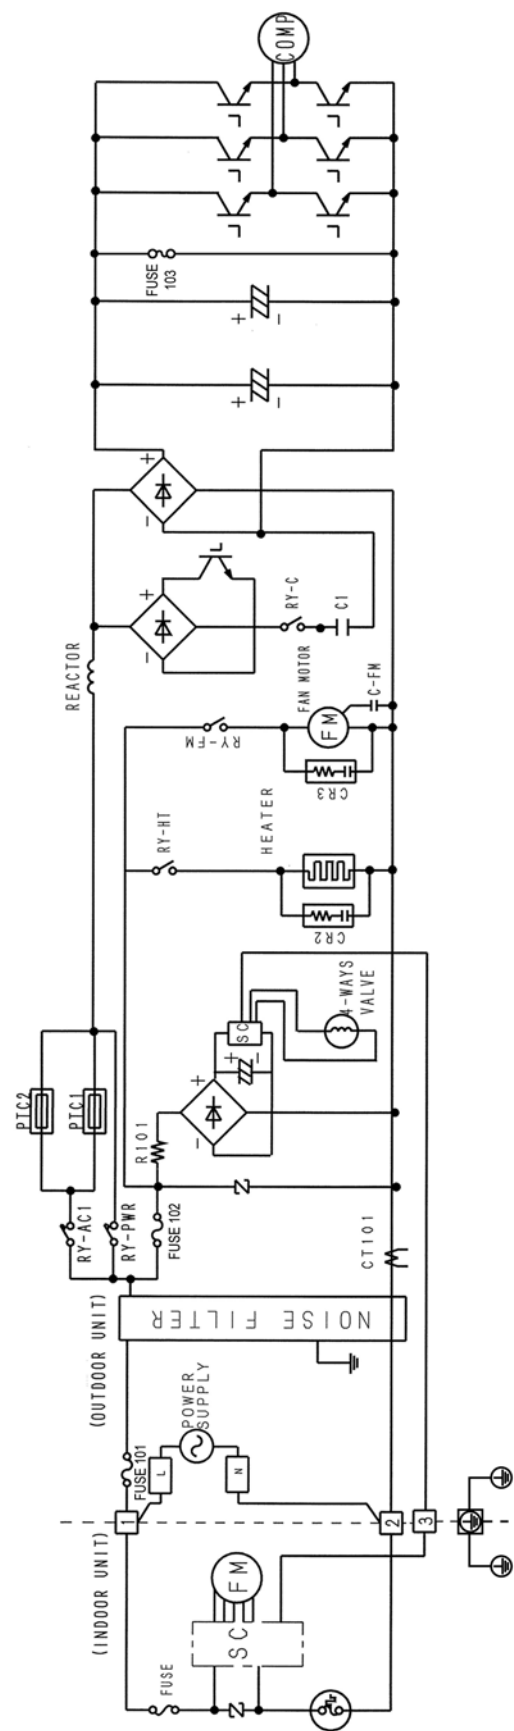


#### 7.4. CU-E18LKE CU-E21LKE

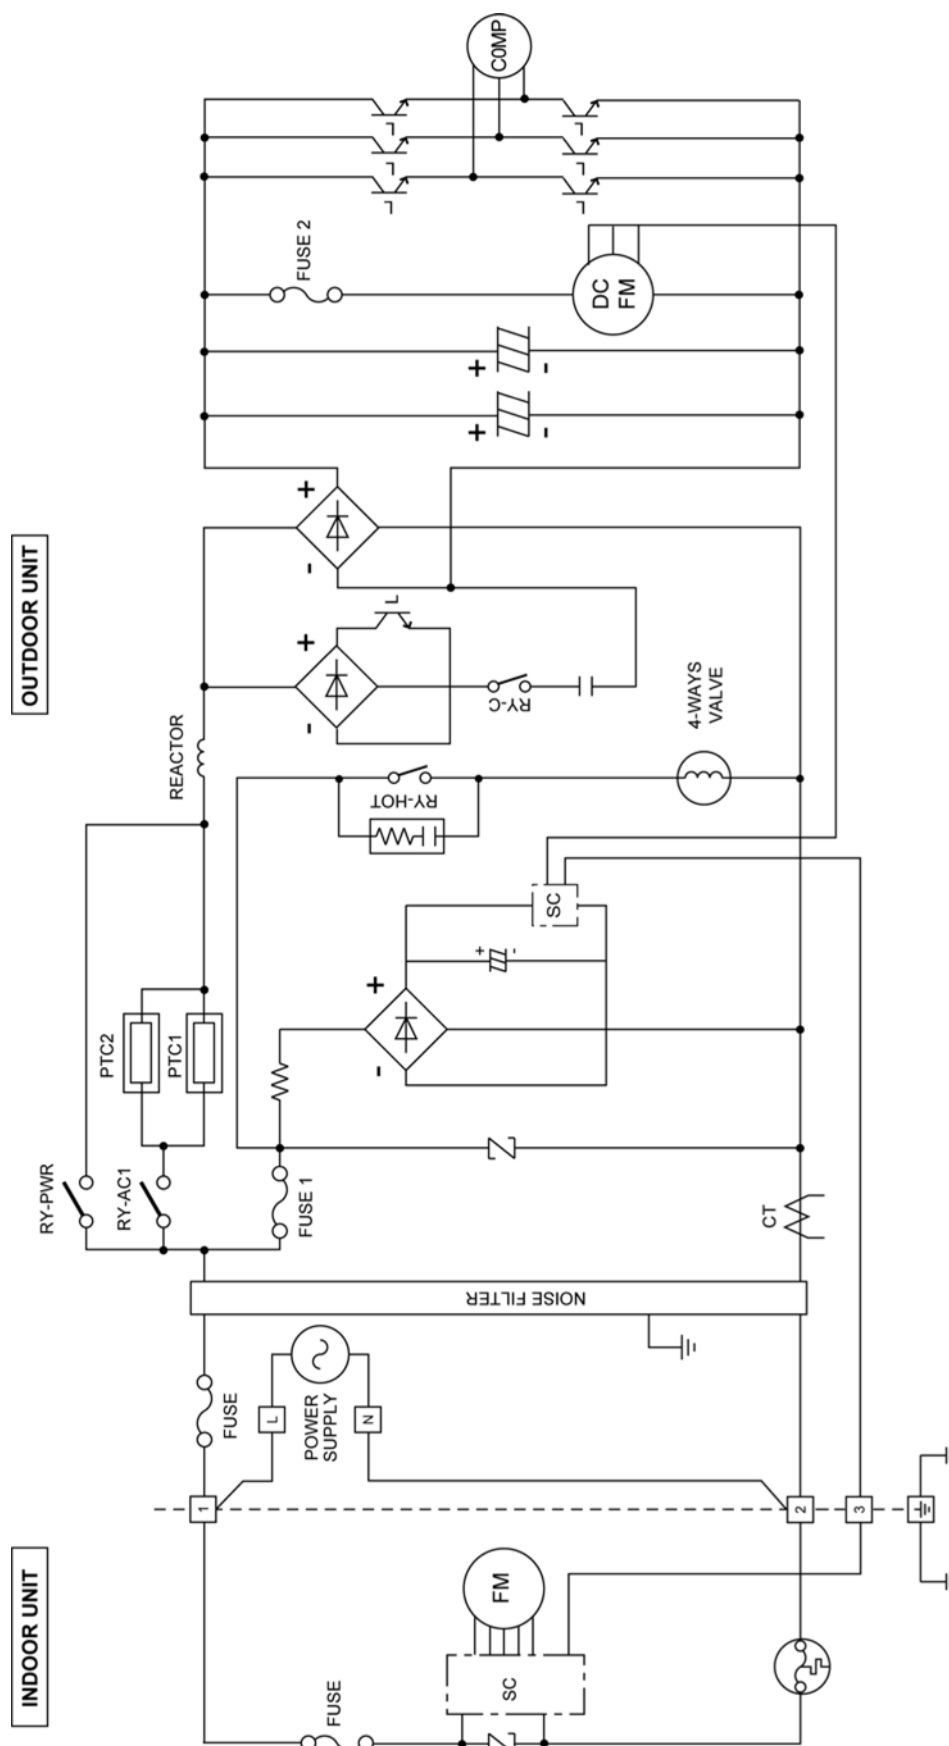


## 8 Wiring Connection Diagram

### 8.1. Indoor Unit

#### 8.1.1. CS-E7LK CS-E9LK CS-E12LK CS-E15LK CS-XE7LK CS-XE9LK CS-XE12LK CS-XE15LK

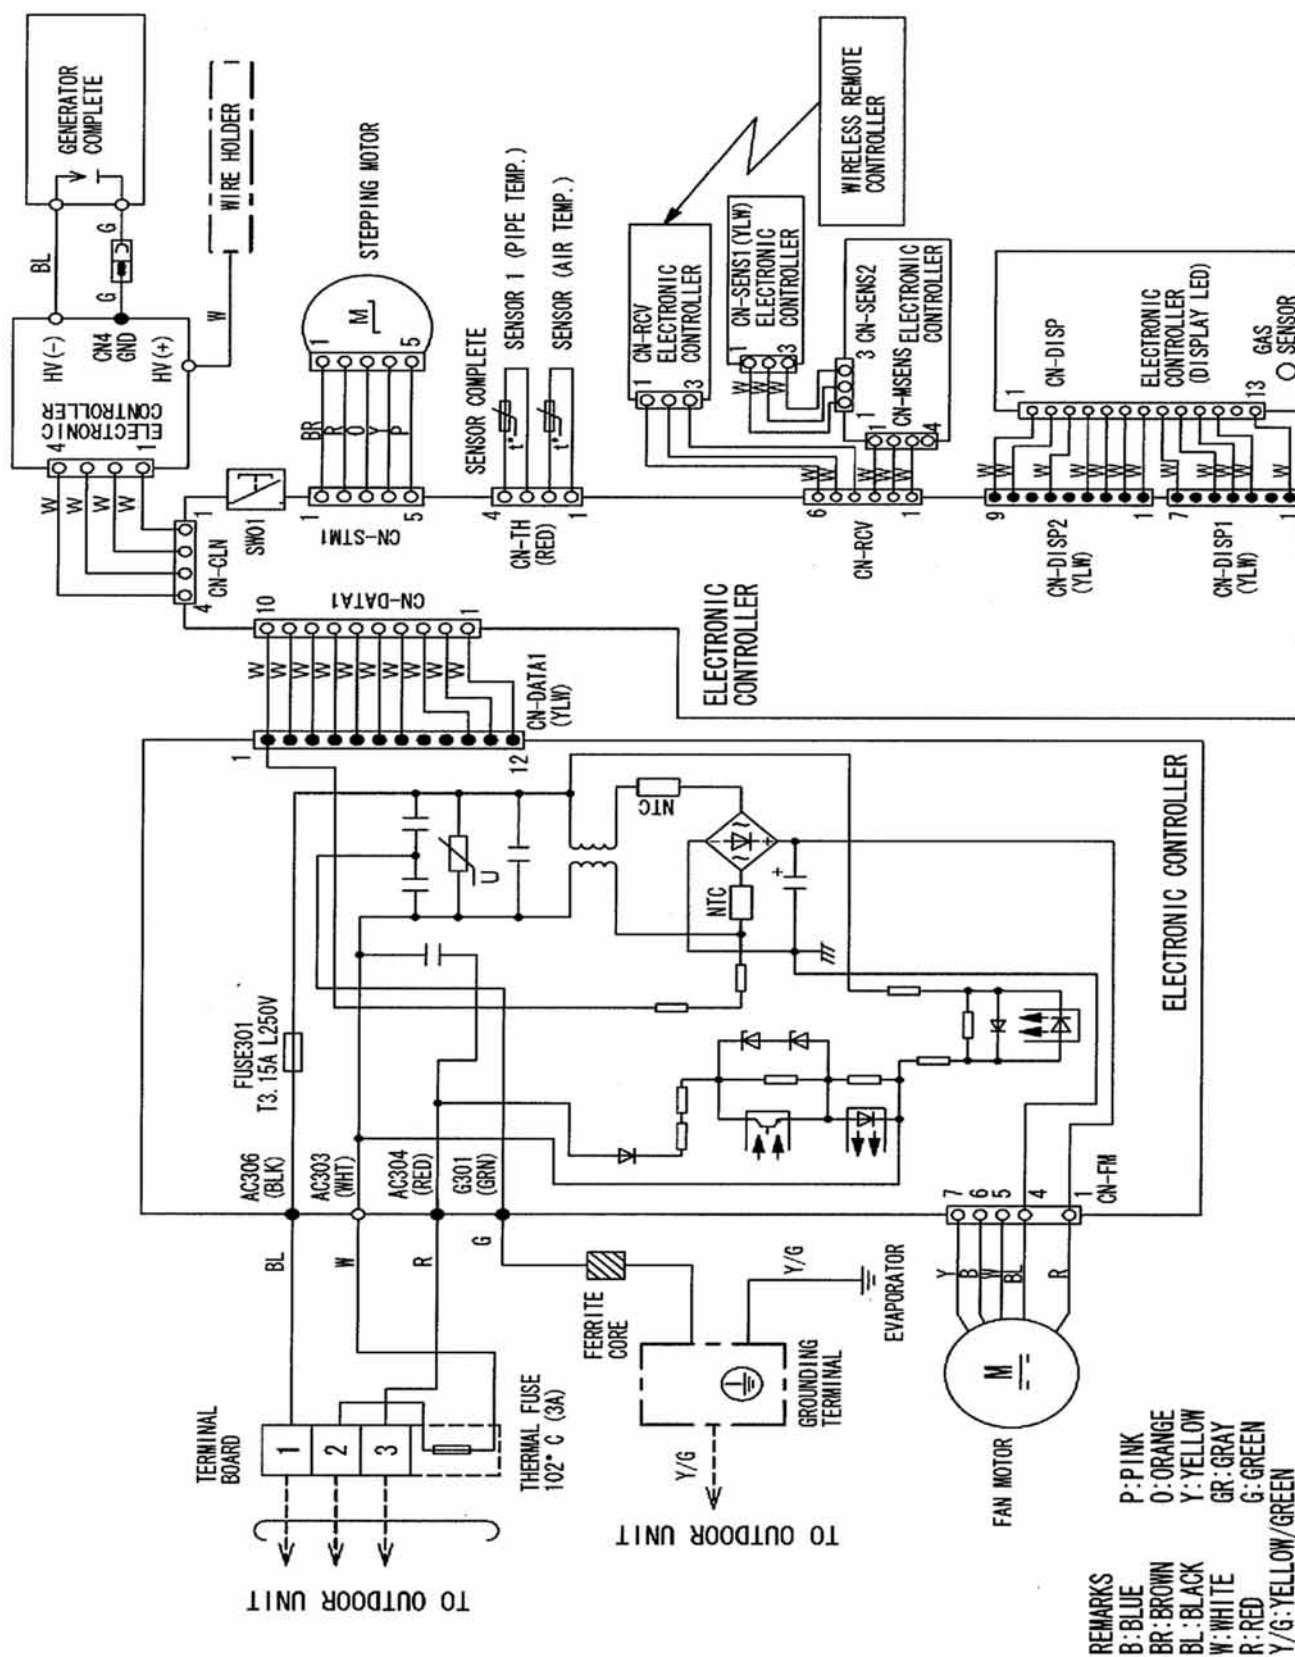


## 8.1.2. CS-E18LK CS-E21LK CS-XE18LK CS-XE21LK

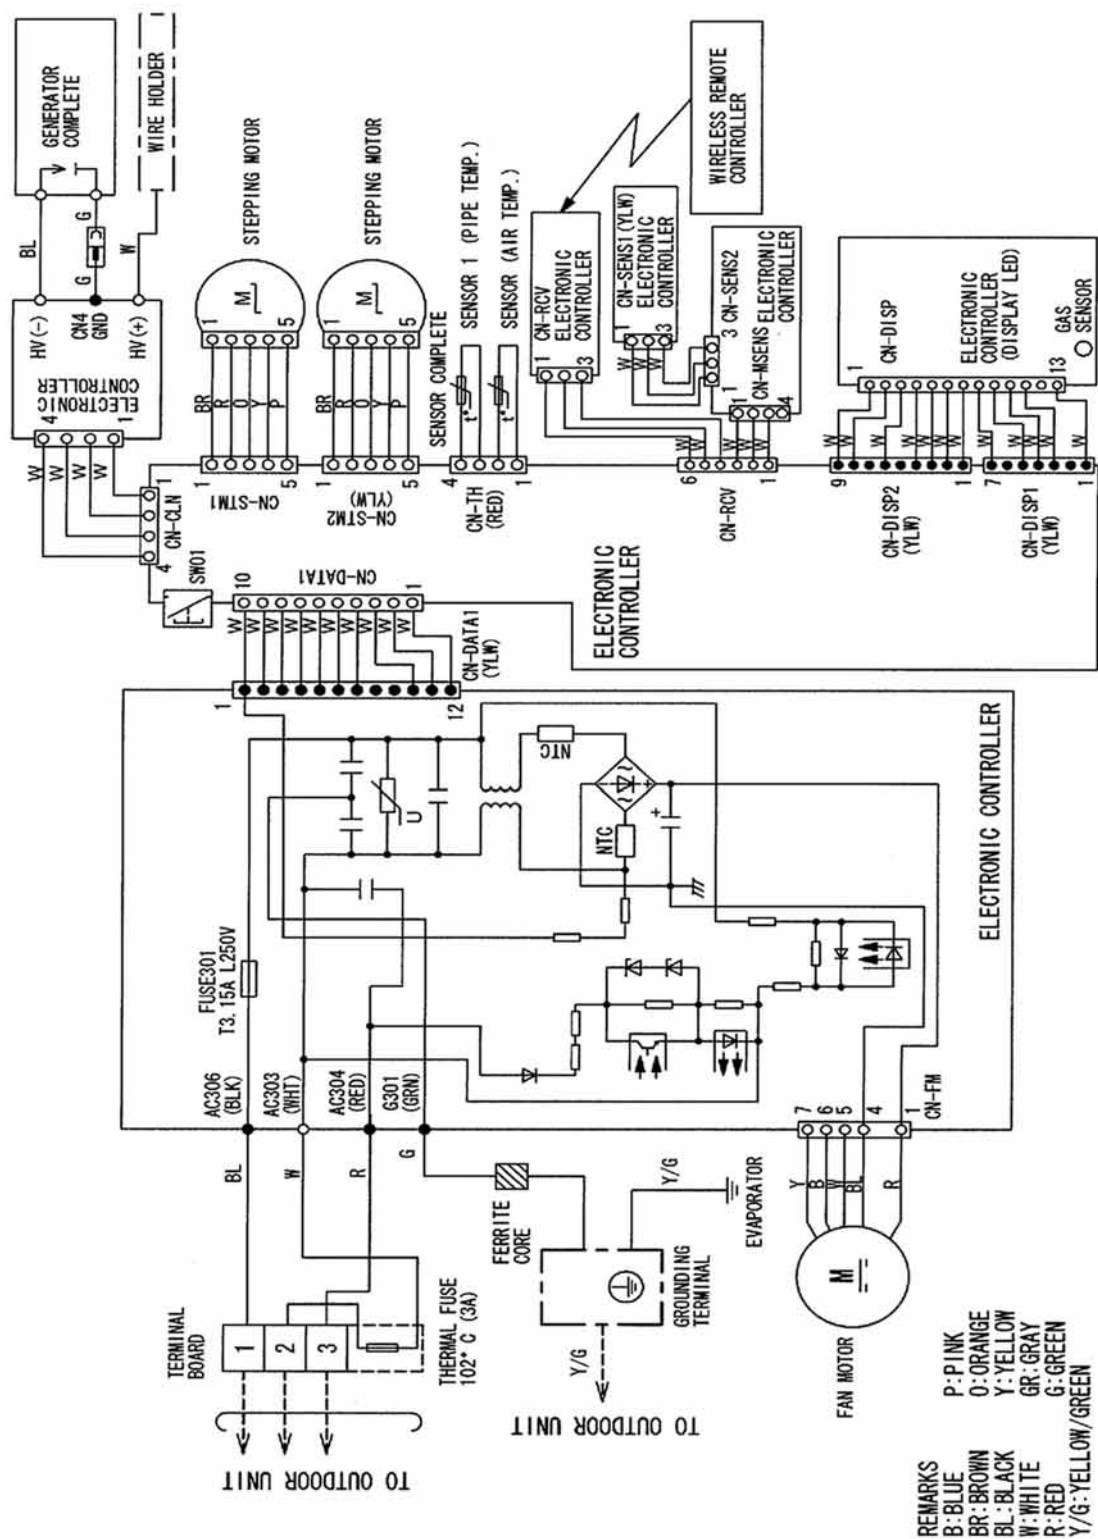


## 8.2. Outdoor Unit

### 8.2.1. CU-E7LKE CU-E9LKE CU-E15LKE

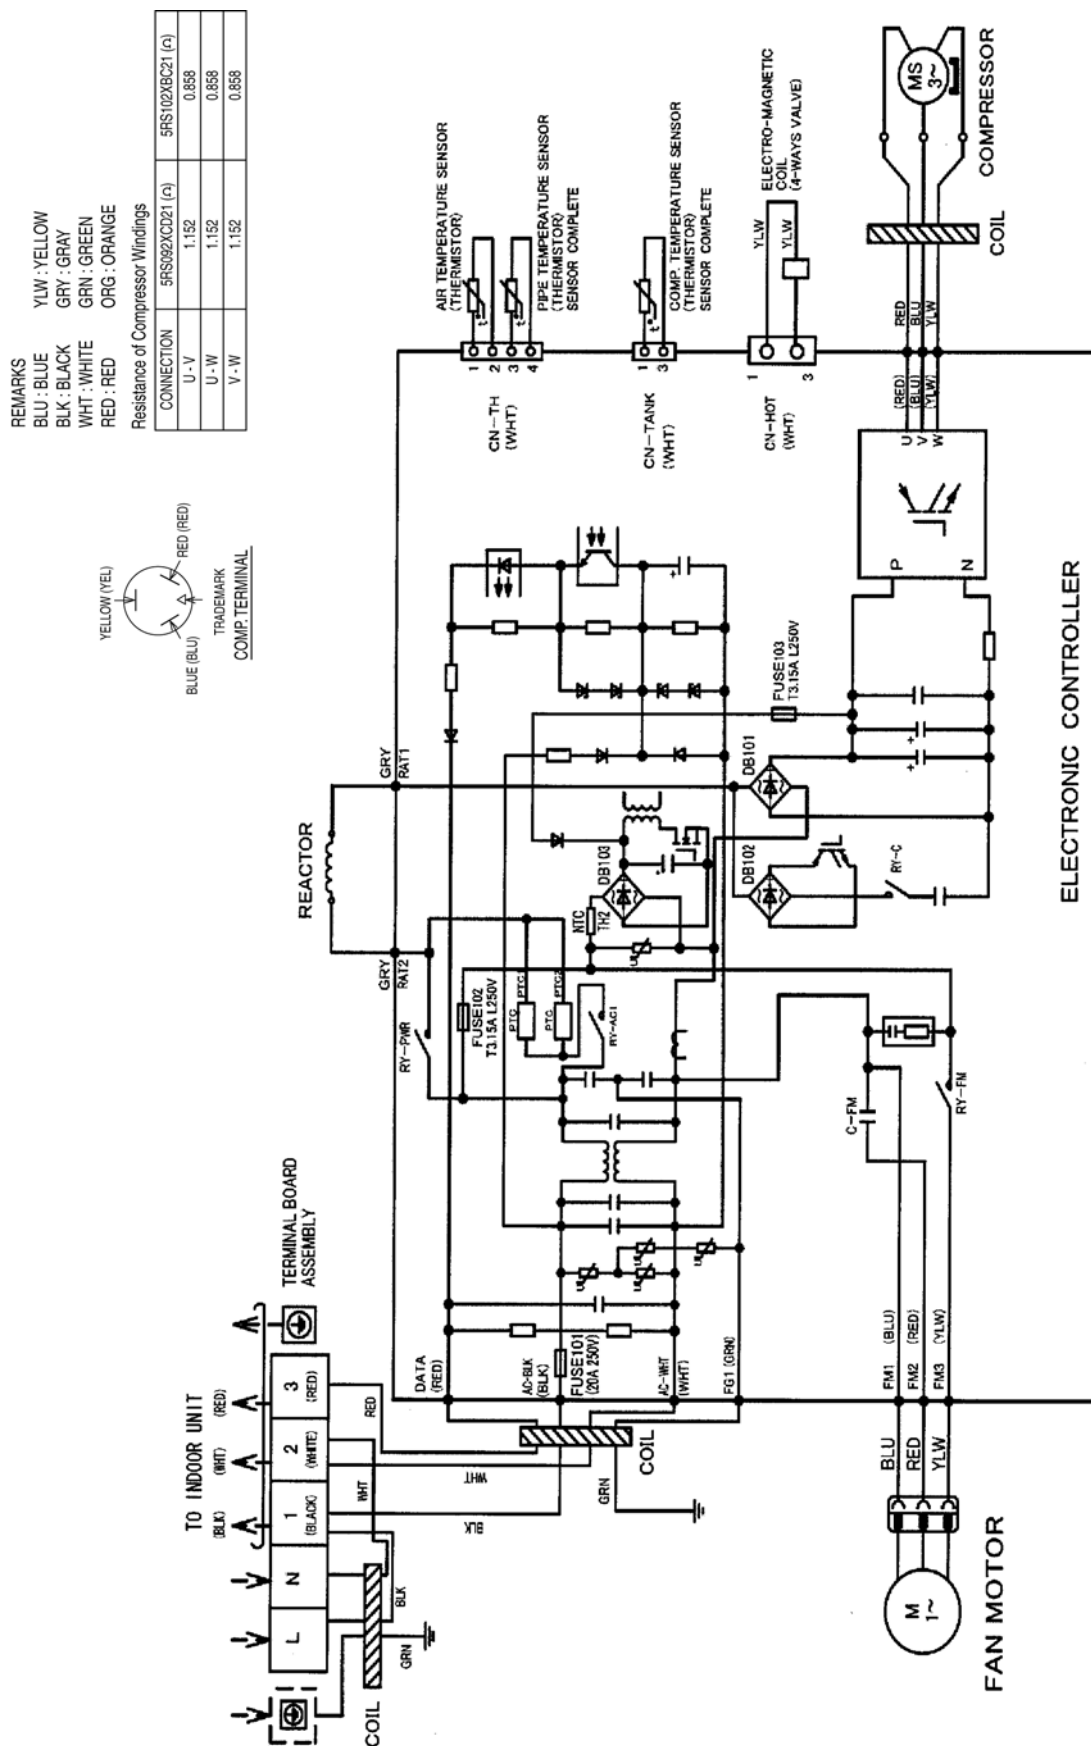

8.2.2. CU-E12LKE

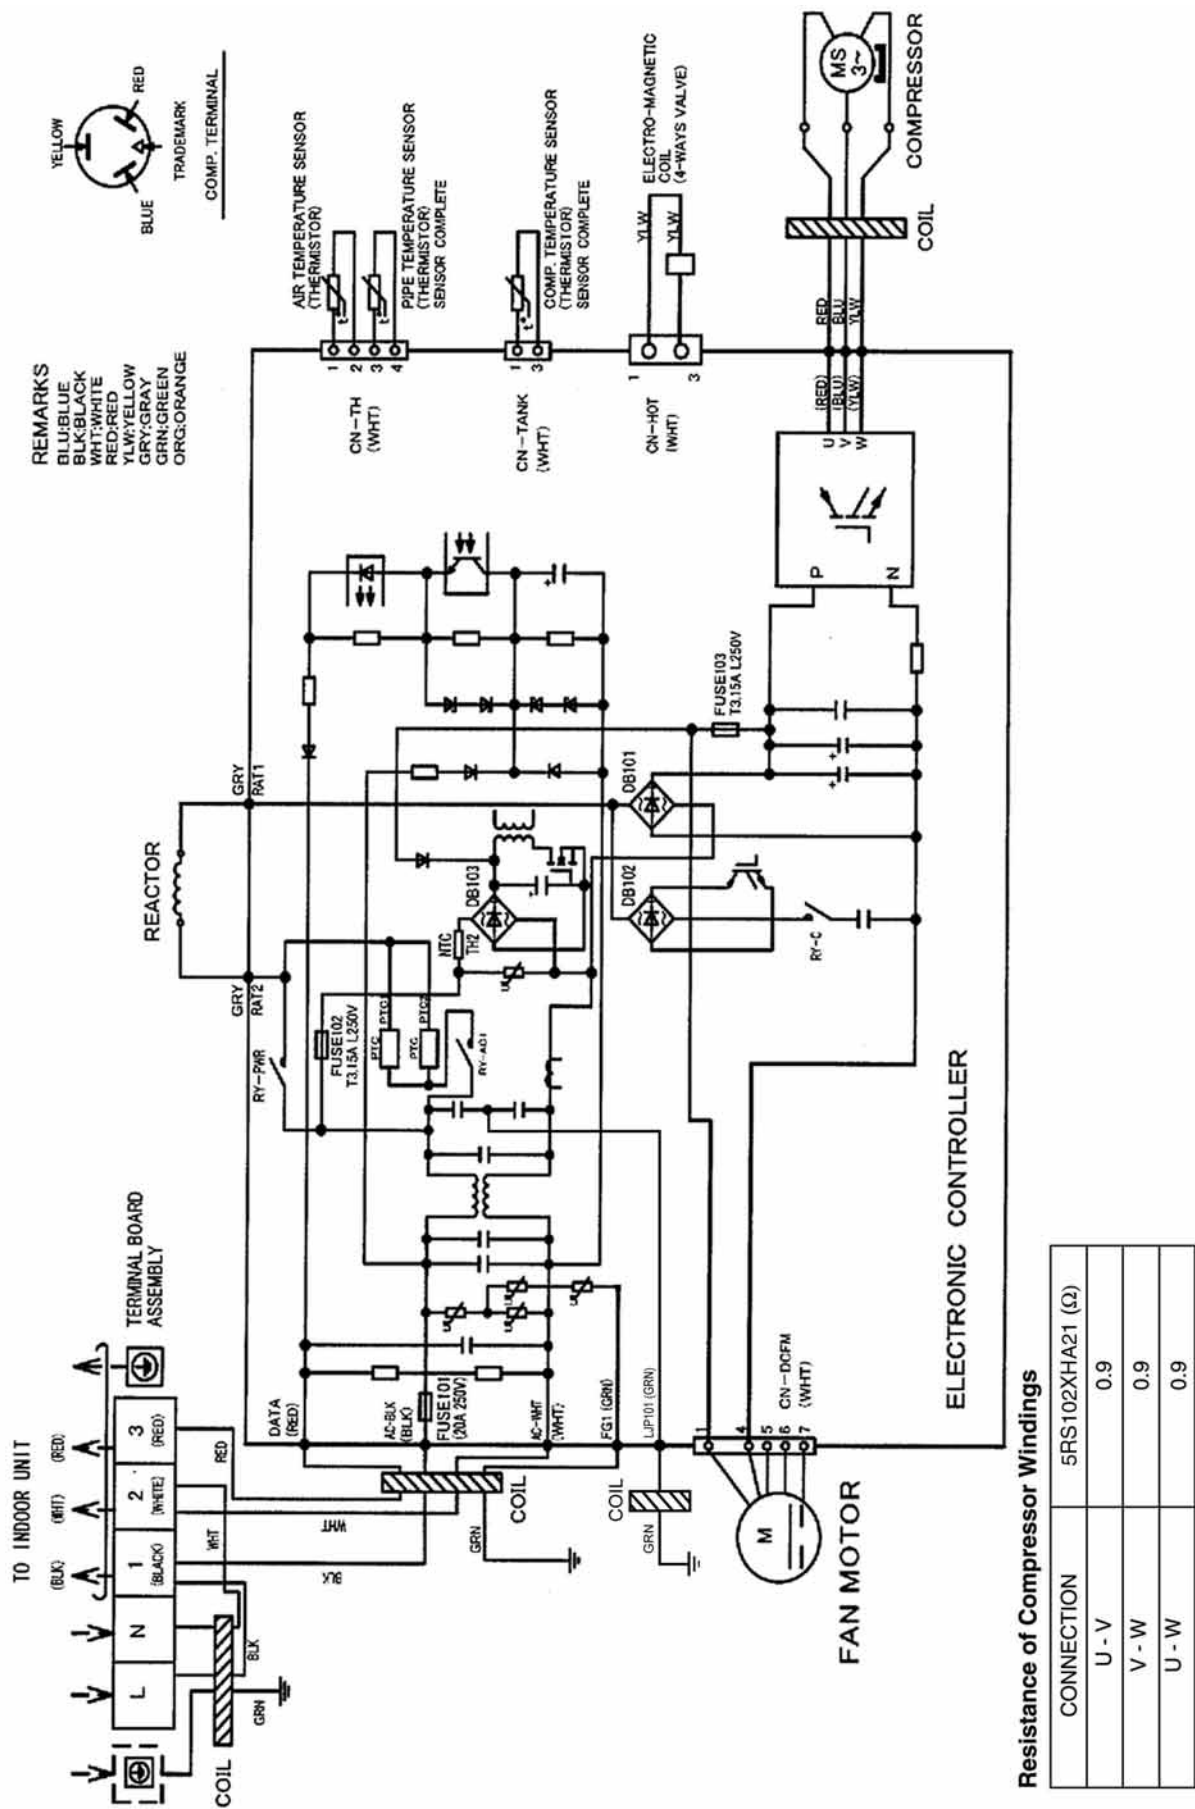

Resistance of Compressor Windings



CONNECTION	5RS102XHA21 (Ω)
U - V	0.9
V - W	0.9
U - W	0.9

### 8.2.3. CU-E7LKE-3 CU-E9LKE-3 CU-E12LKE-3

REMARKS  
 BLU : BLUE  
 BLK : BLACK  
 WHT : WHITE  
 RED : RED  
 YLW : YELLOW  
 GRN : GREEN  
 ORG : ORANGE

Resistance of Compressor Windings

CONNECTION	CU-E7LKE-3	CU-E9LKE-3	CU-E12LKE-3
U-V	5RS092XCD21 (Ω)	1.152	0.858
U-W	1.152	0.858	
V-W	1.152	0.858	

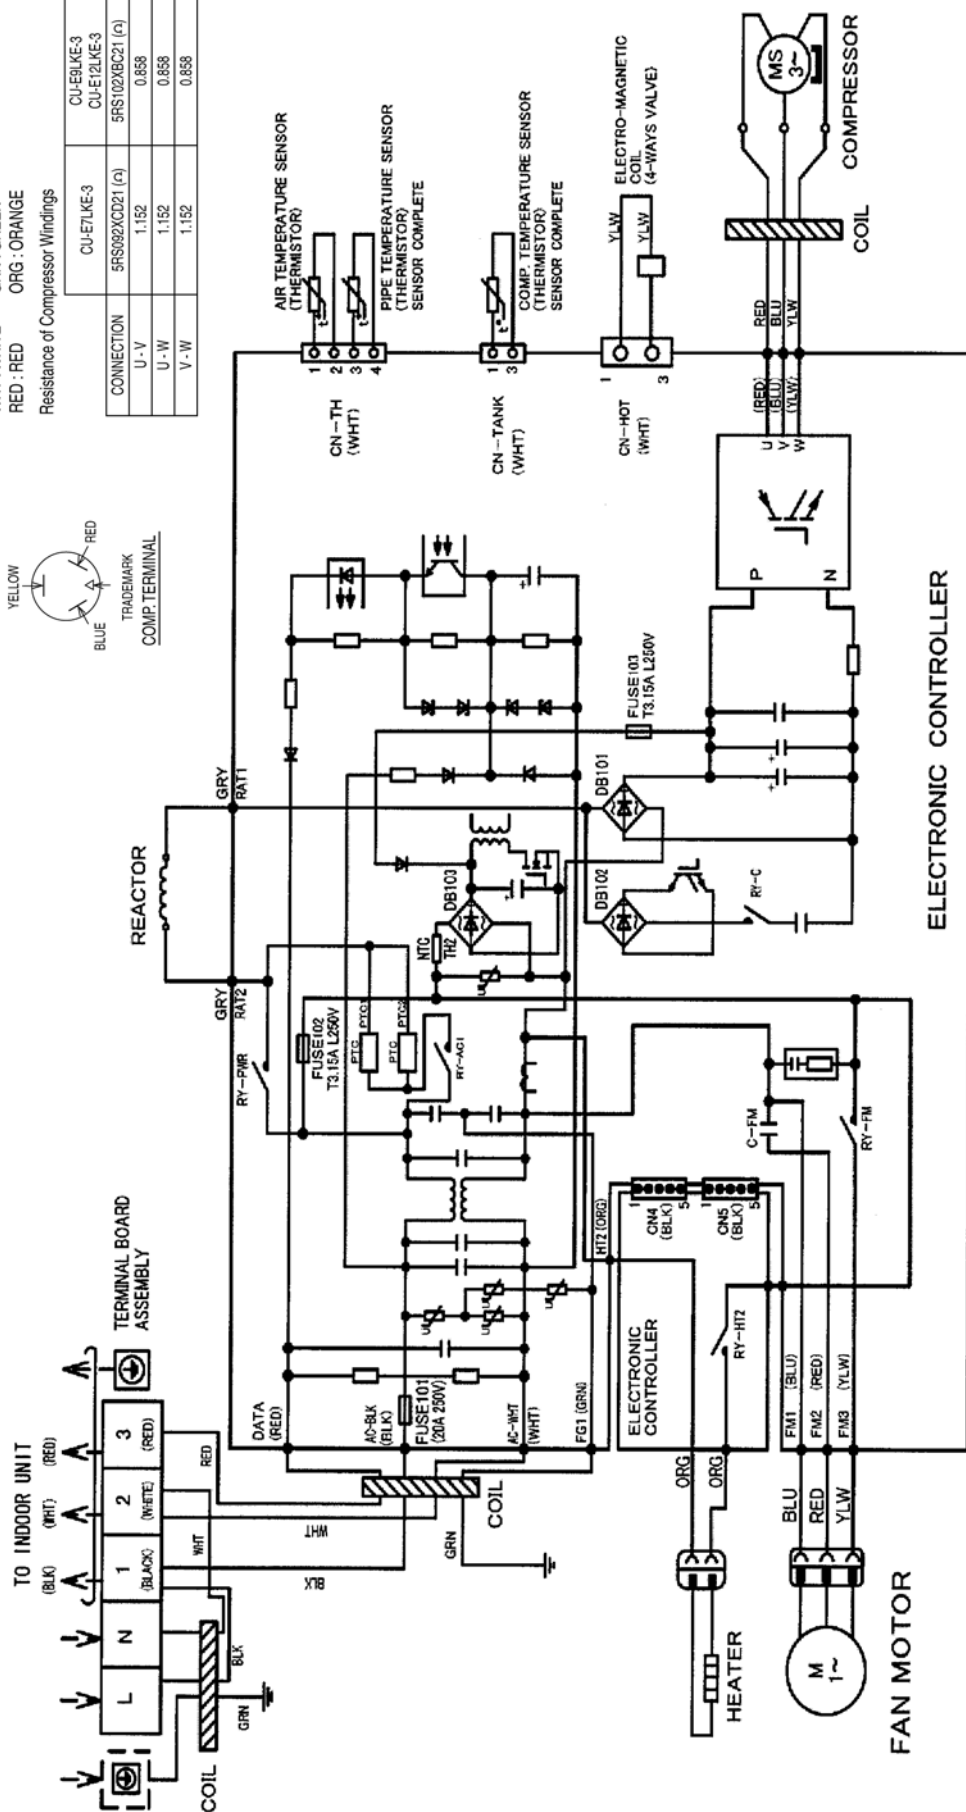





## 8.2.4. CU-E18LKE CU-E21LKE

REMARKS  
 BLU : BLUE  
 WHT : WHITE  
 RED : RED

YLU : YELLOW  
 GRY : GRAY  
 GRN : GREEN

Resistance of Compressor Windings


CONNECTION	5CS130XAD04 (Ω)
U - V	0.902
U - W	0.903
V - W	0.900

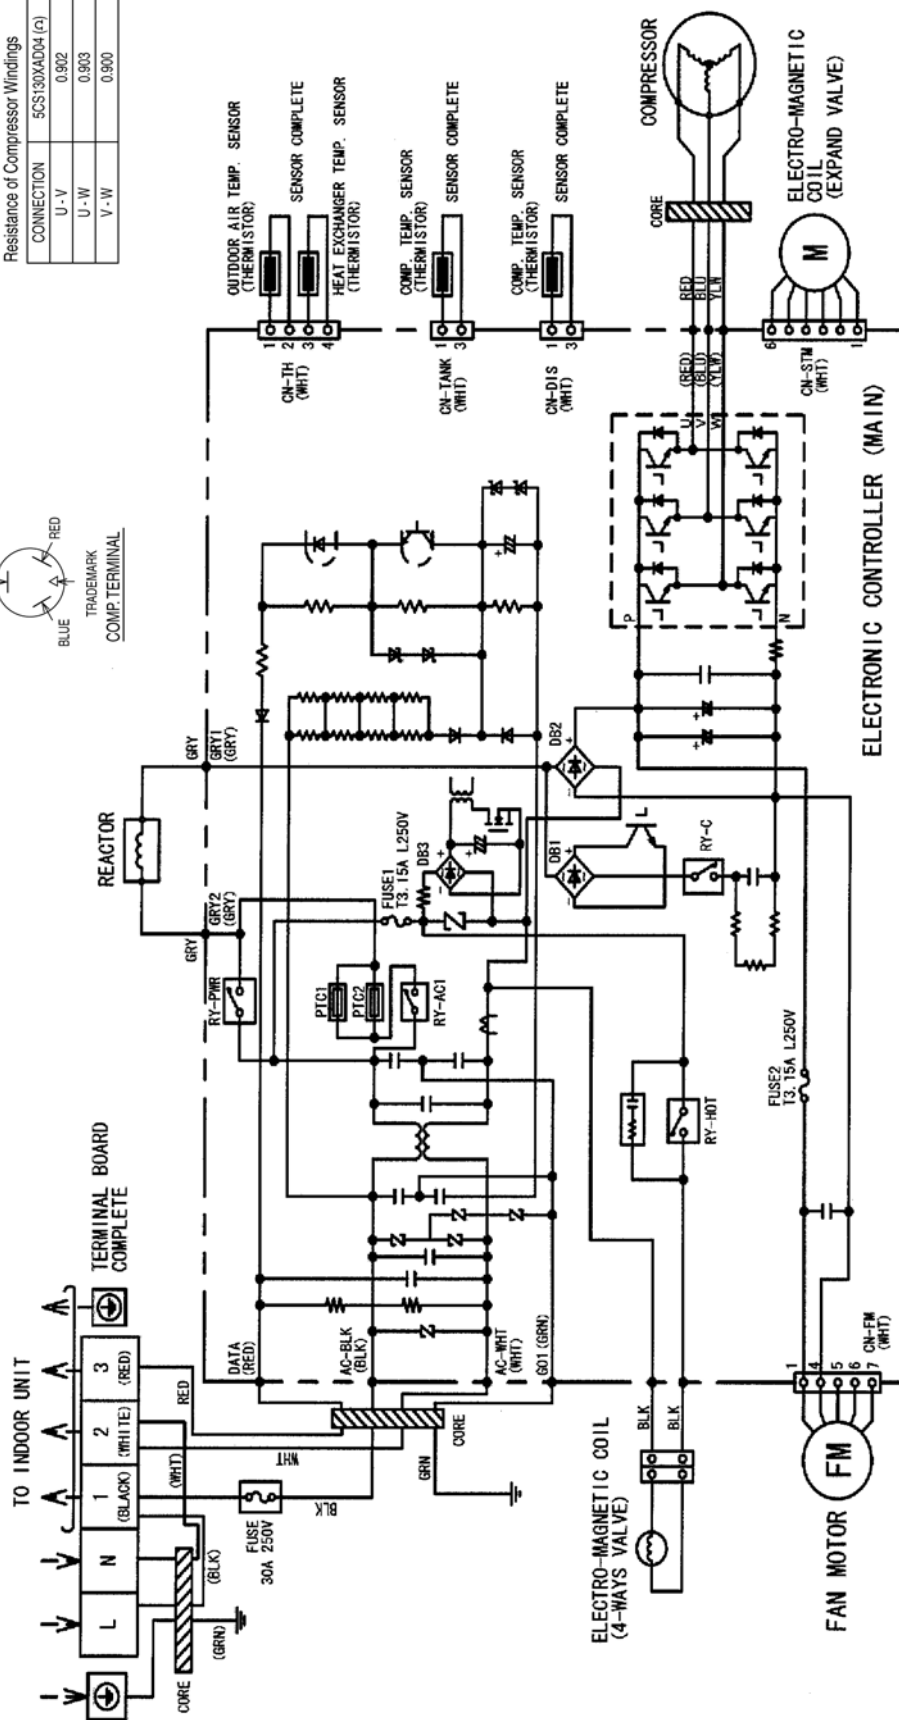


# 9 Electronic Circuit Diagram

## 9.1. Indoor Unit

### 9.1.1. CS-E7LK CS-E9LK CS-E12LK CS-E15LK CS-XE7LK CS-XE9LK CS-XE12LK CS-XE15LK



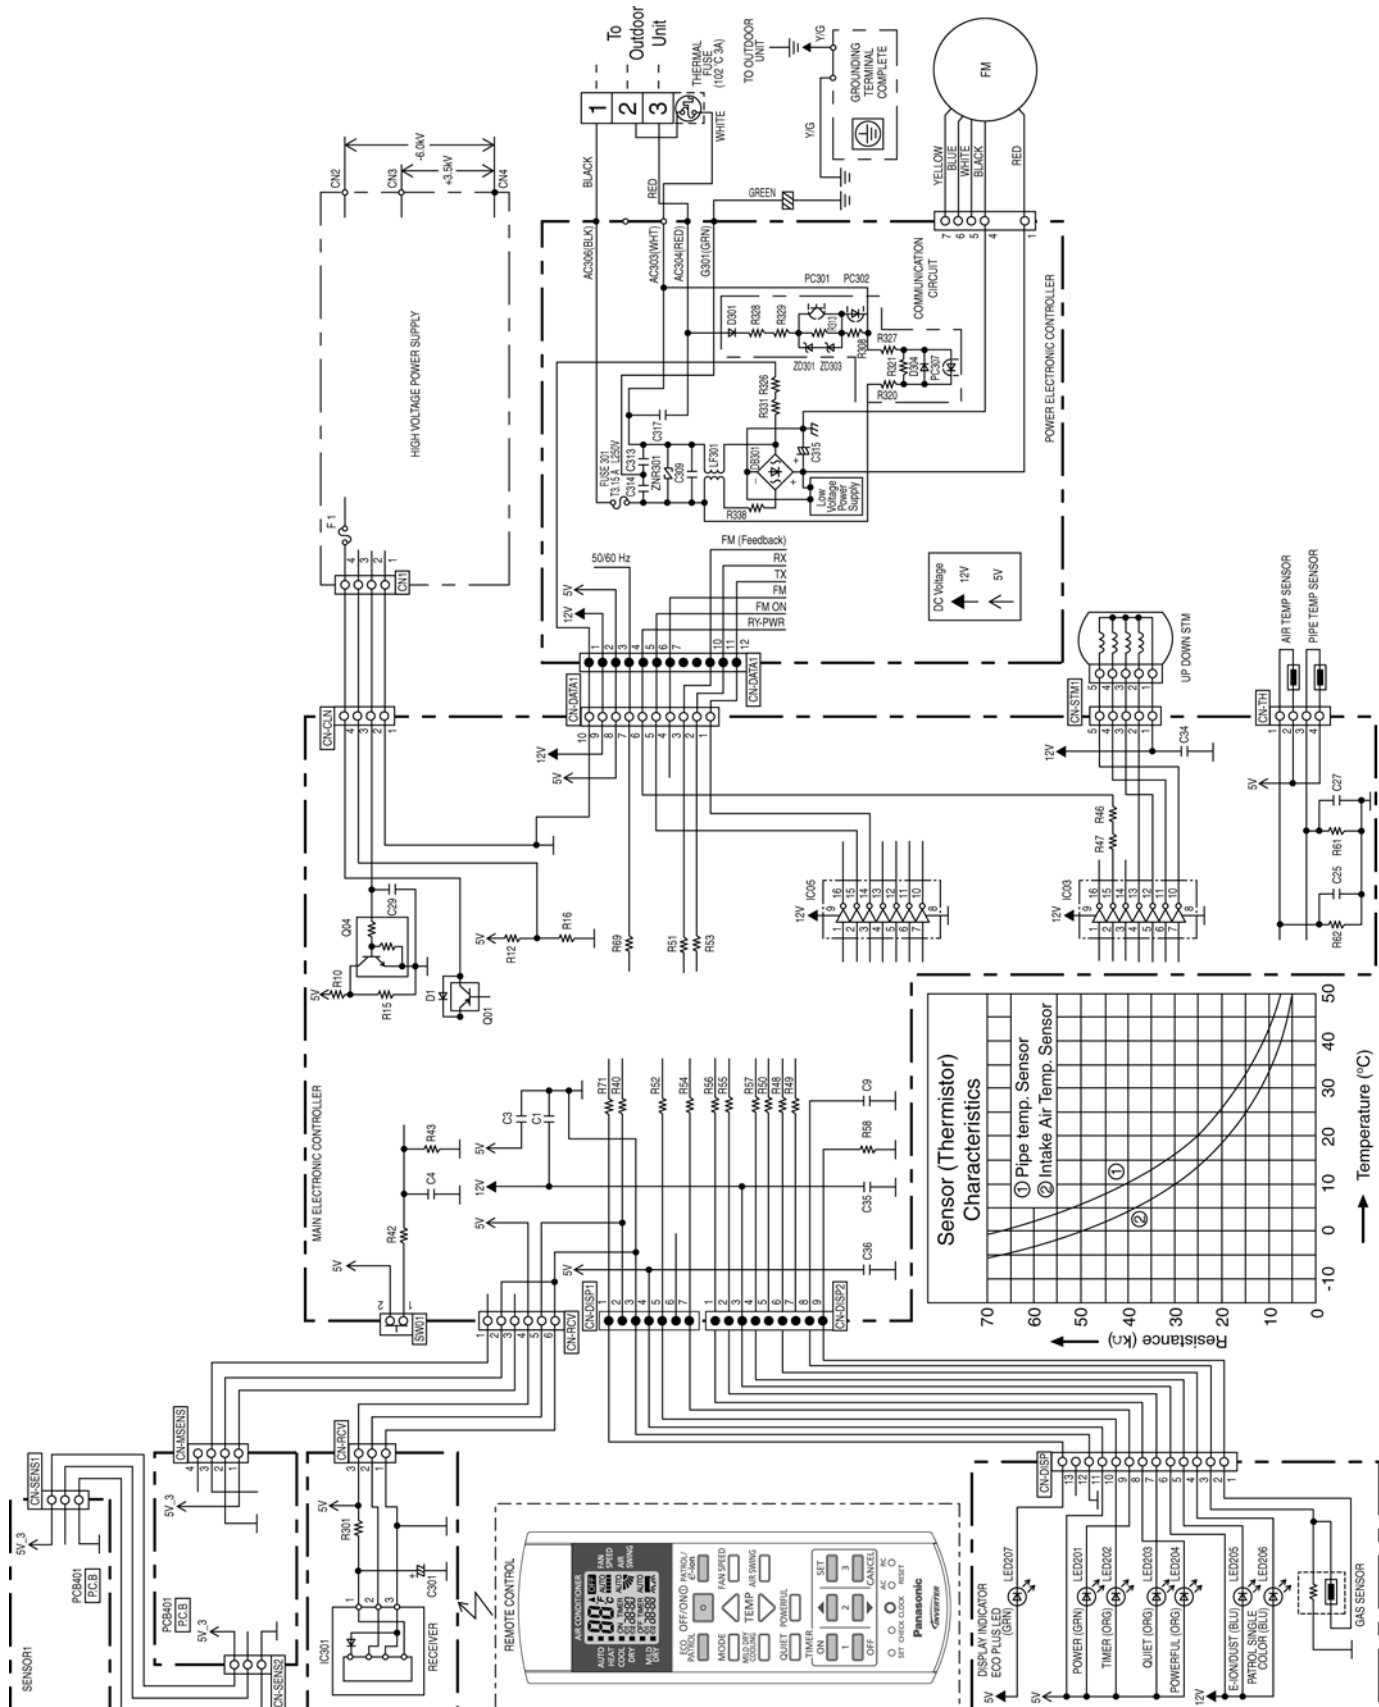


## 9.1.2. CS-E18LK CS-E21LK CS-XE18LK CS-XE21LK



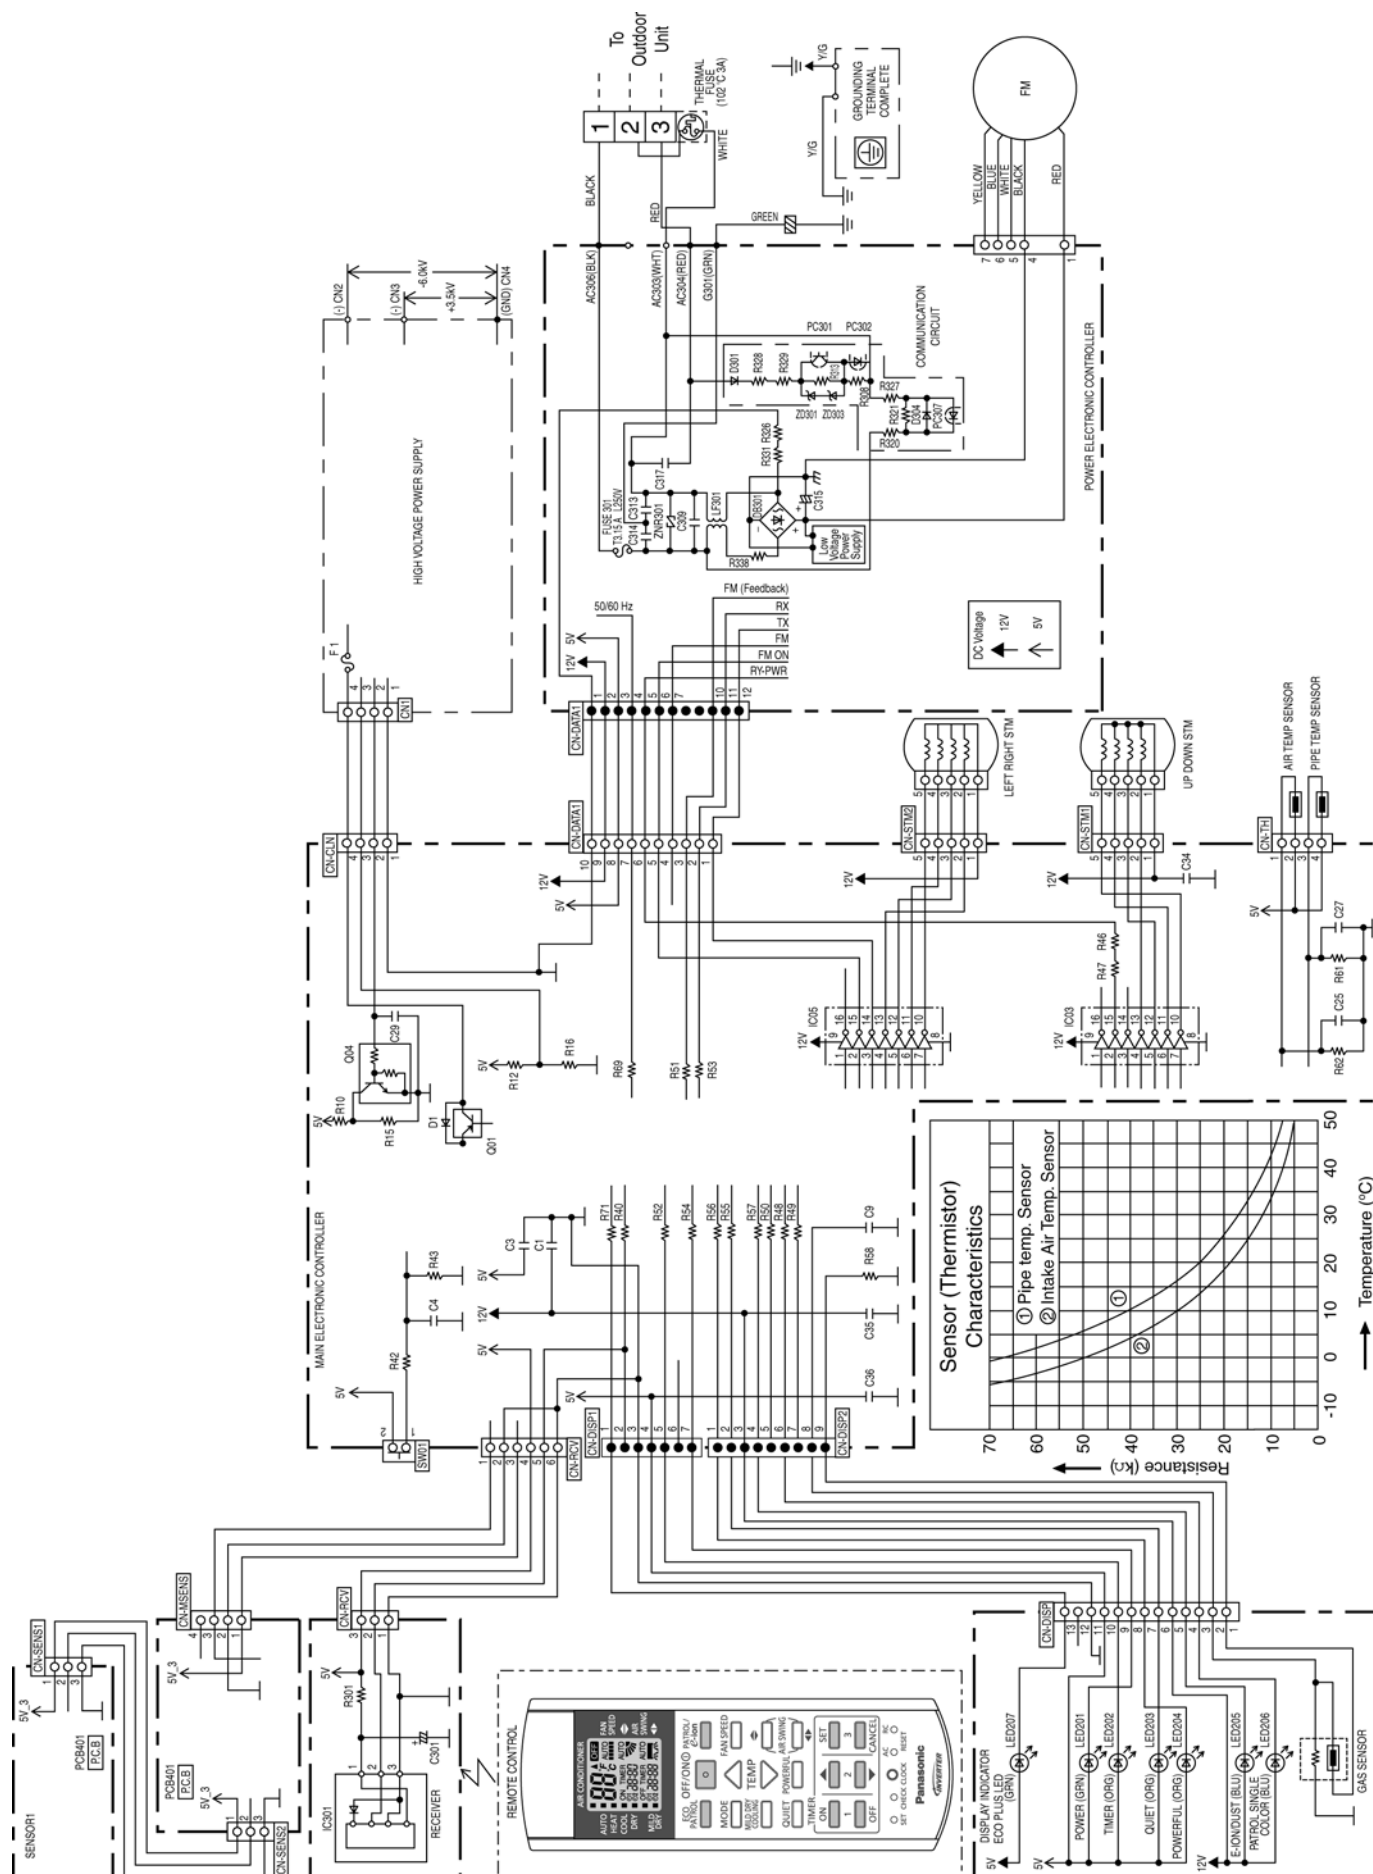


## 9.2. Outdoor Unit




### 9.2.1. CU-E7LKE CU-E9LKE CU-E15LKE

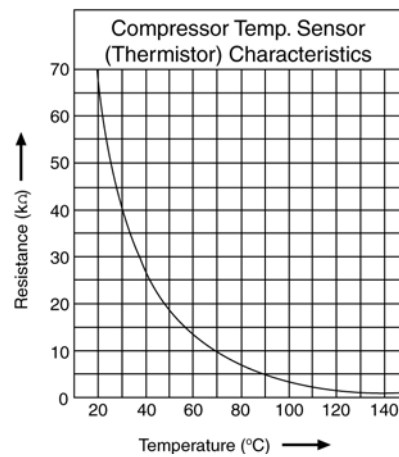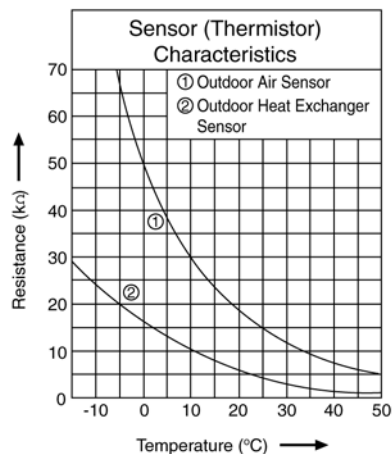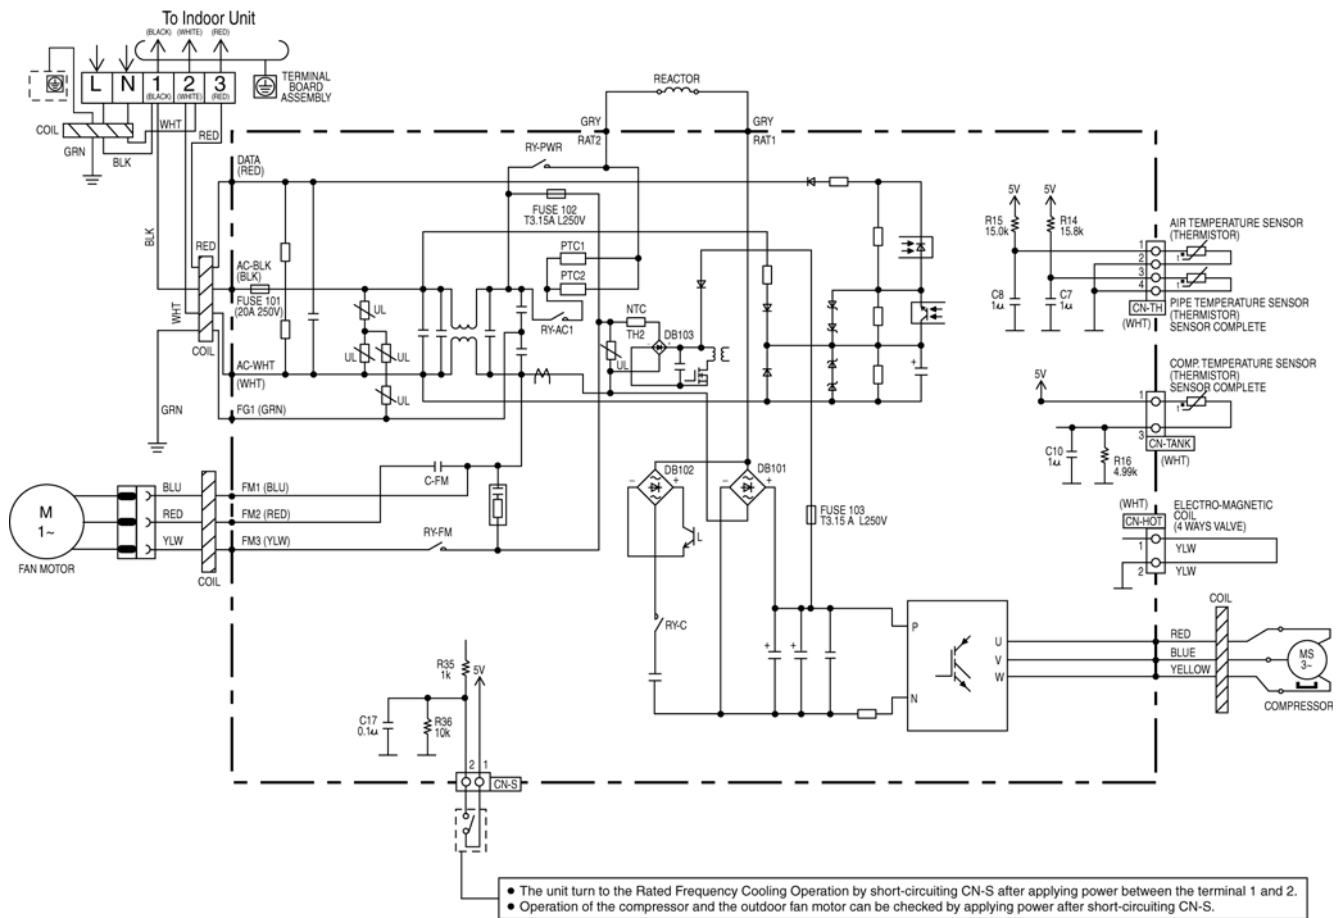




## 9.2.2. CU-E12LKE

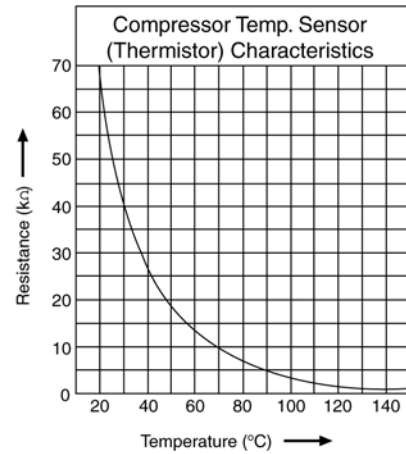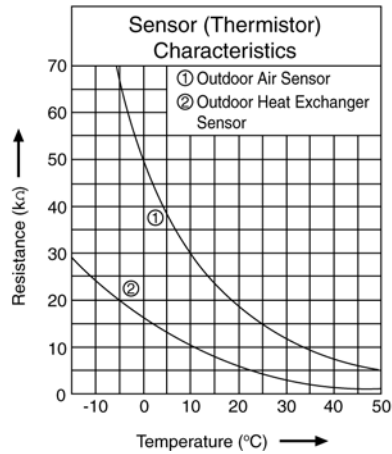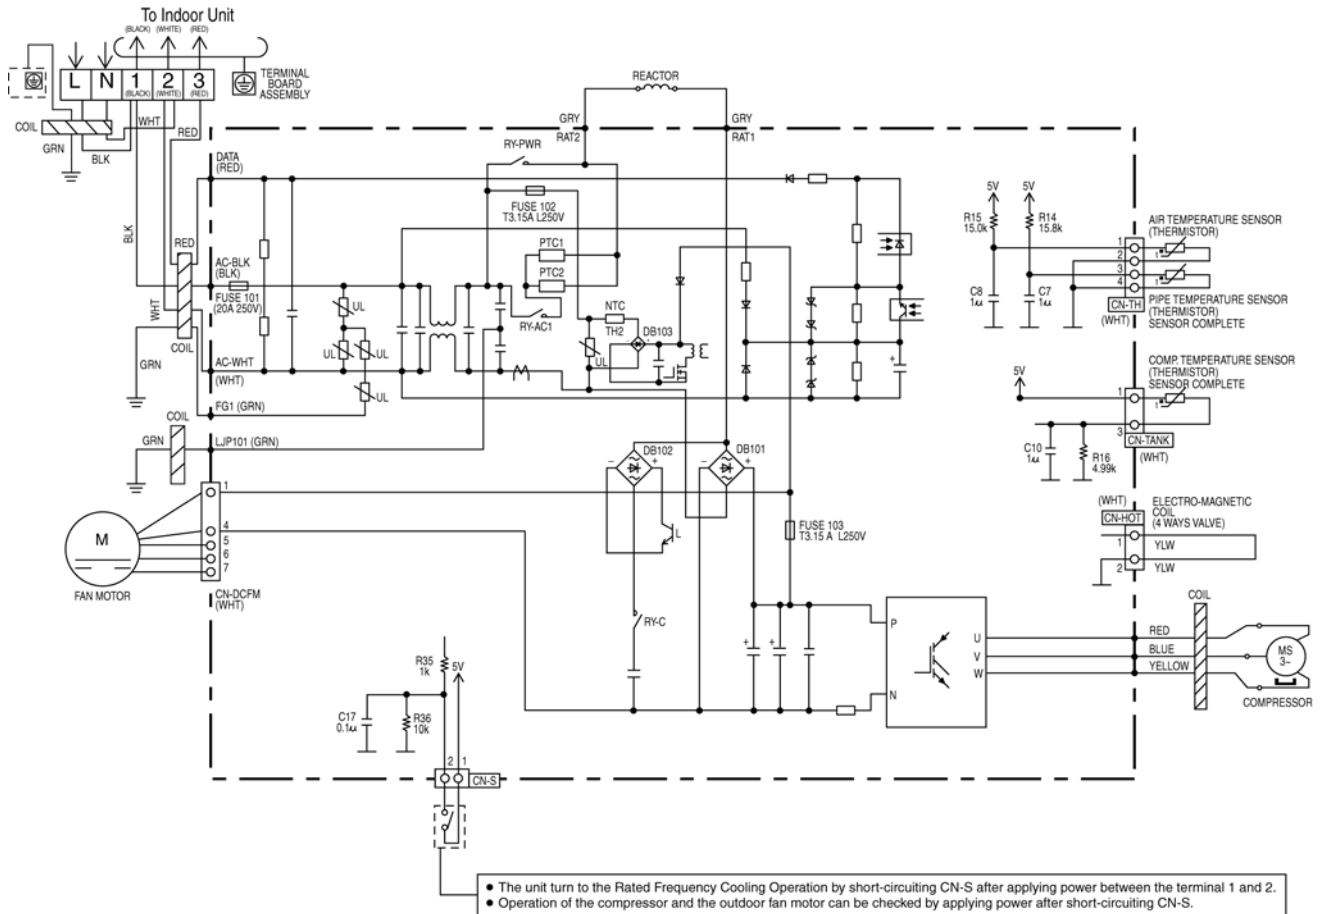

### 9.2.3. CU-E7LKE-3 CU-E9LKE-3 CU-E12LKE-3

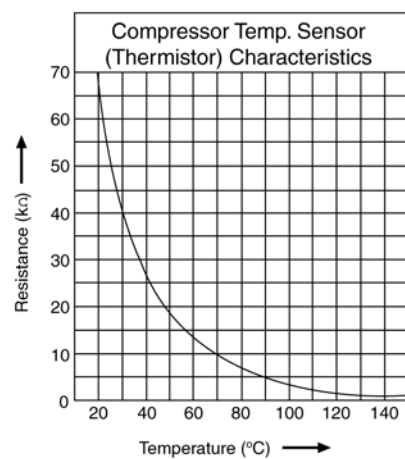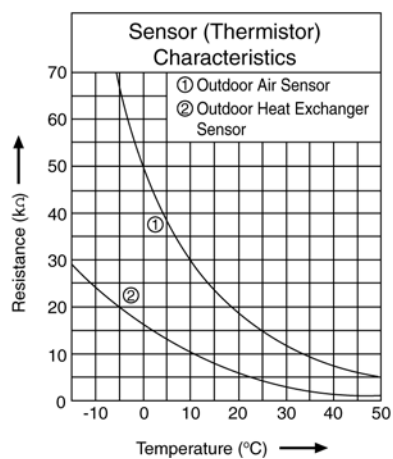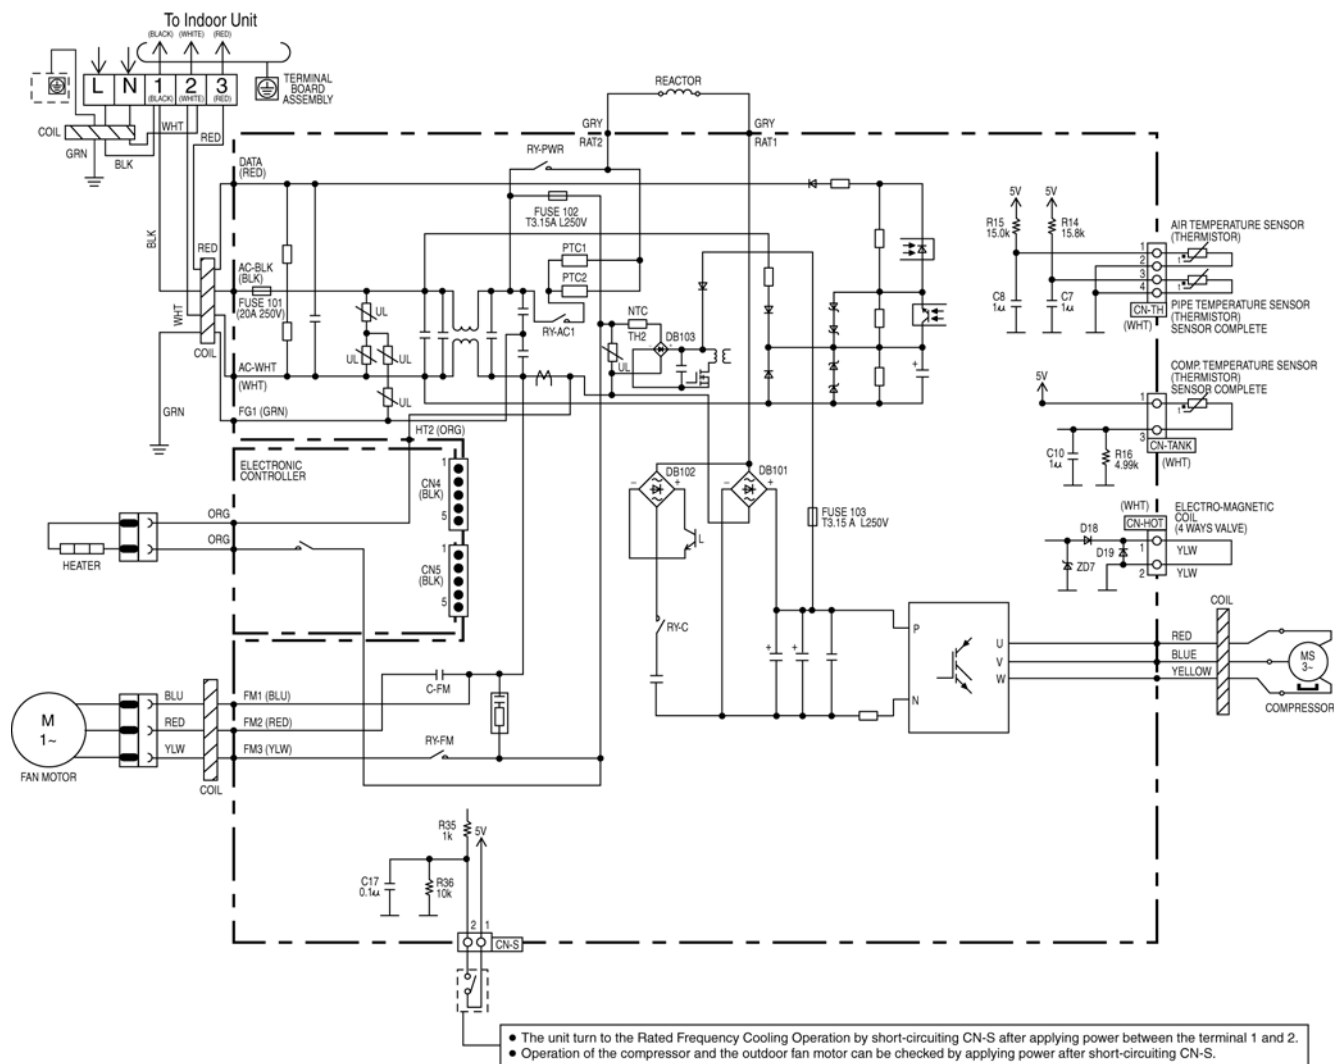

## 9.2.4. CU-E18LKE CU-E21LKE

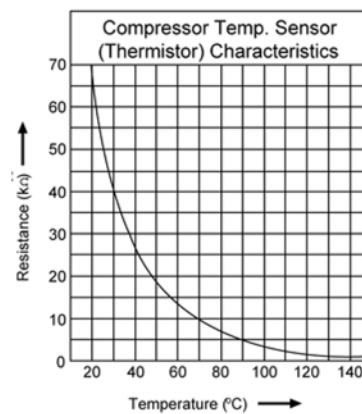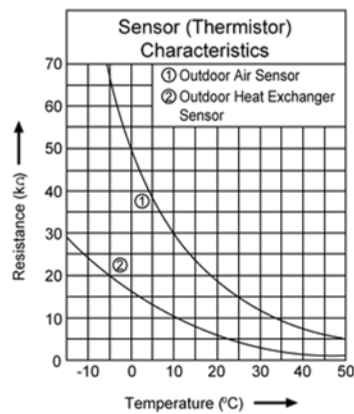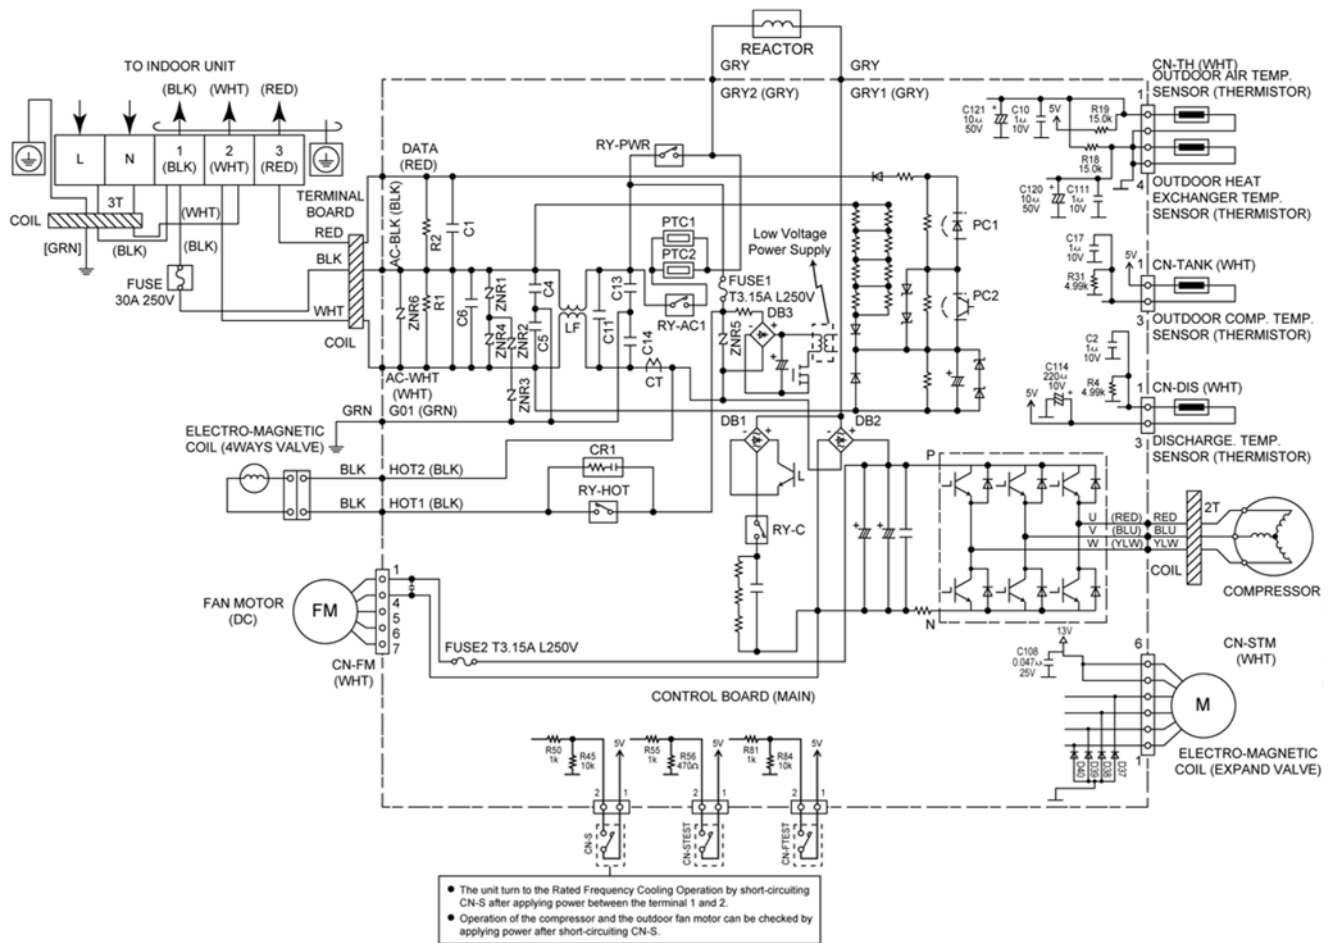


### 10.1.1. Main Printed Circuit Board







### 10.1.2. Power Printed Circuit Board

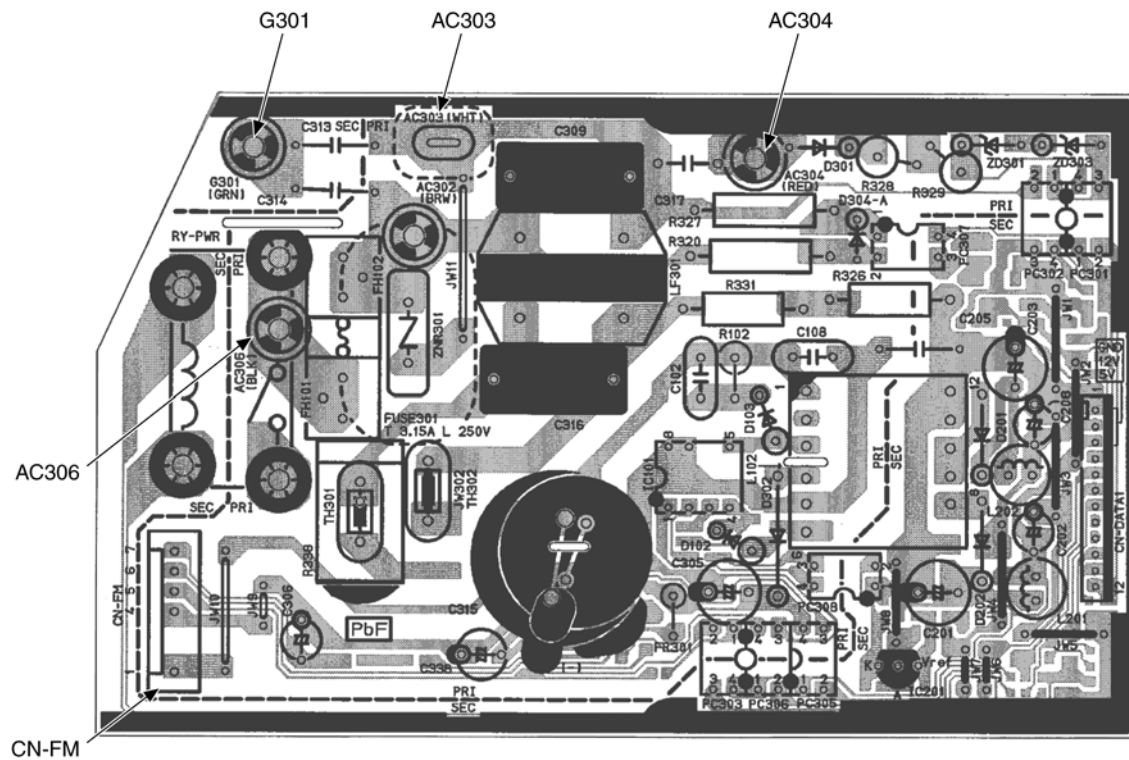


### 10.1.3. Indicator Printed Circuit Board

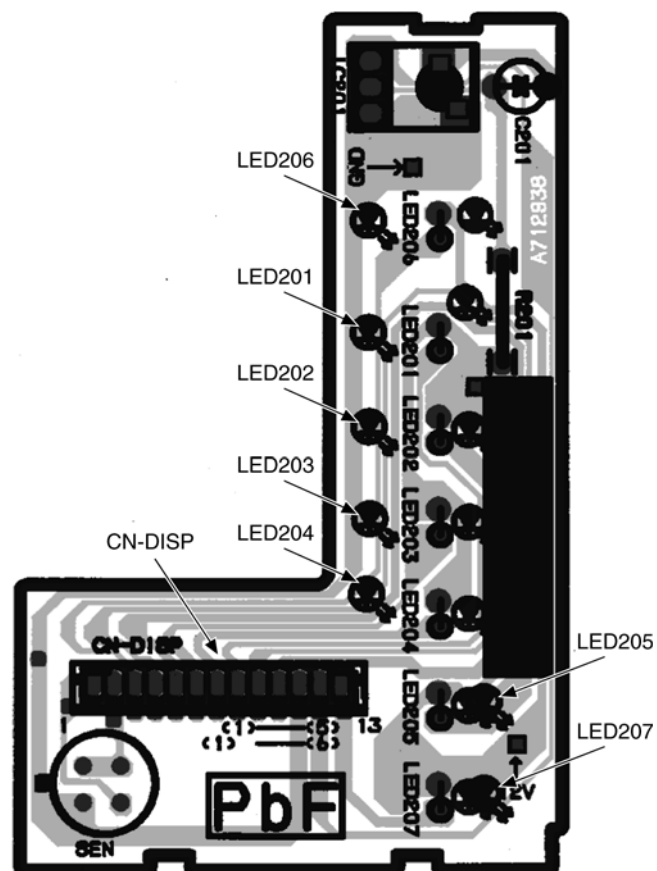


10.1.4. Receiver Printed Circuit Board

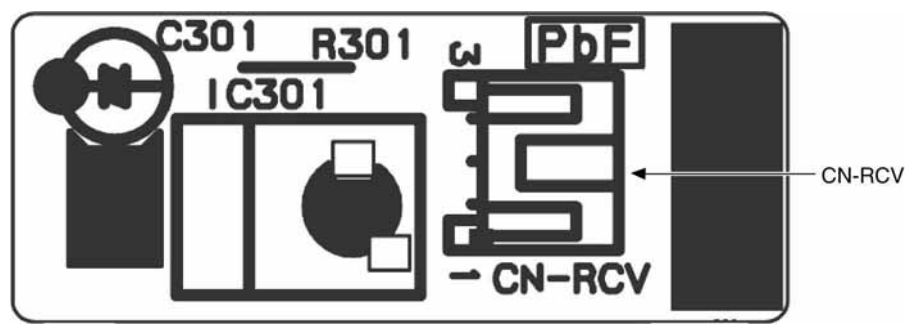


10.1.5. High Voltage Power Supply Printed Circuit Board

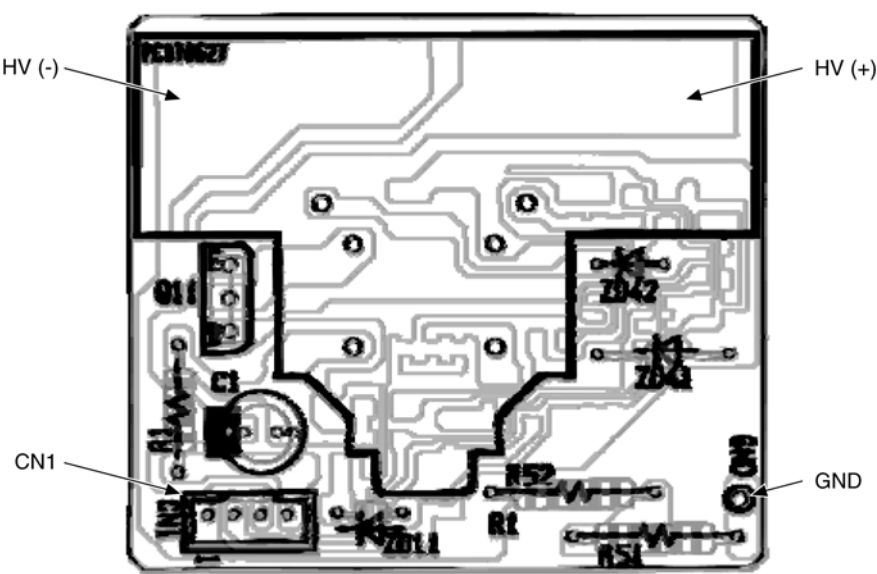

10.1.6. Comparator Printed Circuit Board

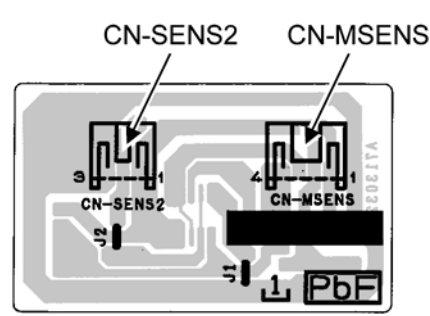



10.1.7. Eco Patrol Printed Circuit Board

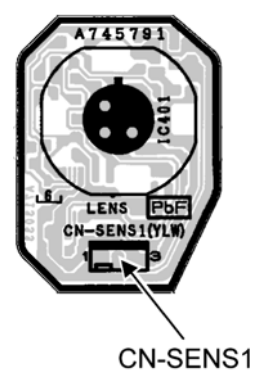


## 10.2. Outdoor Unit

### 10.2.1. CU-E7LKE CU-E9LKE CU-E12LKE CU-E15LKE CU-E7LKE-3 CU-E9LKE-3 CU-E12LKE-3

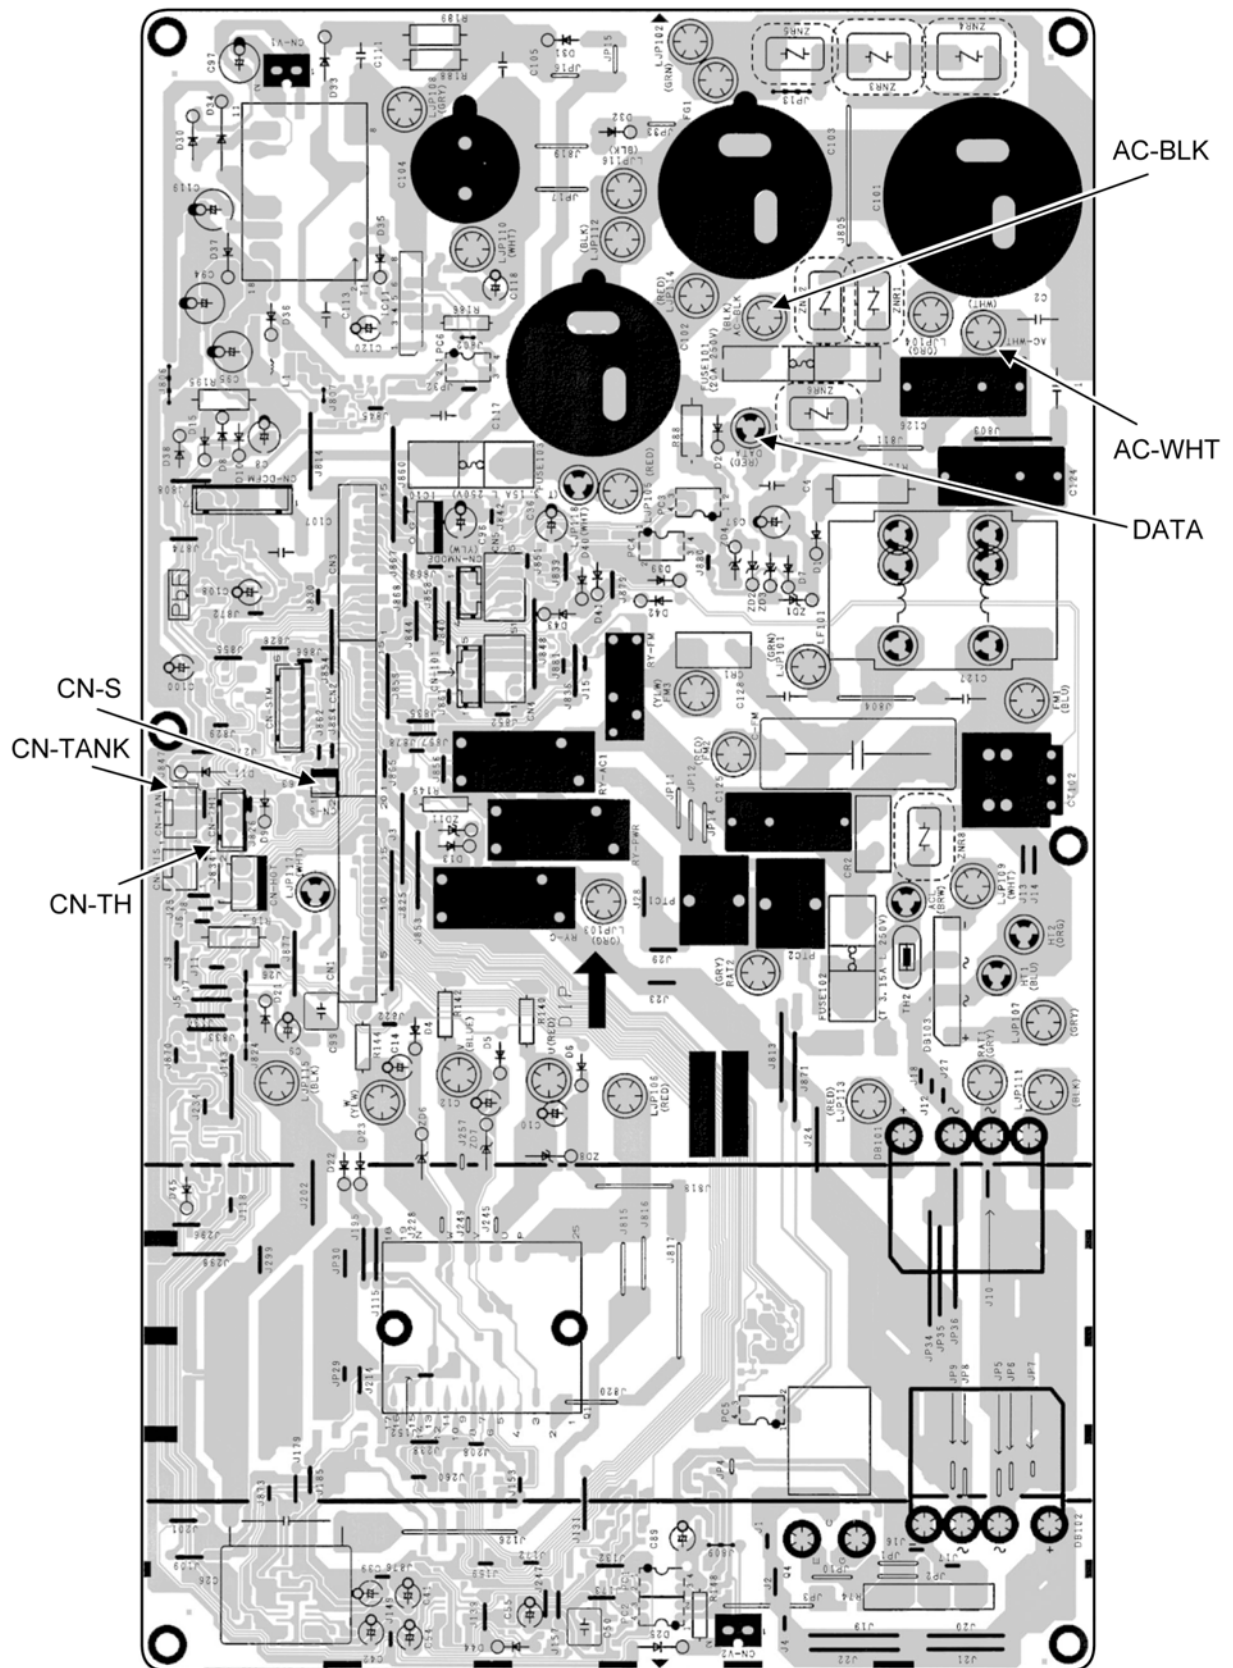

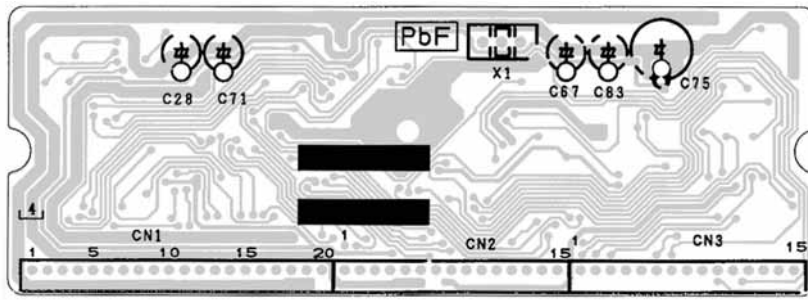

## 10.2.2. CU-E18LKE CU-E21LKE

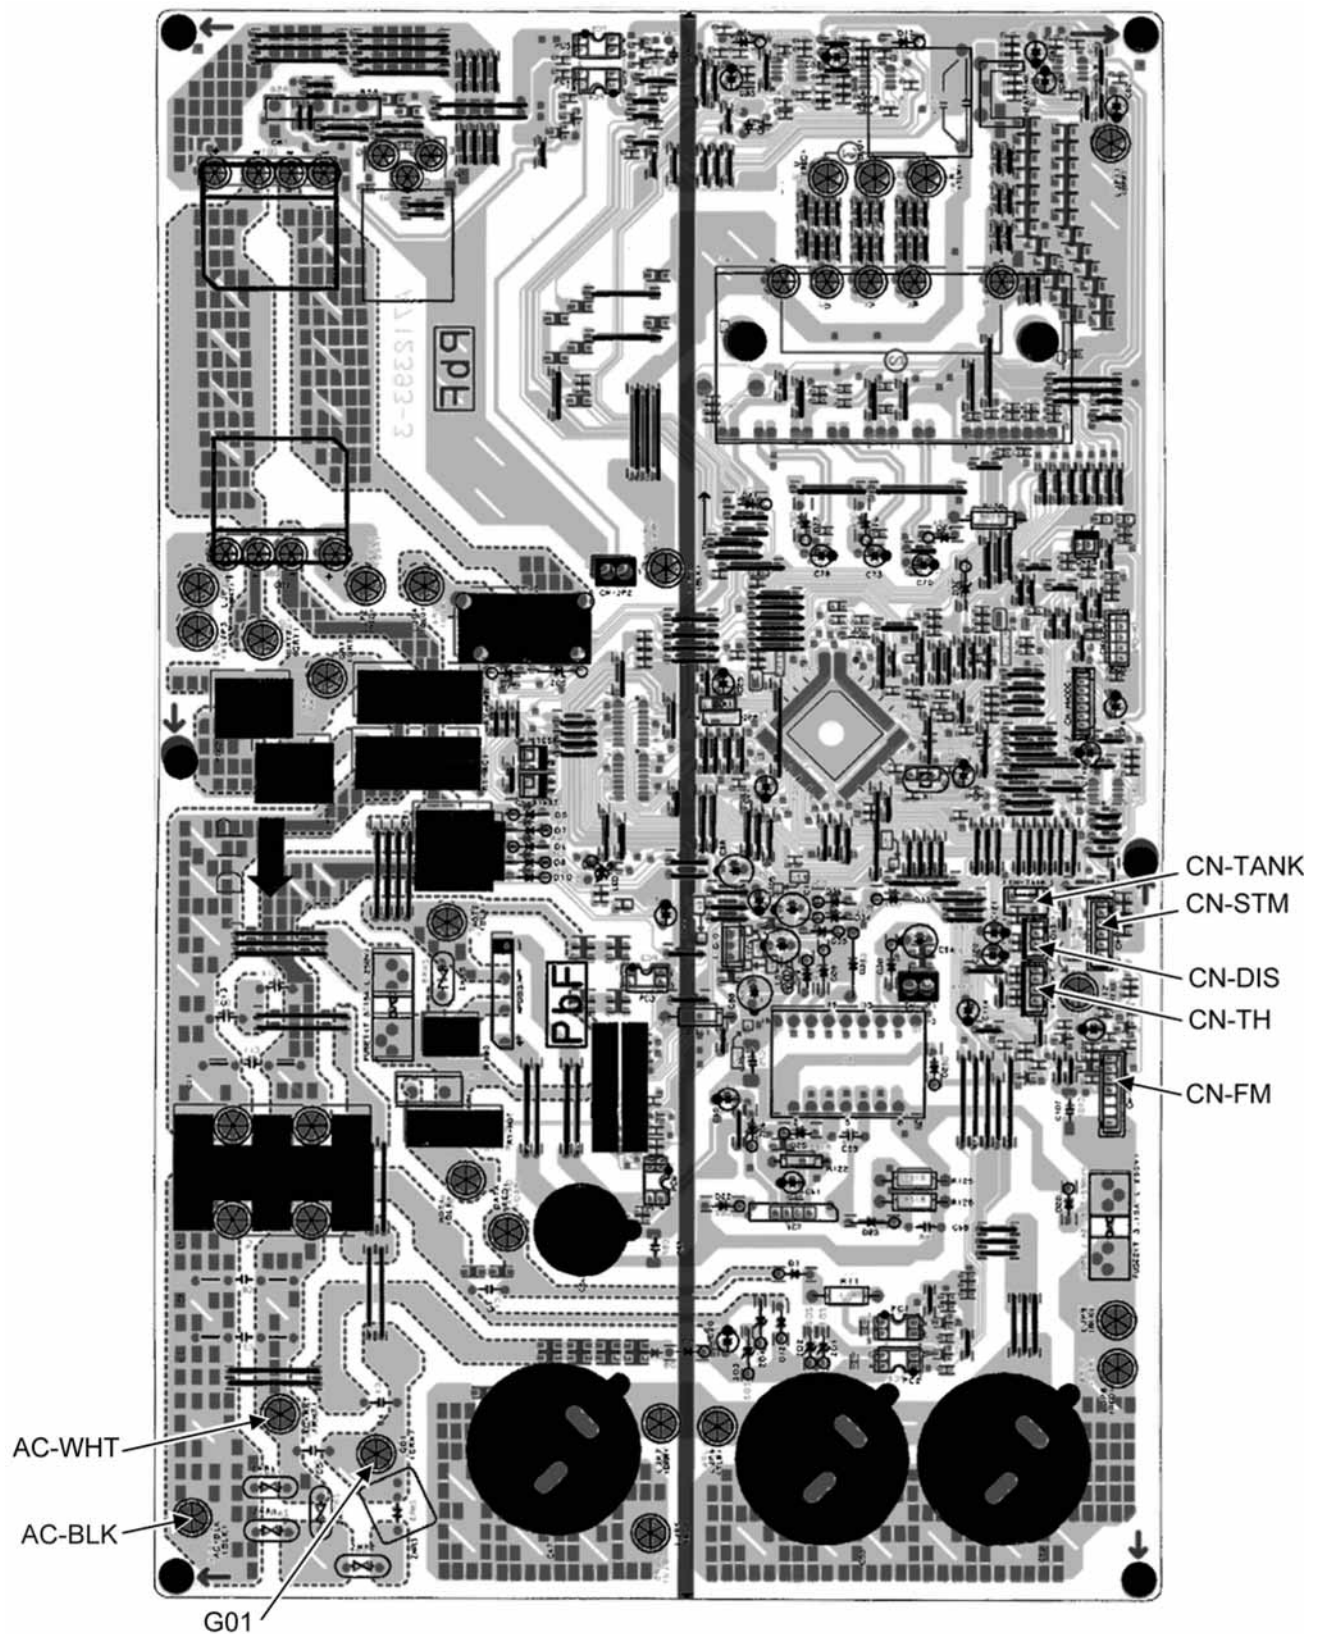

# 11 Installation Instruction

## 11.1. Select the Best Location

### 11.1.1. Indoor Unit

- Do not install the unit in excessive oil fume area such as kitchen, workshop and etc.
- There should not be any heat source or steam near the unit.
- There should not be any obstacles blocking the air circulation.
- A place where air circulation in the room is good.
- A place where drainage can be easily done.
- A place where noise prevention is taken into consideration.
- Do not install the unit near the door way.
- Ensure the spaces indicated by arrows from the wall, ceiling, fence or other obstacles.
- Recommended installation height for indoor unit shall be at least 2.5 m.

### 11.1.2. Outdoor Unit


- If an awning is built over the unit to prevent direct sunlight or rain, be careful that heat radiation from the condenser is not obstructed.
- There should not be any animal or plant which could be affected by hot air discharged.
- Keep the spaces indicated by arrows from wall, ceiling, fence or other obstacles.
- Do not place any obstacles which may cause a short circuit of the discharged air.
- If piping length is over the [piping length for additional gas], additional refrigerant should be added as shown in the table.

Model	Horse Power (HP)	Piping size		Std. Length (m)	Max. Ele- vation (m)	Min. Piping Length (m)	Max. Piping Length (m)	Additional Refrigerant (g/m)	Piping Length for add. gas (m)
		Gas	Li- quid						
E7***, XE7***	3/4 ~ 1.75HP	3/8"	1/4"	5	15	3	15	20	7.5
E9***, XE9***					15	3	15	20	7.5
E12***, XE12***					15	3	15	20	7.5
E15***, XE15***	1/2"	15			3	15	20	7.5	
E18***, XE18***		2.0 ~ 2.25HP			15	3	20	20	10
E21***, XE21***					15	3	20	20	10
E24***	2.5HP	5/8"			20	3	30	30	10
E28***	3.0HP				20	3	30	30	10

Example: For E9\*\*\*

If the unit is installed at 10 m distance, the quantity of additional refrigerant should be 50 g .... (10-7.5) m x 20 g/m = 50 g


### 11.1.3. Indoor/Outdoor Unit Installation Diagram

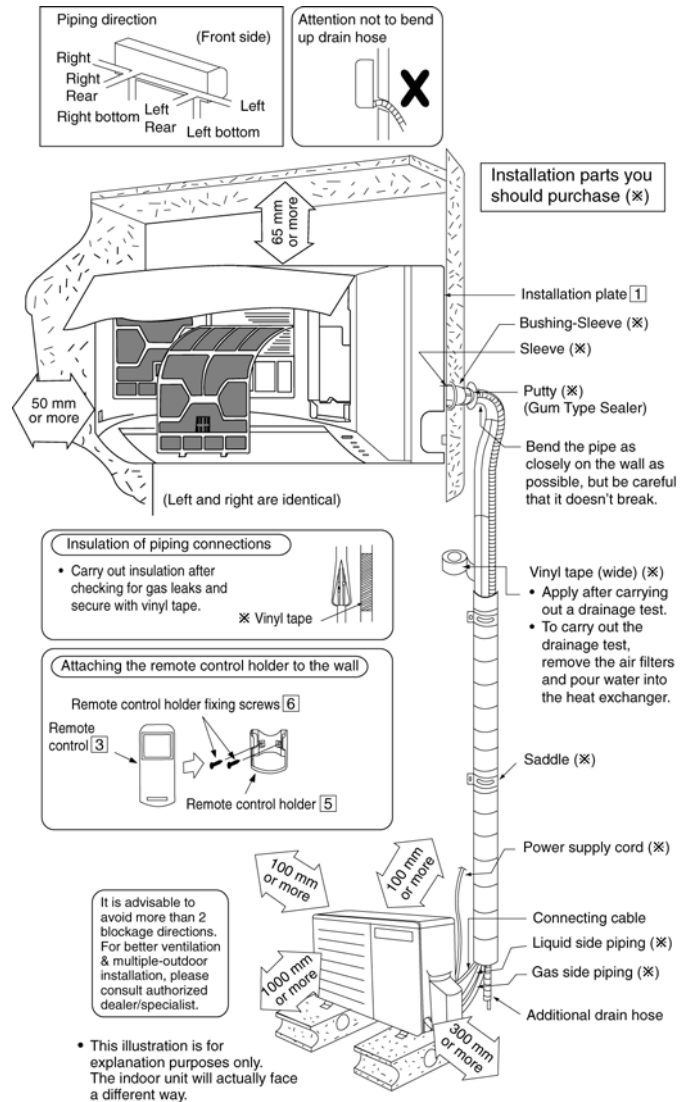

## 11.2. Indoor Unit

### 11.2.1. How to Fix Installation Plate

The mounting wall is strong and solid enough to prevent it from the vibration.

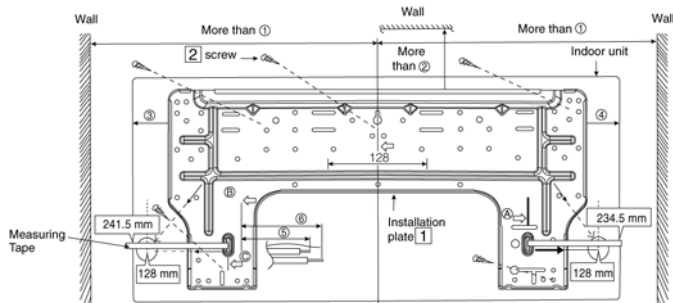

Model	Dimension					
	①	②	③	④	⑤	⑥
E7***, XE7*** E9***, XE9*** E12***, XE12*** E15***, XE15***	485 mm	82 mm	165 mm	158 mm	43 mm	95 mm
E18***, XE18*** E21***, XE21*** E24***, E28***	585 mm	82 mm	165 mm	158 mm	169 mm	219 mm

The centre of installation plate should be at more than ① at right and left of the wall.

The distance from installation plate edge to ceiling should more than ②.

From installation plate left edge to unit's left side is ③.

From installation plate right edge to unit's right is ④.

⑤ : For left side piping, piping connection for liquid should be about ⑤ from this line.

: For left side piping, piping connection for gas should be about ⑥ from this line.

1. Mount the installation plate on the wall with 5 screws or more (at least 5 screws).

(If mounting the unit on the concrete wall, consider using anchor bolts.)

- Always mount the installation plate horizontally by aligning the marking-off line with the thread and using a level gauge.

2. Drill the piping plate hole with  $\varnothing 70$  mm hole-core drill.

- Line according to the left and right side of the installation plate. The meeting point of the extended line is the center of the hole. Another method is by putting measuring tape at position as shown in the diagram above. The hole center is obtained by measuring the distance namely 128 mm for left and right hole respectively.
- Drill the piping hole at either the right or the left and the hole should be slightly slanting to the outdoor side.


### 11.2.2. To Drill a Hole in the Wall and Install a Sleeve of Piping

1. Insert the piping sleeve to the hole.
2. Fix the bushing to the sleeve.
3. Cut the sleeve until it extrudes about 15 mm from the wall.


#### Caution

When the wall is hollow, please be sure to use the sleeve for tube ass'y to prevent dangers caused by mice biting the connecting cable.

4. Finish by sealing the sleeve with putty or caulking compound at the final stage.

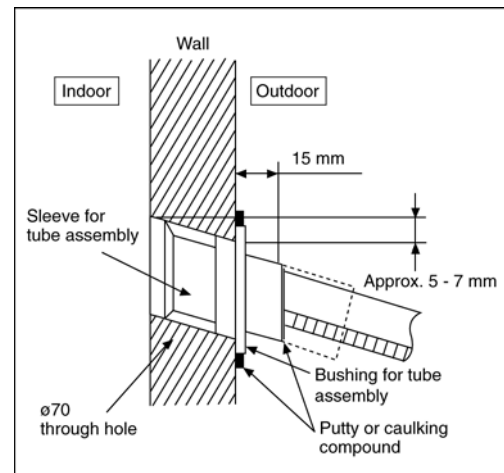

### 11.2.3. Indoor Unit Installation

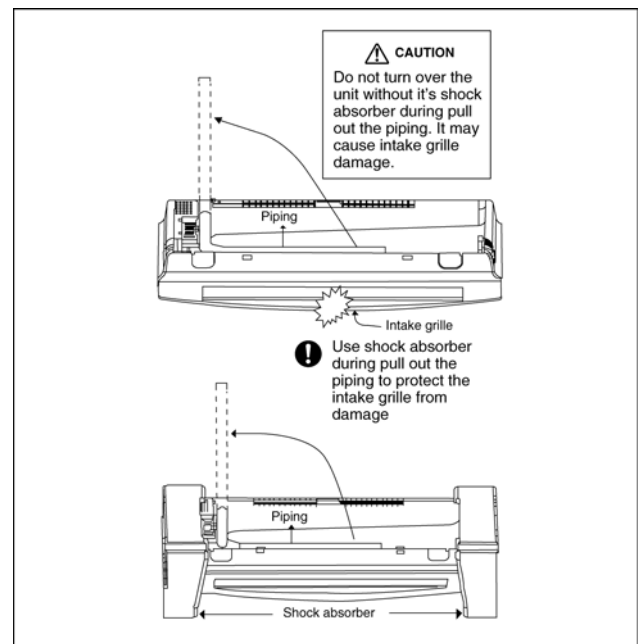

### 1. For the right rear piping

- Step-1** Pull out the Indoor piping
- Step-2** Install the Indoor Unit
- Step-3** Secure the Indoor Unit
- Step-4** Insert the connecting cable


### 2. For the right and right bottom piping

- Step-1** Pull out the Indoor piping
- Step-2** Install the Indoor Unit
- Step-3** Insert the connecting cable
- Step-4** Secure the Indoor Unit

### 3. For the embedded piping

- Step-1** Replace the drain hose
- Step-2** Bend the embedded piping
  - Use a spring bender or equivalent to bend the piping so that the piping is not crushed.
- Step-3** Pull the connecting cable into Indoor Unit
  - The inside and outside connecting cable can be connected without removing the front grille.
- Step-4** Cut and flare the embedded piping
  - When determining the dimensions of the piping, slide the unit all the way to the left on the installation plate.
  - Refer to the section "Cutting and flaring the piping".
- Step-5** Install the Indoor Unit
- Step-6** Connect the piping
  - Please refer to "Connecting the piping" column in outdoor unit section. (Below steps are done after connecting the outdoor piping and gas-leakage confirmation.)
- Step-7** Insulate and finish the piping
  - Please refer to "Piping and finishing" column of outdoor section and "Insulation of piping connection" column as mentioned in indoor/outdoor unit installation.
- Step-8** Secure the Indoor Unit


#### Right Rear piping

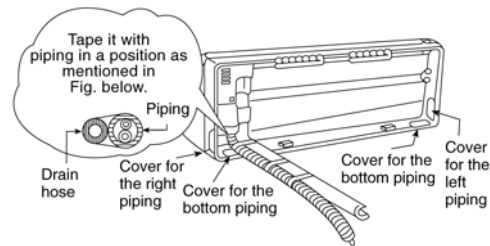


#### How to keep the cover

In case of the cover is cut, keep the cover at the rear of chassis as shown in the illustration for future reinstallation.

(Left, right and 2 bottom covers for piping.)




#### Right and Right Bottom piping

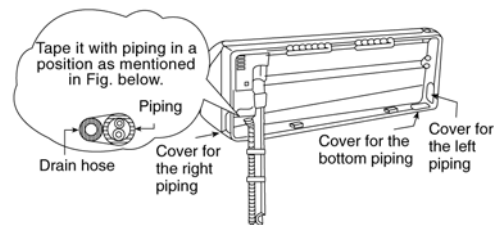



#### Install the indoor unit

Hook the indoor unit onto the upper portion of installation plate. (Engage the indoor unit with the upper edge of the installation plate). Ensure the hooks are properly seated on the installation plate by moving it in left and right.




#### Secure the Indoor Unit

- Press the lower left and right side of the unit against the installation plate until hooks engages with their slot (sound click).








To take out the unit, push the **[PUSH]** marking at the bottom unit, and pull it slightly towards you to disengage the hooks from the unit.

#### Insert the connecting cable

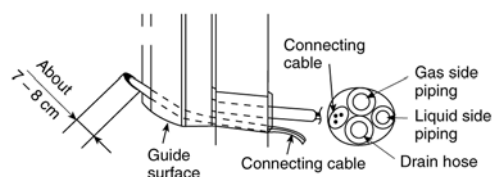

(This can be used for left rear piping and bottom piping also.)



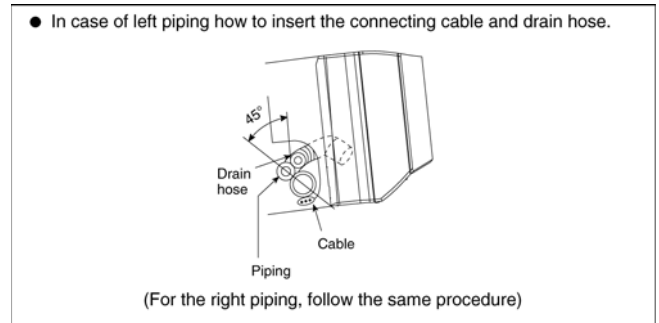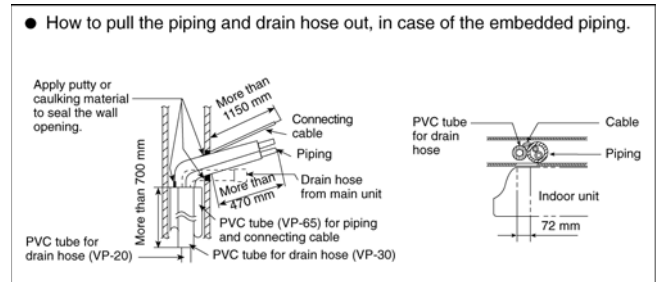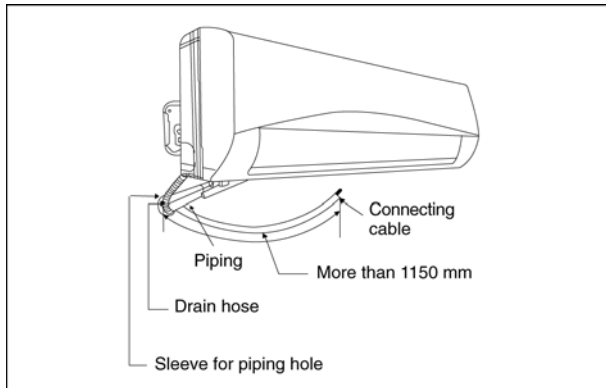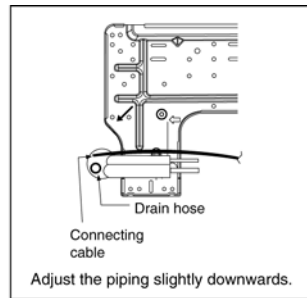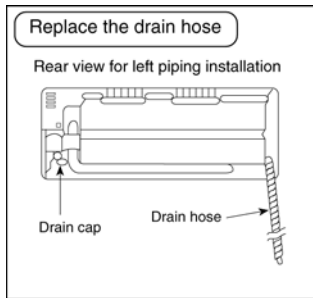

#### 11.2.4. Connect the Cable to the Indoor Unit



1. The inside and outside connecting cable can be connected without removing the front grille.
2. **Connecting cable** between indoor unit and outdoor unit shall be approved polychloroprene sheathed 4 x 1.5 mm<sup>2</sup> flexible cord, type designation 245 IEC 57 or heavier cord.

Terminals on the indoor unit	1	2	3	
Colour of wires				
Terminals on the outdoor unit	1	2	3	

- Secure the connecting cable onto the control board with the holder (clamper).



⚠ This equipment must be properly earthed.

- Ensure the colour of wires of outdoor unit and the terminal Nos. are the same to the indoor's respectively.
- Earth wire shall be Yellow/Green (Y/G) in colour and longer than other AC wires for safety reason.

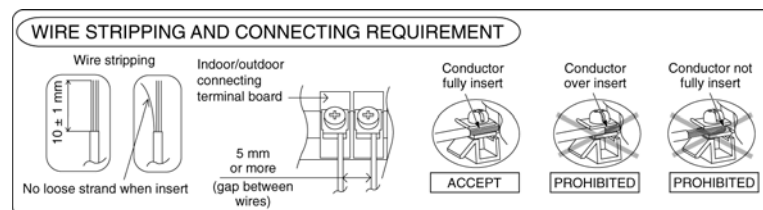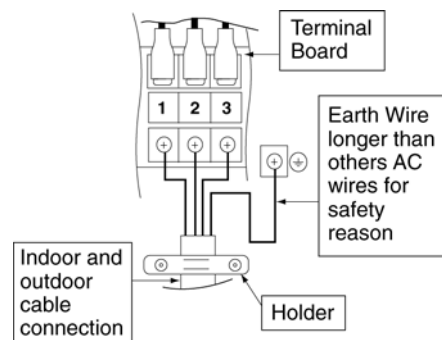

#### CUTTING AND FLARING THE PIPING

1. Please cut using pipe cutter and then remove the burrs.
2. Remove the burrs by using reamer. If burrs is not removed, gas leakage may be caused.  
Turn the piping end down to avoid the metal powder entering the pipe.
3. Please make flare after inserting the flare nut onto the copper pipes.

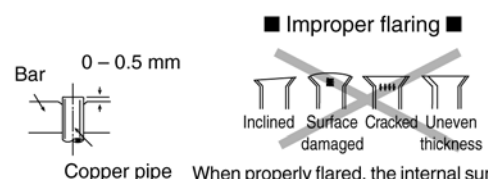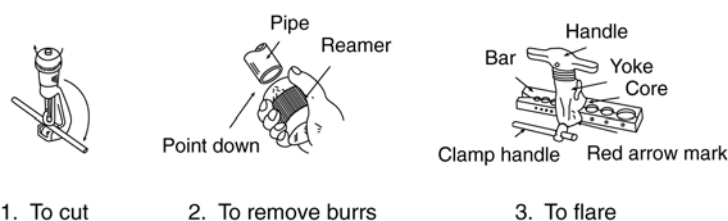


When properly flared, the internal surface of the flare will evenly shine and be of even thickness. Since the flare part comes into contact with the connections, carefully check the flare finish.

## 11.3. Outdoor Unit

### 11.3.1. Install the Outdoor Unit

- After selecting the best location, start installation according to Indoor/Outdoor Unit Installation Diagram.
- 1. Fix the unit on concrete or rigid frame firmly and horizontally by bolt nut (ø10 mm).
- 2. When installing at roof, please consider strong wind and earthquake. Please fasten the installation stand firmly with bolt or nails.

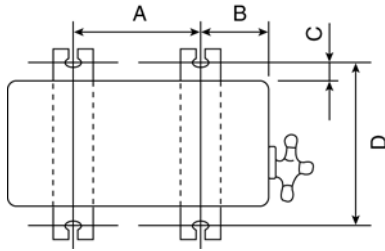

Model	A	B	C	D
E7***	570 mm	105 mm	18.5 mm	320 mm
E9***				
E12***				
E15***				
E15***-3	612.5 mm	131 mm	19 mm	383 mm
E18***				
E21***				
E24***	613 mm	131 mm	16 mm	360.5 mm
E28***				

### 11.3.2. Connect the Piping

#### Connecting the Piping to Indoor

Please make flare after inserting flare nut (locate at joint portion of tube assembly) onto the copper pipe.

(In case of using long piping)

Connect the piping


- Align the center of piping and sufficiently tighten the flare nut with fingers.
- Further tighten the flare nut with torque wrench in specified torque as stated in the table.

<div style="text-align: center;"> <b>CAUTION</b> </div>	
Do not over tighten, over tightening cause gas leakage.	
Piping Size	Torque
1/4" (6.35 mm)	[18 N•m (1.8 kgf.m)]
3/8" (9.52 mm)	[42 N•m (4.3 kgf.m)]
1/2" (12.7 mm)	[55 N•m (5.6 kgf.m)]
5/8" (15.88 mm)	[65 N•m (6.6 kgf.m)]
3/4" (19.05 mm)	[100 N•m (10.2 kgf.m)]

#### Connecting the Piping to Outdoor

Decide piping length and then cut by using pipe cutter. Remove burrs from cut edge. Make flare after inserting the flare nut (located at valve) onto the copper pipe.


Align center of piping to valve and then tighten with torque wrench to the specified torque as stated in the table.

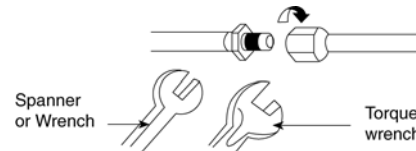

#### Connecting the Piping to Outdoor Multi


Decide piping length and then cut by using pipe cutter. Remove burrs from cut edge. Make flare after inserting the flare nut (located at valve) onto the copper pipe.

Align center of piping to valve and then tighten with torque wrench to the specified torque as stated in the table.

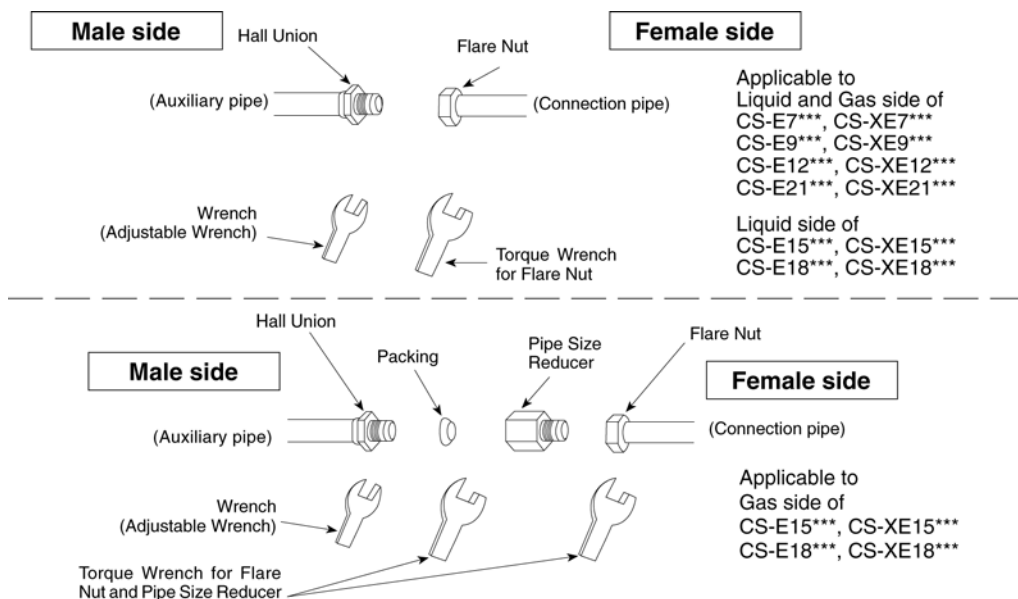

### 11.3.3. Evacuation of the Equipment

WHEN INSTALLING AN AIR CONDITIONER, BE SURE TO EVACUATE THE AIR INSIDE THE INDOOR UNIT AND PIPES in the following procedure.

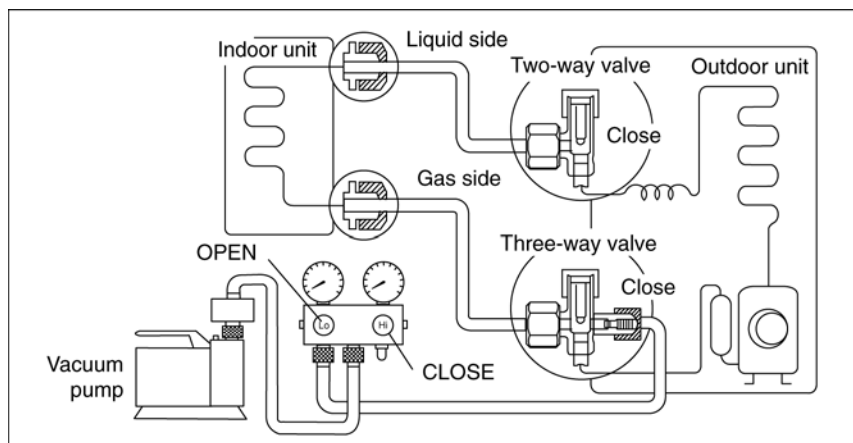

1. Connect a charging hose with a push pin to the Low side of a charging set and the service port of the 3-way valve.
  - Be sure to connect the end of the charging hose with the push pin to the service port.
2. Connect the center hose of the charging set to a vacuum pump.
3. Turn on the power switch of the vacuum pump and make sure that the needle in the gauge moves from 0 cmHg (0 MPa) to -76 cmHg (-0.1 MPa). Then evacuate the air approximately ten minutes.
4. Close the Low side valve of the charging set and turn off the vacuum pump. Make sure that the needle in the gauge does not move after approximately five minutes.
 


Note: BE SURE TO TAKE THIS PROCEDURE IN ORDER TO AVOID REFRIGERANT GAS LEAKAGE.
5. Disconnect the charging hose from the vacuum pump and from the service port of the 3-way valve.
6. Tighten the service port caps of the 3-way valve at a torque of 18 N•m with a torque wrench.
7. Remove the valve caps of both of the 2-way valve and 3-way valve. Position both of the valves to "OPEN" using a hexagonal wrench (4 mm).
8. Mount valve caps onto the 2-way valve and the 3-way valve.
  - Be sure to check for gas leakage.


#### CAUTION

- If gauge needle does not move from 0 cmHg (0 MPa) to -76 cmHg (-0.1 MPa), in step ③ above take the following measure:
  - If the leak stops when the piping connections are tightened further, continue working from step ③.
  - If the leak does not stop when the connections are retightened, repair the location of leak.
  - Do not release refrigerant during piping work for installation and reinstallation.
  - Take care of the liquid refrigerant, it may cause frostbite.

### 11.3.4. Connect the Cable to the Outdoor Unit

1. Remove the control board cover from the unit by loosening the screw.
2. Cable connection to the power supply through Isolating Devices (Disconnecting means).
  - Connect approved type polychloroprene sheathed **power supply cord** 3 x 1.5 mm<sup>2</sup> (3/4 ~ 1.75HP), 3 x 2.5 mm<sup>2</sup> (2.0 ~ 2.5HP) or 3 x 4.0 mm<sup>2</sup> (3.0HP) type designation 245 IEC 57 or heavier cord to the terminal board, and connect the others end of the cord to Isolating Devices (Disconnecting means).
3. **Connecting cable** between indoor unit and outdoor unit shall be approved polychloroprene sheathed 4 x 1.5 mm<sup>2</sup> flexible cord, type designation 245 IEC 57 or heavier cord.
4. Connect the power supply cord and connecting cable between indoor unit and outdoor unit according to the diagram below.

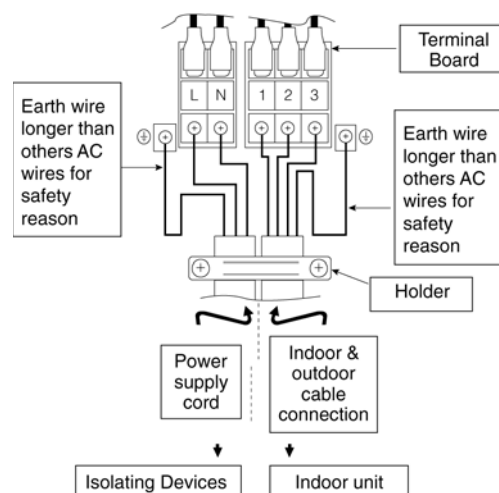

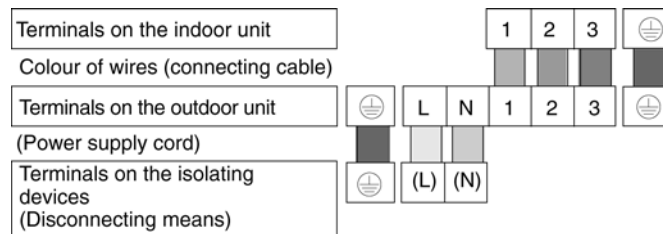

5. Secure the power supply cord and connecting cable onto the control board with the holder.
6. Attach the control board cover back to the original position with screw.
7. For wire stripping and connection requirement, refer to instruction ⑤ of indoor unit.



This equipment must be properly earthed.

- Note: Isolating Devices (Disconnecting means) should have minimum 3.0 mm contact gap.
- Earth wire shall be Yellow/Green (Y/G) in colour and longer than other AC wires for safety reason.

### 11.3.5. Pipe Insulation

1. Please carry out insulation at pipe connection portion as mentioned in Indoor/Outdoor Unit Installation Diagram. Please wrap the insulated piping end to prevent water from going inside the piping.
2. If drain hose or connecting piping is in the room (where dew may form), please increase the insulation by using POLY-E FOAM with thickness 6mm or above.


# 12 Operation and Control

## 12.1. Basic Function

Inverter control, which equipped with a microcomputer in determining the most suitable operating mode as time passes, automatically adjusts output power for maximum comfort always. In order to achieve the suitable operating mode, the microcomputer maintains the set temperature by measuring the temperature of the environment and performing temperature shifting. The compressor at outdoor unit is operating following the frequency instructed by the microcomputer at indoor unit that judging the condition according to internal setting temperature and intake air temperature.

### 12.1.1. Internal Setting Temperature

Once the operation starts, remote control setting temperature will be taken as base value for temperature shifting processes. These shifting processes are depending on the air conditioner settings and the operation environment. The final shifted value will be used as internal setting temperature and it is updated continuously whenever the electrical power is supplied to the unit.

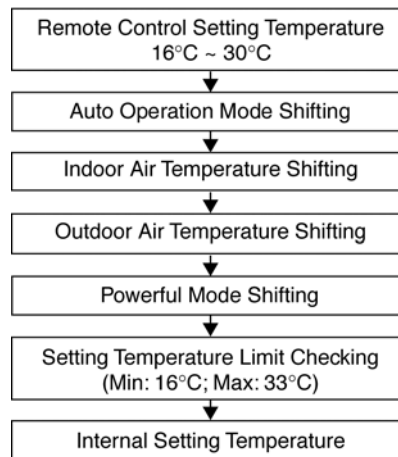

### 12.1.2. Cooling Operation

#### 12.1.2.1. Thermostat control

- Compressor is OFF when Intake Air Temperature - Internal Setting Temperature < -1.5°C.
- Compressor is ON after waiting for 3 minutes, if the Intake Air Temperature - Internal Setting Temperature > Compressor OFF point.

### 12.1.3. Soft Dry Operation

#### 12.1.3.1. Thermostat control

- Compressor is OFF when Intake Air Temperature - Internal Setting Temperature < -2.0°C.
- Compressor is ON after waiting for 3 minutes, if the Intake Air Temperature - Internal Setting Temperature > Compressor OFF point.


### 12.1.4. Heating Operation

#### 12.1.4.1. Thermostat control


- Compressor is OFF when Intake Air Temperature - Internal Setting Temperature > +2.0°C.
- Compressor is ON after waiting for 3 minutes, if the Intake Air Temperature - Internal Setting Temperature < Compressor OFF point.

12.1.5. Automatic Operation

- This mode can be set using remote control and the operation is decided by remote control setting temperature, remote control operation mode and indoor intake air temperature.
- During operation mode judgment, indoor fan motor (with speed of Lo-) is running for 30 seconds to detect the indoor intake air temperature.
- Every 10 minutes, the indoor temperature is judged.
- For the 1st judgment
  - If indoor intake temperature - remote control setting temperature  $\geq 2^{\circ}\text{C}$ , COOL mode is decided.
  - If  $-2^{\circ}\text{C} \leq$  indoor intake temperature - remote control setting temperature  $< 2^{\circ}\text{C}$ , DRY mode is decided.
  - If indoor intake temperature - remote control setting temperature  $< -2^{\circ}\text{C}$ , HEAT mode is decided.

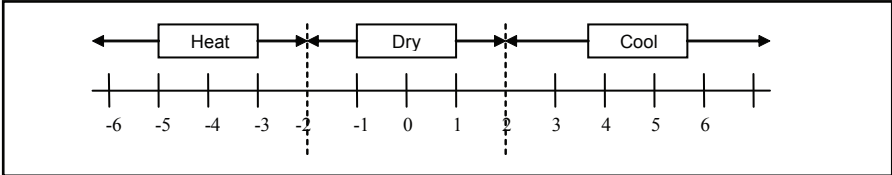

- For the 2nd judgment onwards
  - If indoor intake temperature - remote control setting temperature  $\geq 3^{\circ}\text{C}$ , if previous operate in DRY mode, then continue in DRY mode. otherwise COOL mode is decided.
  - If  $-2^{\circ}\text{C} \leq$  indoor intake temperature - remote control setting temperature  $< 3^{\circ}\text{C}$ , maintain with previous mode.
  - If indoor intake temperature - remote control setting temperature  $< -2^{\circ}\text{C}$ , HEAT mode is decided.

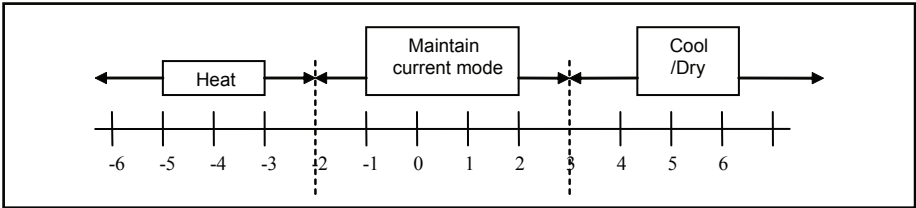

12.2. Indoor Fan Motor Operation

A. Basic Rotation Speed (rpm)

i. Manual Fan Speed

[Cooling, Dry]

- Fan motor's number of rotation is determined according to remote control setting.

Remote Control	O	O	O	O	O
Tab	Hi	Me+	Me	Me-	Lo

[Heating]


- Fan motor's number of rotation is determined according to remote control setting.

Remote Control	O	O	O	O	O
Tab	SHi	Me+	Me	Me-	Lo

ii. Auto Fan Speed


[Cooling, Dry]

- According to room temperature and setting temperature, indoor fan speed is determined automatically.
- The indoor fan will operate according to pattern below.

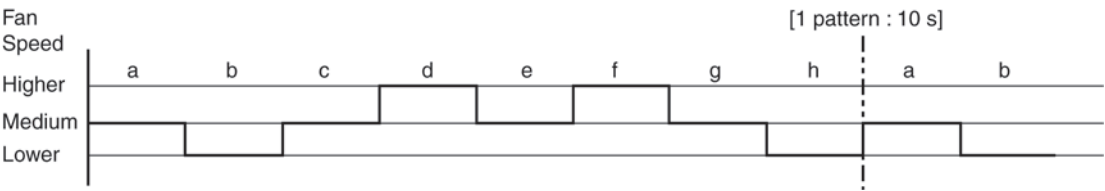

[Heating]

- According to indoor pipe temperature, automatic heating fan speed is determined as follows.

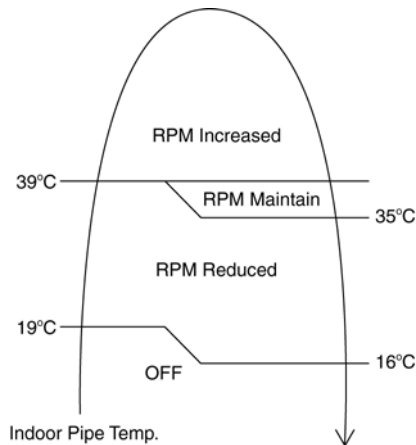


#### B. Feedback control

- Immediately after the fan motor started, feedback control is performed once every second.
- During fan motor on, if fan motor feedback  $\geq 2550$  rpm or  $< 50$  rpm continue for 10 seconds, then fan motor error counter increase, fan motor is then stop and restart. If the fan motor counter becomes 7 times, then H19 - fan motor error is detected. Operation stops and cannot on back.

### 12.3. Outdoor Fan Motor Operation

Outdoor fan motor is operated with one fan speed only. It starts when compressor starts operation and it stops 30 seconds after compressor stops operation.

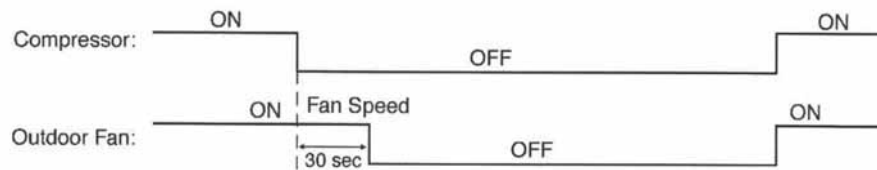

### 12.4. Airflow Direction


1. There are two types of airflow, vertical airflow (directed by horizontal vane) and horizontal airflow (directed by vertical vanes).
2. Control of airflow direction can be automatic (angles of direction is determined by operation mode, heat exchanger temperature and intake air temperature) and manual (angles of direction can be adjusted using remote control).

#### 12.4.1. Vertical Airflow

Operation Mode	Airflow Direction		Vane Angle (°)				
			1	2	3	4	5
Heating	Auto with Heat Exchanger Temperature	A	20				
		B	57 (45 : E18/21LK)				
		C	32				
	Manual		20	32	45	57	68
Cooling and Ion	Auto		20 ~ 45				
	Manual		20	26	32	37	45
Soft Dry	Auto		20 ~ 45				
	Manual		20	26	32	37	45

1. Automatic vertical airflow direction can be set using remote control; the vane swings up and down within the angles as stated above. For heating mode operation, the angle of the vane depends on the indoor heat exchanger temperature as Figure 1 below. It does not swing during fan motor stop. When the air conditioner is stopped using remote control, the vane will shift to close position.

2. Manual vertical airflow direction can be set using remote control; the angles of the vane are as stated above and the positions of the vane are as Figure 2 below. When the air conditioner is stopped using remote control, the vane will shift to close position.

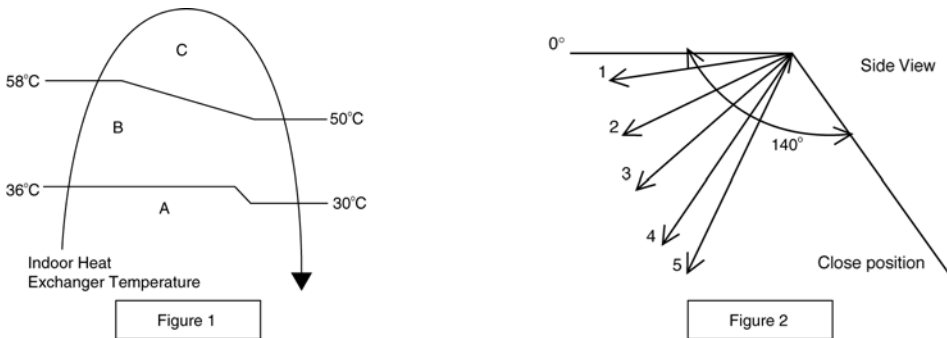

## 12.4.2. Horizontal Airflow


### 12.4.2.1. E7LK E9LK E12LK E15LK

- The horizontal airflow direction louvers can be adjusted manually by hand.

### 12.4.2.2. E18LK E21LK

1. Automatic horizontal airflow direction can be set using remote control; the vane swings left and right within the angles as stated below. For heating mode operation, the angle of the vane depends on the indoor heat exchanger temperature as Figure 1 below. It does not swing during fan motor stop.

Operation Mode		Vane Angle (°)
Heating, with heat exchanger temperature	A	68 ~ 112
	B	90
Cooling and Soft Dry		68 ~ 112

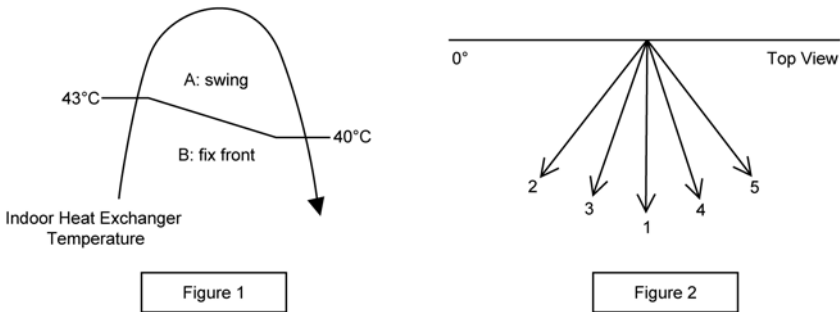

2. Manual horizontal airflow direction can be set using remote control; the angles of the vane are as stated below and the positions of the vane are as Figure 2 above.

Pattern	1	2	3	4	5
Airflow Direction Patterns at Remote Control					
Vane Angle (°)	90	68	78	102	112



## 12.5. Quiet operation (Cooling Mode/Cooling area of Dry Mode)

### A. Purpose

To provide quiet cooling operation compare to normal operation.

### B. Control condition

#### a. Quiet operation start condition

- When "Quiet" button at remote control is pressed.  
Quiet LED illuminates.

#### b. Quiet operation stop condition

1. When one of the following conditions is satisfied, quiet operation stops:
  - a. Powerful button is pressed.
  - b. Stop by OFF/ON switch.
  - c. Timer "off" activates.
  - d. Quiet button is pressed again.
  - e. Eco Patrol button is pressed.
  - f. Mild Dry Cooling button is pressed.
2. When quiet operation is stopped, operation is shifted to normal operation with previous setting.
3. When fan speed is changed, quiet operation is shifted to quiet operation of the new fan speed.
4. When operation mode is changed, quiet operation is shifted to quiet operation of the new mode.
5. During quiet operation, if timer "on" activates, quiet operation maintains.
6. After off, when on back, quiet operation is not memorised.

### C. Control contents

1. Auto fan speed is changed from normal setting to quiet setting of respective fan speed.  
This is to reduce sound of Hi, Me, Lo for 3dB (some models more than 3dB).
2. Manual fan speed for quiet operation is reduced from setting fan speed.

## 12.6. Quiet operation (Heating)

### A. Purpose

To provide quiet heating operation compare to normal operation.

### B. Control condition

#### a. Quiet operation start condition

- When "Quiet" button at remote control is pressed.  
Quiet LED illuminates.

#### b. Quiet operation stop condition

1. When one of the following conditions is satisfied, quiet operation stops:
  - a. Powerful button is pressed.
  - b. Stop by OFF/ON switch.
  - c. Timer "off" activates.
  - d. Quiet button is pressed again.
  - e. Eco Patrol button is pressed.
  - f. Mild Dry Cooling button is pressed.
2. When quiet operation is stopped, operation is shifted to normal operation with previous setting.
3. When fan speed is changed, quiet operation is shifted to quiet operation of the new fan speed.
4. When operation mode is changed, quiet operation is shifted to quiet operation of the new mode, expect fan only mode.
5. During quiet operation, if timer "on" activates, quiet operation maintains.
6. After off, when on back, quiet operation is not memorised.

### C. Control contents

#### a. Fan Speed manual

- Manual fan speed for quiet operation is reduced from setting fan speed.

#### b. Fan Speed Auto

- Indoor FM RPM depends on pipe temp sensor of indoor heat exchanger.  
Fan speed is changed from normal setting to quiet setting of respective fan speed.  
This is to reduce sound of Hi, Me, Lo for 3dB.

## 12.7. Powerful Mode Operation


- When the powerful mode is selected, the internal setting temperature will shift lower up to 2°C (for Cooling/Soft Dry) or higher up to 3.5°C (for Heating) than remote control setting temperature for 20 minutes to achieve the setting temperature quickly.

## 12.8. Timer Control

- There are 2 sets of ON and OFF timer available to turn the unit ON or OFF at different preset time.
- If more than one timer had been set, the upcoming timer will be displayed and will activate in sequence.

### 12.8.1. ON Timer Control

- ON timer 1 and ON timer 2 can be set using remote control, the unit with timer set will start operate earlier than the setting time. This is to provide a comfortable environment when reaching the set ON time.
- 60 minutes before the set time, indoor (at fan speed of Lo-) and outdoor fan motor start operate for 30 seconds to determine the indoor intake air temperature and outdoor air temperature in order to judge the operation starting time.
- From the above judgment, the decided operation will start operate earlier than the set time as shown below.

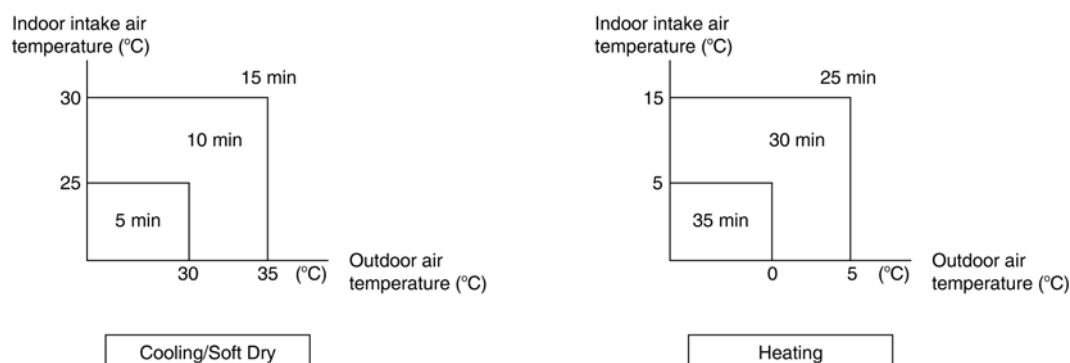

### 12.8.2. OFF Timer Control

OFF timer 1 and OFF timer 2 can be set using remote control, the unit with timer set will stop operate at set time.

## 12.9. Auto Restart Control

- When the power supply is cut off during the operation of air conditioner, the compressor will re-operate within three to four minutes (there are 10 patterns between 2 minutes 58 seconds and 3 minutes 52 seconds to be selected randomly) after power supply resumes.
- This type of control is not applicable during ON/OFF Timer setting.

## 12.10. Indication Panel


LED	POWER	TIMER	QUIET	POWERFUL	e-ion	ECO PATROL	PATROL SENSOR
Color	Green	Orange	Orange	Orange	Blue	Green	Blue
Light ON	Operation ON	Timer Setting ON	Quiet Mode ON	Powerful Mode ON	e-ion ON	Eco Patrol ON	PATROL ON
Light OFF	Operation OFF	Timer Setting OFF	Quiet Mode OFF	Powerful Mode OFF	e-ion OFF	Eco Patrol OFF	PATROL OFF

Note:

- If POWER LED is blinking, the possible operation of the unit are Hot Start, during Deice operation, operation mode judgment, or ON timer sampling.
- If Timer LED is blinking, there is an abnormality operation occurs.
- If e-ion LED is blinking, there is an abnormality of e-ion occurs.
- If PATROL LED is blinking, there is a gas sensor error detection.


## 12.11. Patrol Operation

- To monitor air dirtiness level by using Patrol sensor and to maintain air freshness by activates e-ion operation
- Patrol operation starts condition
  - When the unit operation is started with “OFF/ON” button.
  - When the unit stops, “Patrol” operation is selected, Patrol individual operation will start.
  - During cooling only operation, “Patrol” operation is selected.
- Patrol operation stops condition (when any of the following condition is fulfilled):
  - When “OFF/ON” button is selected.
  - During any operation with Patrol, “PATROL/e-ion” button is pressed.
  - When OFF Timer activates.
- To disable the Patrol Operation during unit starts (default) with “OFF/ON” button
  - Press “Set” button continuously for 15 seconds by using pointer during Air Conditioner is OFF condition to enter internal setting mode.
  - Press “Timer Decrement” button to select “Pt dFLt”.
  - Press “Timer Set” button to toggle Patrol operation default OFF/ON.
    - Long “beep”: Turn OFF Patrol operation default.
    - Short “beep”: Turn ON Patrol operation default.

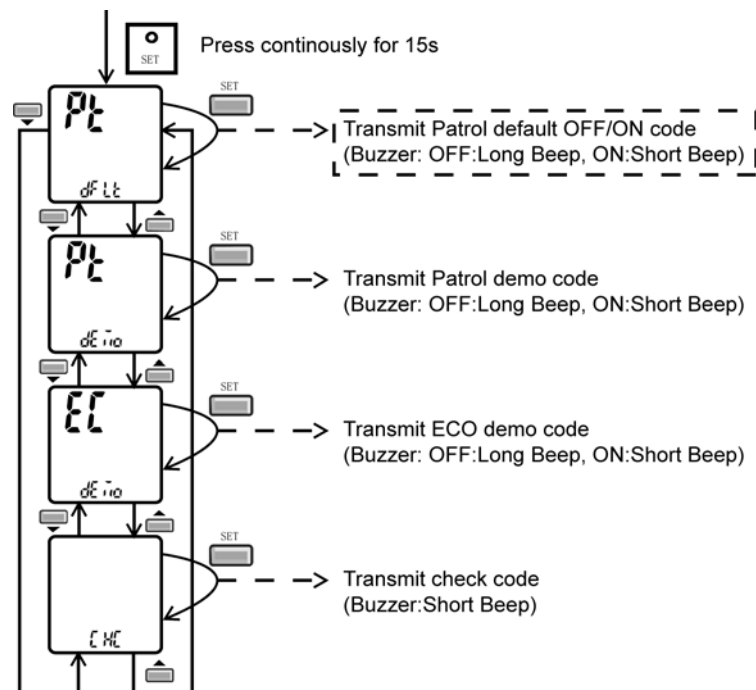

- Patrol Sensor Control

- First 2 minutes from Patrol function activates is stabilization time, during stabilization time, no air dirtiness level is monitored. The Air Dirtiness level is set to Clean.
- After that, Patrol sensor starts to record the resistance value at fixed interval. Higher resistance value indicates cleaner air.
- The air dirtiness level is monitored by comparing the current resistance value with maximum resistance value from time to time to get the Air Dirtiness Value.
- There are 3 air dirtiness level, based on the Air Dirtiness Value:
  - Air Dirtiness level 0: Clean
  - Air Dirtiness level 1: Moderate
  - Air Dirtiness level 2: Contaminated

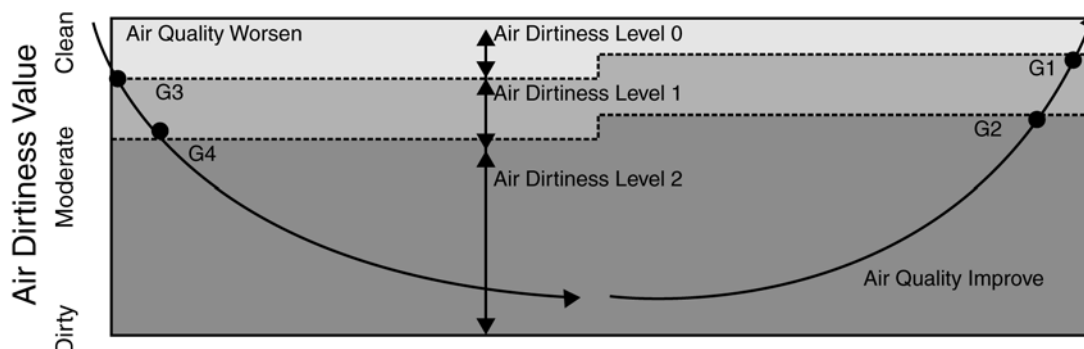

- Dirtiness level sensitivity adjustment

It is possible to change the Patrol sensor sensitivity, where the Threshold value (G1 ~ G4) will be shifted accordingly:

1. Press and release “SET” button.
2. Press Timer ▲ / Timer ▼ button to select sensitivity. (Air 1 “Low Sensitivity” ↔ Air 2 “Standard” (Default) ↔ Air 3 “High Sensitivity”)
3. Confirm setting by pressing “Timer Set” button. LCD returned to original display after 2 seconds.
4. LCD returned to original display if remote control does not operate for 30 seconds.

- e-ion Control

- e-ion operation starts condition
  - When dirtiness at level 2.
  - 2 minutes after stabilization time.
  - 4 hours at level 0.
- e-ion operation time
  - If dirtiness level improves from level 2 to level 1, the unit carries out level change after 60 seconds.
  - When dirtiness level returns to level 0 continuously for 11 minutes or more, e-ion operation stops.

- Dirtiness Level and fan speed

- When e-ion operation starts, the fan speed increases based on dirtiness level:

	Dirtiness level	rpm shift		
		Patrol individual operation	Combine operation	
			Auto	Manual
<b>e-ion ON</b>	Dirtiness level 0	No change	No change	No change
	Dirtiness level 1	Me -	+ 20	+ 1 fan tap (max - Hi)
	Dirtiness level 2	Me	+ 40	+ 2 fan tap (max - Hi)

- Indoor Fan Control
  - During any operation mode combines with Patrol operation, fan speed follows respective operation mode.
  - During Patrol individual operation if e-ion starts, only Auto Fan Speed and no Powerful operation is allowed. Even if “Fan Speed” button is pressed, no signal is sent to air conditioner, and no change on LCD display.
  - During Patrol individual operation if e-ion stops, Indoor Fan stop operation.

- Airflow direction (Horizontal, Vertical) Control

- During any operation mode combines with Patrol operation, airflow direction follows respective operation mode.
- During Patrol individual operation if e-ion starts, only Auto Air Swing is allowed. Even if “Air Swing” button is pressed, no signal is sent to air conditioner, and no change on LCD display.
- During Patrol individual operation if e-ion stops, Airflow direction louver closed.

- Indicator

- When patrol is selected, patrol sensor indicator ON.

NO	Description	BLUE	E-ION
1	When patrol is selected function is not selected	OFF	-
2	During gas sensor error detection control	OFF	OFF
3	During stop	OFF	OFF
4	2 minutes gas sensor initial stabilization time (Level 0)	ON	OFF
5	During operation During patrol	a. Dirtiness level 0*	ON
		b. Dirtiness level 1	ON
		c. Dirtiness level 1*	ON
		d. Dirtiness level 2	ON

- Remote Control Receiving Sound

- Normal Operation → Patrol Mode : Beep
- Patrol Mode → Stop : Long Beep
- Patrol Mode → Normal Operation : Beep
- Stop → Patrol : Beep

- Timer Control

- When ON timer activates when unit stops, previous operation resumes and restored last saved Patrol operation status.
- When ON timer activates during any operation, no change and carry on current operation.
- When OFF timer activates during any operation, all operation stops and the latest Patrol operation status is saved.

- Power Failure Control

- During Patrol individual operation, if power failure occurs, after power resumes, Patrol individual operation resumes immediately.
- During combination operation, if power failure occurs, after power resumes combination operation resume immediately.

## 12.12. e-ion Operation

### A. Purpose

This operation provides clean air by producing negative ions to attract dust captured at the positively charged e-ion filters.

### B. Control Condition

#### a. e-ion operation start condition

- During unit running at any operation mode, if “e-ion” operation is selected, combination operation (operation mode + e-ion operation) starts.
- During unit is OFF, if “e-ion” operation is selected, e-ion individual operation starts.

#### b. e-ion operation stop condition

- When “OFF/ON” button is pressed to stop the operation.
- When “PATROL/e-ion” button is pressed.
- When OFF Timer activates.

#### c. e-ion operation pause condition


- When indoor fan stop (during deice, odor cut control, thermostat off, etc.). e-ion operation resume after indoor fan restarts.
- When indoor intake temperature  $\geq 40^{\circ}\text{C}$ . e-ion operation resume after indoor intake temperature  $< 40^{\circ}\text{C}$  continuously for 30 minutes.

### C. Control Content

#### a. Indoor fan control

- During any operation mode combines with e-ion operation, fan speed follows respective operation mode.
- During e-ion individual operation - only Auto Fan Speed and no Powerful operation is allowed. Even if Fan Speed button is pressed, no signal is sent to air conditioner, and no change on LCD display.

Auto Fan Speed for e-ion operation switches between HLo and CLo at pattern below:

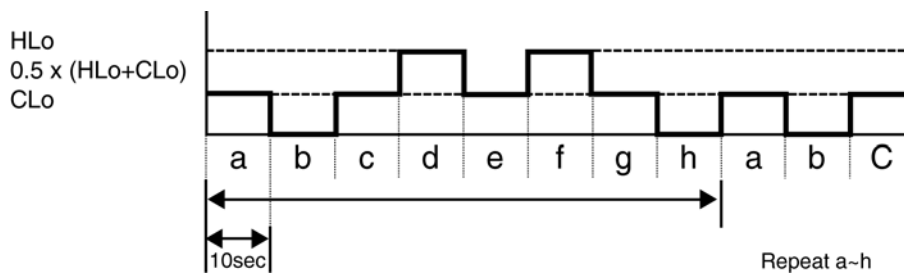

b. Airflow direction control

- During any operation mode combines with e-ion operation, airflow direction follows respective operation mode.
- During e-ion individual operation, only Auto Air Swing is allowed. Even if Air Swing button is pressed, no signal is sent to air conditioner, and no change on LCD display.

c. Timer control

- When ON timer activates when unit stops, previous operation resumes and restores last saved e-ion operation status.
- When ON timer activates during any operation, no change and carry on current operation.
- When OFF timer activates during any operation, all operation stops and the latest e-ion operation status is saved.

d. Indicator

- When e-ion operation starts, e-ion indicator ON.


e. e-ion Check Mode

- e-ion abnormality check mode
- Purpose is to improve sensor serviceability when sensor is malfunction.

1. Control starting condition

When all of the conditions are formed

- Not in Patrol Demo mode.
- e-ion operation mode ON.
- When e-ion check mode signal is received; the procedure of selection is as shown:
  - Press "Set" button continuously for 15 seconds by using pointer to enter internal setting mode.
  - Press "Timer Decrement" button to select "CHC".
  - Confirm setting by pressing "Timer Set" button, a "beep" sound will be heard.

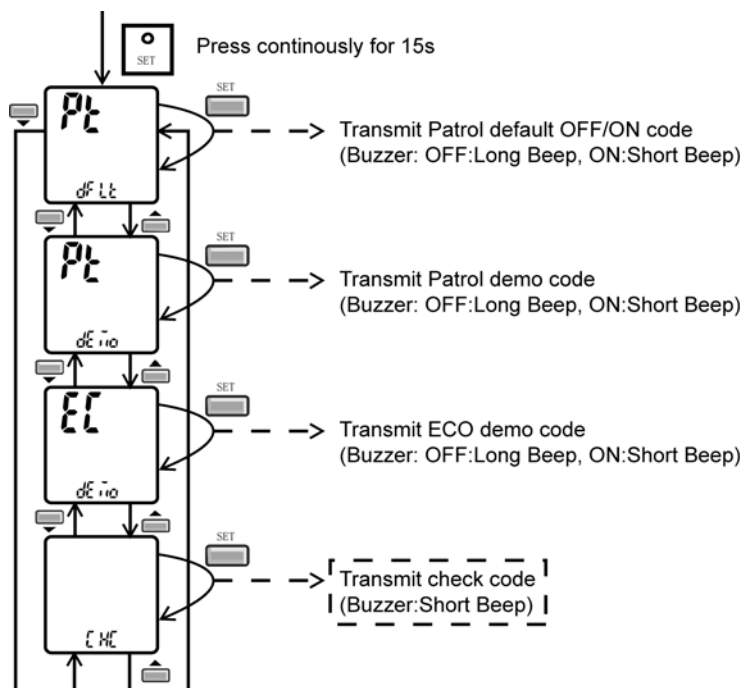

- If abnormal discharge is detected at filter (short-circuited) due to water or dust adhesion, etc., the e-ion indicator blinks immediately.

f. Power failure

- During e-ion individual operation, if power failure occurs, after power resumes, e-ion individual operation resumes immediately.
- During combination operation, if power failure occurs, after power resumes, combination operation resume immediately.

g. Error Detection Control

When e-ion indicator blink, it indicates error listed below:

i. e-ion Air Purifying system main connector to PCB is open:

Judgement Method

- During e-ion operation (include during Patrol operation), e-ion Air Purifying system main connector to PCB is opened.

Troubleshooting Methods

- Connect the connector or stop operation (include during Patrol operation) to cancel the blinking.

ii. Abnormal Discharge

Judgement Method

- During e-ion operation, when feedback voltage is -Lo (at microcontroller) is detected, it is judged abnormal discharge and stops power supplies to the e-ion Air Purifying system.
- The unit retries after 30 minutes and repeat for 24 times. (not applicable for e-ion Check Mode)

Troubleshooting Method

- Press "PATROL/e-ion" button or "OFF/ON" button to stop the operation and check the e-ion Air Purifying system main connector to PCB.
- After that, press "e-ion" button again to confirm the e-ion indicator not blinking.
- The 24 times counter will be clear after 10 minutes of normal operation or when operation stops.

Error Reset Method

- Press "OFF/ON" button to OFF the operation.
- Press AUTO OFF/ON button at indoor unit to OFF the operation.
- OFF Timer activates.
- Power supply reset.

iii. e-ion breakdown

Judgement Method

- When hi-feedback voltage (at microcontroller) supplied to filter during e-ion stop, due to PCB or filter's high voltage power supply damage.
- Operations except e-ion continue. Both Timer indicator and e-ion indicator blink.

Troubleshooting Method


- Press "PATROL/e-ion" button or "OFF/ON" button to stop the operation.
- Change main circuit board or filter's high voltage power supply.
- When lo-feedback voltage supplied to e-ion Air Purifying system during e-ion operation, e-ion indicator and Timer indicator stop blinking.

## 12.13. Mild Dry Cooling Operation

- This operation helps to prevent decreases in room humidity while maintaining the setting temperature.
- During unit running at Cooling operation mode, if "Mild Dry Cooling" button is pressed, Mild Dry Cooling operation starts and Mild Dry Cooling indicators turns ON at remote control display.
- Mild dry cooling operation is unavailable when the unit is operating Auto mode, Soft Dry mode, Patrol individual operation or e-ion individual operation.
- Mild dry cooling operation is cancelled when the unit turned OFF, Mild Dry Cooling button is pressed again or when the operation mode changed from Cooling to other mode.
- Eco Patrol, Powerful, Quiet and Mild Dry Cooling mode cannot function at the same time, the unit will follows the operation according to the last signal received.
- During this operation, the compressor frequency changes according to operating condition to prevent room humidity decreases and when AUTO AIR SWING is set, the vertical airflow direction fixed at lower limit position.

## 12.14. ECO Patrol Operation

- A Pyoelectric infrared sensor is used to detect injection strength variation of infrared at setting area to determine the presence or absence of human and its activity level. Human detection area is shown in figure below:

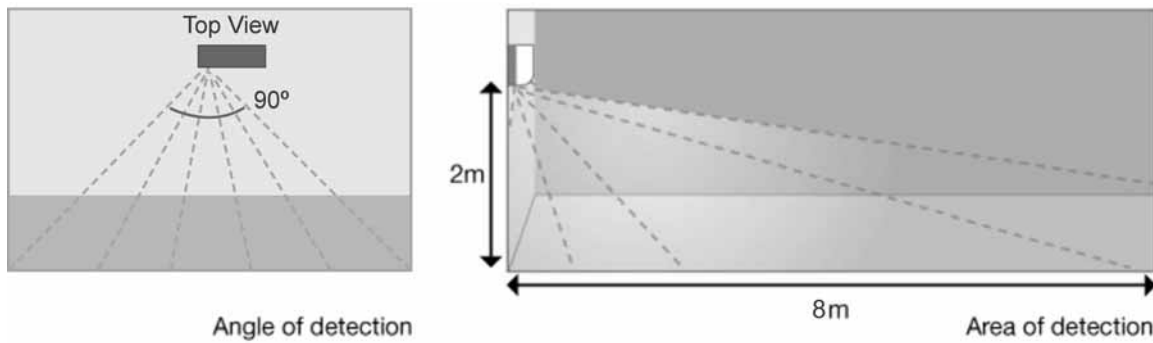


- ECO Patrol operation - Human presence/absence detection outlined flow
  - Process infrared sensor output signal
  - Human detection (movement) every 3 seconds.
  - ▼
  - Human detection records
    - Records human detection (movement) result for 30 seconds and determine its activity level i.e. Hi/Lo.
  - ▼
  - Presence / absence detection
    - Compares current and previous human detection result every 30 seconds to determine the presence or absence of human.
  - ▼
  - Presence / absence determination
    - Based on human presence / absence detection, if human presence detection showed within 30 minutes, it is recognised that human is present. If human absence detection showed continuously for more than 30 minutes, it is recognised that no human is present.
- ECO Patrol Sensor abnormality detection
  - Connector pulled out (disconnected), Wire cut Abnormality (Fix Output at Hi)
    - Abnormal judgment start condition.
      - Start from ECO Patrol Sensor power ON, and end after 30 seconds.
    - Control content.
      - Judge ECO Patrol Sensor power level every 100ms.
    - Abnormal Judgment condition.
      - When ECO Patrol Sensor has continues for 25 seconds Hi level.
  - Circuit Abnormal (Fix Output Lo)
    - Abnormal judgment start condition.
      - After ECO Patrol Sensor unit power ON, and after pressed 70 seconds.
    - Control content.
      - Judge ECO Patrol Sensor power level every 100ms.
    - Abnormal Judgment condition.
      - When ECO Patrol Sensor has continues at Lo level for 25 seconds.
  - Abnormal treatment
    - Any one of the above self-diagnosis result is abnormal
    - Abnormal counter +1 and ECO Patrol Sensor power supply OFF.
    - After ECO Patrol Sensor unit power is OFF for 5 seconds, Retry the ECO Patrol operation.
    - When Abnormal counter reach 4 counts, ECO Patrol sensor abnormality is confirmed.
      - (Abnormal counter is cleared when sensor power ON and maintain normal for 120 seconds and above or Clear Anormal counter by power reset)
    - Save ECO Patrol Sensor Abnormality H59 (no Timer LED blinking).
    - ECO Patrol Sensor operation OFF, but ECO Patrol LED maintain ON.
    - The unit still operate as normal.
    - Sensor error counter can be cleared only after power supply reset or AC Reset button on the remote control is pressed.



- ECO Patrol Demo Mode

- Press "Set" button continuously for 15 seconds by using pointer during Air Conditioner is OFF condition to enter internal setting mode.
- Press "Timer Decrement" button to select "EC demo".
- Press "Timer Set" button to toggle ECO Patrol Demo mode.
  - Short "beep": Turn ON ECO Patrol Demo mode.
  - Long "beep": Turn OFF ECO Patrol Demo mode.

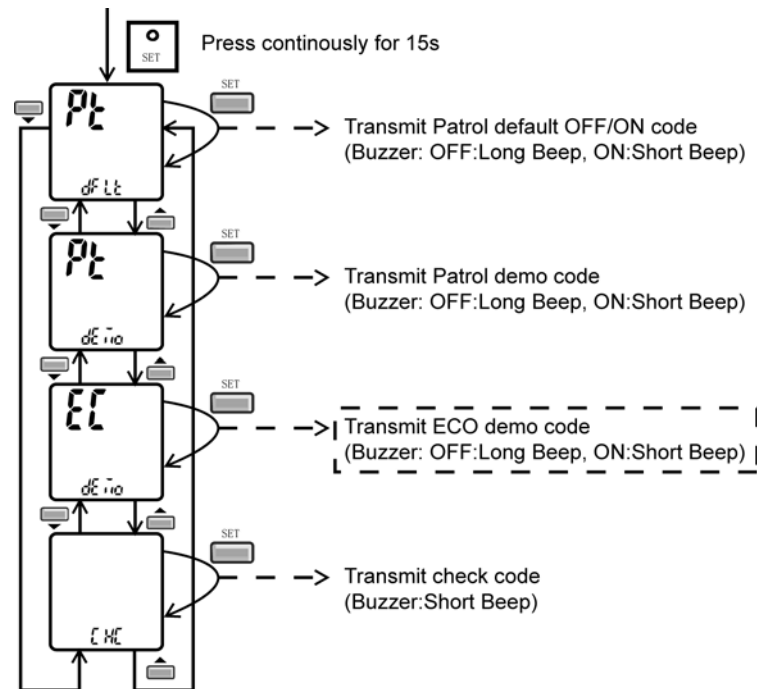

Control details:

- During ECO Patrol Demo mode, operation LED ON and horizontal vane will set to Auto Swing.
- When Hi activity judge, Fan speed change to Hi Fan and ECO Patrol LED ON.
- When Lo activity judge, Fan speed change to Lo Fan and ECO Patrol LED OFF.
- No setting temperature adjustment.
- During ECO Patrol operation, the internal setting temperature and fan speed are adjusted in order to provide comfort and energy saving.
- ECO Patrol Start condition.
  - Press ECO Patrol button to select ECO1 and ECO2.
- ECO Patrol Stop condition.
  - Press ECO Patrol button again.
  - OFF Timer activates.
  - Press OFF/ON button to turn off the air conditioner.
  - Press AUTO OFF/ON button to turn off the air conditioner.
  - Press POWERFUL/QUIET button.
  - Press Mild Dry Cooling button.
- ECO Patrol operation could ON when any of the following conditions is fulfilled:
- During forced cooling or forced heating operation.
- During e-ion or individual patrol operation.
- 
- Power Failure
  - ECO Patrol operation will be resuming after recovered from power failure.
- Timer Operation
  - When unit is turn on by ON Timer and ECO Patrol operation is ON during previous operation before OFF, ECO Patrol operation will not be ON automatically.
  - When unit is turn on by ON Timer and ECO Patrol operation is OFF during previous operation before OFF, ECO Patrol operation will not be ON automatically.

• Other Information

- ECO Patrol, Powerful, Quiet and Mild Dry Cooling cannot be operated at the same time.
- ECO Patrol sensor initialized time is 70 seconds from power supplied to ECO Patrol sensor, or 70 seconds from the operation start.

• ECO 1 Cooling/Soft Dry Operation

Activity Level	Low	High	None
Set Temperature		-1°C	+2°C
Fan Speed	Set Speed	+1tap Up	Set Speed
			Med Fan

• ECO 2 Cooling/Soft Dry Operation

Activity Level	Low	High	None
Set Temperature		-1°C	+3°C
Fan Speed	Set Speed	+1tap Up	Set Speed
			Med Fan

• ECO 1 Heating Operation

Activity Level	Low	High	None
Set Temperature		-1°C	-2°C
Fan Speed	Set Speed	Set Speed	Set Speed

• ECO 2 Heating Operation


Activity Level	Low	High	None
Set Temperature		-1°C	-3°C
Fan Speed	Set Speed	Set Speed	Set Speed

- Purpose is to improve sensor serviceability when sensor is malfunction.

#### 1. Control starting condition

When all of the conditions are formed

- Not in ECO Patrol Demo mode.
- ECO Patrol mode ON.
- When ECO Patrol sensor check mode signal is received; the procedure of selection is as shown:
  - Press "Set" button continuously for 15 seconds by using pointer to enter internal setting mode.
  - Press "Timer Decrement" button to select "CHC".
  - Confirm setting by pressing "Timer Set" button, a "beep" sound will be heard.

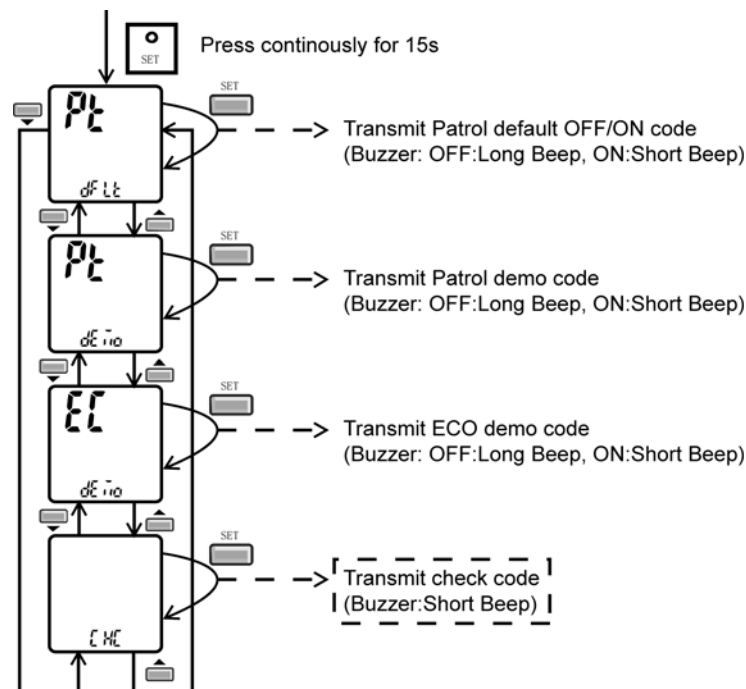

#### 2. Control ending condition.

When any of the conditions are formed

- Operation stops.
- "Timer Cancel" button pressed.
- When ECO Patrol sensor check mode signal is not received for more than 30 seconds.

#### 3. Control content.

- During ECO Patrol mode ON, when check signal is received, if (1) or (2) is detected.
  - ECO Patrol LED start blinking (ECO Patrol sensor operation stops but the unit operates as normal) and ECO Patrol sensor abnormal code is memorized (the 4 times counter is ignored)
- The blinking of ECO Patrol LED can be cancelled by pressing ECO Patrol button again.
- Sensor error counter can be cleared only after power supply reset or "AC Reset" button on remote control is pressed.

However, if there is no ECO Patrol sensor abnormally happen, ECO Patrol sensor operation will continues as normal.

# 13 Operation Control (For Multi Split Connection)

During multi split connection, indoor unit's operation controls are same with single split connection unless specified in this chapter.

## 13.1. Cooling operation

### 13.1.1. Thermostat control

- Capability supply to indoor unit is OFF (Expansion valve closed) when Intake Air Temperature — Internal setting temperature  $< -2.0^{\circ}\text{C}$
- Capability resume supply to indoor unit after waiting for 3 minutes, if the Intake Air temperature — Internal setting temperature  $>$  Capability supply OFF point.

## 13.2. Soft Dry Operation

### 13.2.1. Thermostat control

- Capability supply to indoor unit is OFF (Expansion valve closed) when Intake Air Temperature — Internal setting temperature  $< -3.0^{\circ}\text{C}$
- Capability resume to indoor unit after waiting for 3 minutes, if the Intake Air temperature — Internal setting temperature  $>$  Capability supply OFF point.

## 13.3. Heating Operation

### 13.3.1. Thermostat control


- Capability supply to indoor unit is OFF (Expansion valve closed) when Intake Air Temperature — Internal setting temperature  $> +1.0^{\circ}\text{C}$
- During this condition, the indoor fan is stopped if compressor is ON.
- Capability resume supply to indoor unit after waiting for 3 minutes, if the Intake Air Temperature — Internal setting temperature  $<$  Capability supply OFF point.

### 13.3.2. Temperature Sampling Control

- Temperature sampling is controlled by outdoor unit where room temperature for all power supply ON indoor unit could be obtained.
- When capability supply to the indoor unit is OFF and the compressor is ON, the indoor fan motor is stopped. During this condition, 15 seconds after sampling signal from outdoor unit is received, the indoor fan start operation at low fan speed.
- However, within first 4 minutes of capability stopped supply to the indoor unit, even sampling signal is received, the sampling control is cancelled.

## 13.4. Automatic Operation

- This mode can be set using remote control and the operation is decided by remote control setting temperature, remote control operation mode, indoor intake and outdoor air temperature.
- During operation mode judgment, indoor fan motor (with speed of -Lo) and outdoor fan motor are running for 30 seconds to detect the indoor intake and outdoor air temperature. The operation mode is decided based on below chart.

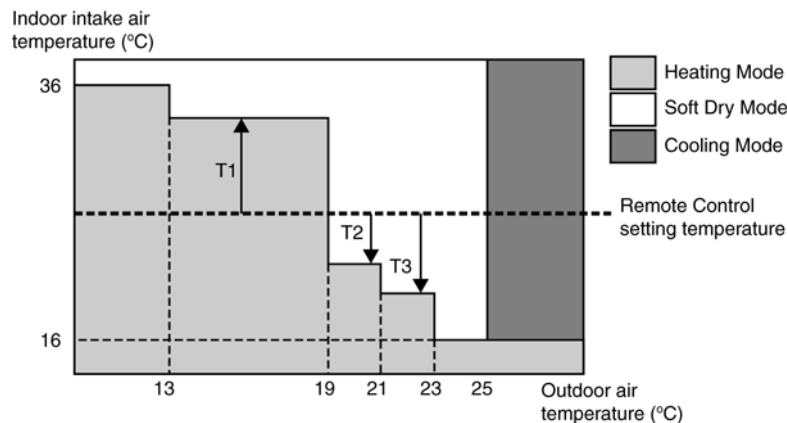

- Every 180 minutes, the indoor and outdoor temperature is judge. Based on remote control setting temperature, the value of T1 will increase up to  $10^{\circ}\text{C}$ , T2 will decrease by  $3^{\circ}\text{C}$  and T3 will decrease up to  $8^{\circ}\text{C}$ .

## 13.5. Indoor Fan Motor Operation

### 13.5.1. Residual Heat Removal Control

- To prevent high pressure at indoor unit, when heating mode thermostat-off condition or power supply OFF, indoor fan continue to operate at controlled fan speed for maximum 30 seconds then stop.

## 13.6. Powerful Mode Operation

- When the power mode is selected, the internal setting temperature will shift lower up to 4°C for Cooling/Soft Dry or higher up to 6°C for heating than remote control setting temperature, the powerful operation continue until user cancel the Powerful operation by pressing powerful button again.

## 13.7. Auto restart control

- When the power supply is cut off during the operation of air conditioner, the compressor will re-operate between three to four minutes (10 patterns to be selected randomly) after power resume.
- During multi split connection, Indoor unit will resume previous mode, include unit standby mode.

## 13.8. Indication Panel

LED	POWER	TIMER	QUIET	POWERFUL	e-ion	ECO PATROL	PATROL SENSOR
Color	Green	Orange	Orange	Orange	Blue	Green	Blue
Light ON	Operation ON	Timer Setting ON	Quiet Mode ON	Powerful Mode ON	e-ion ON	Eco Patrol ON	PATROL ON
Light OFF	Operation OFF	Timer Setting OFF	Quiet Mode OFF	Powerful Mode OFF	e-ion OFF	Eco Patrol OFF	PATROL OFF

Note:

- If POWER LED is blinking (0.5 seconds ON, 0.5 second OFF), the possible operation of the unit are during Indoor Residual Heat Removal, Hot Start, during Deice operation, operation mode judgment, or ON timer sampling.
- If POWER LED is blinking (2.5 seconds ON, 0.5 second OFF), the unit is in standby mode.
- If TIMER LED is blinking, there is an abnormality operation occurs.
- If e-ion LED is blinking, there is an abnormality of e-ion occurs.
- If PATROL LED is blinking, there is a gas sensor error detection.

## 13.9. Mild Dry Cooling Operation

- During multi split connection, Mild Dry Cooling Operation is disabled.

# 14 Protection Control

## 14.1. Protection Control For All Operations

### 14.1.1. Restart Control (Time Delay Safety Control)

- The Compressor will not turn on within 3 minutes from the moment operation stops, although the unit is turned on again by pressing OFF/ON button at remote control within this period.
- This control is not applicable if the power supply is cut off and on again.
- This phenomenon is to balance the pressure inside the refrigerant cycle.

### 14.1.2. 30 Seconds Forced Operation


- Once the air conditioner is turned on, the compressor will not stop within 30 seconds in a normal operation although the intake air temperature has reached the thermo-off temperature. However, force stop by pressing the OFF/ON button at the remote control is permitted or the Auto OFF/ON button at indoor unit.
- The reason for the compressor to force operation for minimum 30 seconds is to allow the refrigerant oil run in a full cycle and return back to the outdoor unit.

### 14.1.3. Total Running Current Control

1. When the outdoor unit total running current (AC) exceeds X value, the frequency instructed for compressor operation will be decreased.
2. If the running current does not exceed X value for 5 seconds, the frequency instructed will be increased.
3. However, if total outdoor unit running current exceeds Y value, compressor will be stopped immediately for 3 minutes.

Model	E7LK		E9LK		E12LK		E15LKE		E18LK		E21LK	
Operation Mode	X (A)	Y (A)	X (A)	Y (A)	X (A)	Y (A)	X (A)	Y (A)	X (A)	Y (A)	X (A)	Y (A)
Cooling/Soft Dry (A)	3.95	15.0	4.54	15.0	6.86	15.0	9.0	15.0	10.7	15.0	11.0	15.0
Cooling/Soft Dry (B)	3.6	15.0	4.12	15.0	6.35	15.0	8.5	15.0	7.7	15.0	9.6	15.0
Heating	4.37	15.0	5.57	15.0	8.03	15.0	9.8	15.0	10.7	15.0	11.5	15.0

4. The first 30 minutes of cooling operation, (A) will be applied.

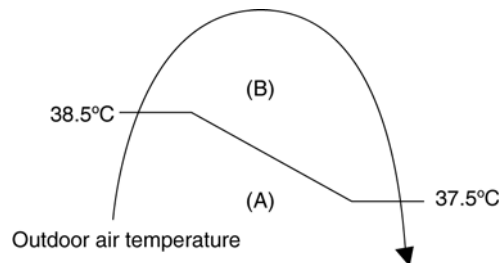

### 14.1.4. IPM (Power transistor) Prevention Control

#### A. Overheating Prevention Control


1. When the IPM temperature rises to 120°C (E7~15LK) and 110°C (E18~21LK), compressor operation will stop immediately.
2. Compressor operation restarts after 3 minutes the temperature decreases to 110°C (E7~15LK) and 95°C (E18~21LK).
3. If this condition repeats continuously 4 times within 20 minutes, timer LED will be blinking ("F96" is indicated).

#### B. DC Peak Current Control

1. When electric current to IPM exceeds set value of 18.5 A (E7 ~ 15LK) and 30.0 ± 5.0A (E18 ~ 21LK), the compressor will stop operate. Then, operation will restart after 3 minutes.
2. If the set value is exceeded again more than 30 seconds after the compressor starts, the operation will restart after 2 minutes.
3. If the set value exceeded again within 30 seconds after the compressor starts, the operation will restart after 1 minute. If this condition repeats continuously for 7 times, all indoor and outdoor relays will be cut off, timer LED will be blinking ("F99" is indicated).

### 14.1.5. Compressor Overheating Prevention Control

- Instructed frequency for compressor operation will be regulated by compressor discharge temperature. The changes of frequency are as below.
- If compressor discharge temperature exceeds 107°C (E7 ~ E15LK) and 112°C (E18 ~ E21LK), compressor will be stopped, occurs 4 times per 20 minutes, timer LED will be blinking. ("F97" is indicated.)

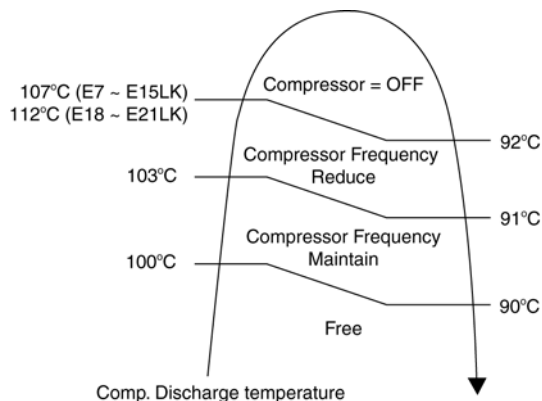

### 14.1.6. Low Pressure Prevention Control (Gas Leakage Detection)

- Control start conditions
  - For 5 minutes, the compressor continuously operates and outdoor total current is between 0.65A and 1.65A.
  - During Cooling and Soft Dry operations:  
Indoor suction temperature - indoor piping temperature is below 4°C.
  - During Heating operations :  
Indoor piping temperature - indoor suction is under 5°C.
- Control contents
  - Compressor stops (and restart after 3 minutes).
  - If the conditions above happen 2 times within 20 minutes, the unit will:
    - Stop operation
    - Timer LED blinks and "F91" indicated.

### 14.1.7. Low Frequency Protection Control 1

- When the compressor operate at frequency lower than 24 Hz continued for 20 minutes, the operation frequency will be changed to 23 Hz for 2 minutes.

### 14.1.8. Low Frequency Protection Control 2


- When all the below conditions comply, the compressor frequency will change to lower frequency.

Temperature, T, for:	Cooling/Soft Dry	Heating
Indoor intake air (°C)	$T < 15$ or $T \geq 30$	—
Outdoor air (°C)	$T < 16$ or $T \geq 38$	$T < 4$ or $T \geq 24$
Indoor heat exchanger (°C)	$T < 30$	$T \geq 0$

## 14.2. Protection Control For Cooling & Soft Dry Operation

### 14.2.1. Outdoor Air Temperature Control

- The compressor operating frequency is regulated in accordance to the outdoor air temperature as shown in the diagram below.
- This control will begin 1 minute after the compressor starts.
- Compressor frequency will adjust base on outdoor air temperature.

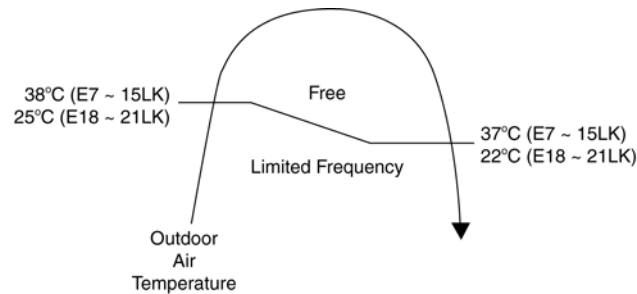

### 14.2.2. Cooling Overload Control

- Detects the Outdoor pipe temperature and carry out below restriction/limitation (Limit the compressor Operation frequency).
- The compressor stop if outdoor pipe temperature exceeds 61°C (E7 ~ 15LK) and 63°C (E18 ~ 21LK).
- If the compressor stops 4 times in 20 minutes, Timer LED blinking (F95 indicated: outdoor high pressure rise protection).

### 14.2.3. Freeze Prevention Control 1

1. When indoor heat exchanger temperature is lower than 0°C continuously for 6 minutes, compressor will stop operating.
2. Compressor will resume its operation 3 minutes after the indoor heat exchanger is higher than 5°C.
3. At the same time, indoor fan speed will be higher than during its normal operation.
4. If indoor heat exchanger temperature is higher than 5°C for 5 minutes, the fan speed will return to its normal operation.

### 14.2.4. Freeze Prevention Control 2

1. Control start conditions
  - During Cooling operation and soft dry operation
    - During thermo OFF condition, indoor intake temperature is less than 10°C or
    - Compressor stops for freeze prevention control
  - Either one of the conditions above occurs 5 times in 60 minutes.
2. Control contents
  - Operation stops
  - Timer LED blinks and "H99" indicated

### 14.2.5. Dew Prevention Control 1

- To prevent dew formation at indoor unit discharge area.
- This control will be activated if:
  - Outdoor air temperature and Indoor pipe temperature judgment by microcontroller is fulfilled.
  - When Cooling or Dry mode is operated more than 20 minutes or more.
- This control stopped if:
  - Compressor stopped.
  - Remote control setting changed (fan speed / temperature).
  - Outdoor air temperature and indoor intake temperature changed.
- Fan speed, angle of louver (vertical airflow angle) will be adjusted accordingly in this control.
  - Fan speed will be increased slowly if the unit is in quiet mode but no change in normal cooling mode.



### 14.2.6. Dew Prevention Control 2

- To prevent dew formation at indoor unit discharge area.
- This control starts if all conditions continue for 20 minutes:
  - Operated with Cooling or Soft Dry Mode.
  - Indoor intake temperature is between 25°C and 29°C.
  - Outdoor air temperature is less than 30°C.
  - Quiet Lo fan speed.
- This control stopped if:
  - When receive air swing change signal from Remote Control.
- The horizontal louver will be fixed at 26° (regardless of Auto or Manual Airflow Direction Setting).
- The vertical louver will be fixed front.

### 14.2.7. Odor Cut Control

- To reduce the odor released from the unit.
  - Start Condition
    - AUTO FAN Speed is selected during COOL or DRY operation.
    - During freeze prevention control and timer preliminary operation, this control is not applicable.
  - Control content
    - Depends on compressor conditions:
      1. Compressor OFF → Compressor ON.  
The indoor unit fan stops temporarily and then starts to blow at minimum airflow for 30 seconds.
      2. Compressor ON → Compressor OFF.  
The indoor unit fan stops for 90 seconds and then blows at minimum airflow for 20 seconds.


## 14.3. Protection Control For Heating Operation

### 14.3.1. Intake Air Temperature Control

Compressor will operate at limited freq., if indoor intake air temperature is 30°C or above.


### 14.3.2. Outdoor Air Temperature Control

- The Max current value is regulated when the outdoor air temperature rise above 16°C (E7 ~ 15LK) and 14°C (E18 ~ 21LK) in order to avoid compressor overloading.

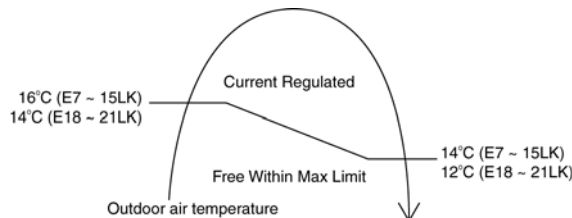

### 14.3.3. Overload Protection Control

- The compressor operating frequency is regulated in accordance to indoor heat exchanger temperature as shown below.
- If the heat exchanger temperature exceeds 60°C, compressor will stop.

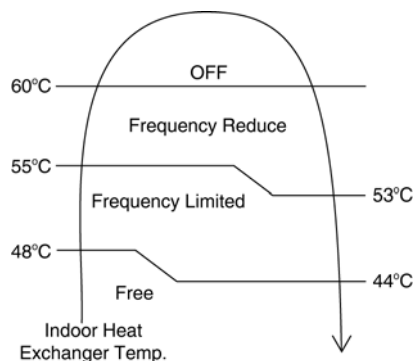

#### **14.3.4. Low Temperature Compressor Oil Return Control (E7 ~ 15LK)**

- In heating operation, if the outdoor temperature falls below -10°C when compressor starts, the compressor frequency will be regulated up to 600 seconds.

#### **14.3.5. Cold Draught Prevention Control**


- When indoor pipe temperature is low, cold draught operation starts where indoor fan speed will be reduced.

#### **14.3.6. Deice Operation**

- When outdoor pipe temperature and outdoor air temperature is low, deice operation start where indoor fan motor and outdoor fan motor stop and operation LED blinks.

# 15 Servicing Mode

## 15.1. Auto OFF/ON Button

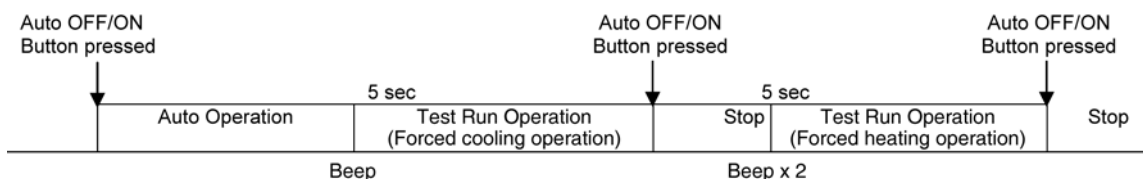


### 1. AUTO OPERATION MODE

The Auto operation will be activated immediately once the Auto OFF/ON button is pressed. This operation can be used to operate air conditioner with limited function if remote control is misplaced or malfunction.

### 2. TEST RUN OPERATION (FOR PUMP DOWN/SERVICING PURPOSE)

The Test Run operation will be activated if the Auto OFF/ON button is pressed continuously for more than 5 seconds. A “beep” sound will heard at the fifth seconds, in order to identify the starting of Test Run operation (Forced cooling operation). Within 5 minutes after Forced cooling operation start, the Auto OFF/ON button is pressed for more than 5 seconds. A 2 “beep” sounds will heard at the fifth seconds, in order to identify the starting of Forced heating operation.

The Auto OFF/ON button may be used together with remote control to set / change the advance setting of air conditioner operation.

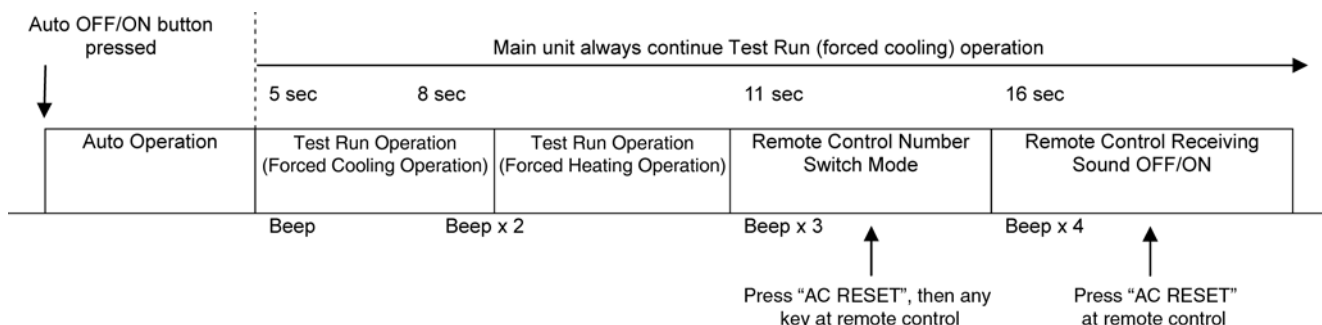

### 3. REMOTE CONTROL NUMBER SWITCH MODE

The Remote Control Number Switch Mode will be activated if the Auto OFF/ON button is pressed continuously for more than 11 seconds (3 “beep” sounds will occur at 11th seconds to identify the Remote Control Number Switch Mode is in standby condition) and press “AC RESET” button and then press any button at remote control to transmit and store the desired transmission code to the EEPROM.

There are 4 types of remote control transmission code could be selected and stored in EEPROM of indoor unit. The indoor unit will only operate when received signal with same transmission code from remote control. This could prevent signal interference when there are 2 or more indoor units installed nearby together.

To change remote control transmission code, short or open jumpers at the remote control printed circuit board.

Remote Control Printed Circuit Board		
Jumper A (J1)	Jumper B (D2)	Remote Control No.
Short	Open	A (Default)
Open	Open	B
Short	Short	C
Open	Short	D

- During Remote Control Number Switch Mode, press any button at remote control to transmit and store the transmission code to the EEPROM.

#### 4. REMOTE CONTROL RECEIVING SOUND OFF/ON MODE

The Remote Control Receiving Sound OFF/ON Mode will be activated if the Auto OFF/ON button is pressed continuously for more than 16 seconds (4 "beep" sounds will occur at 16th seconds to identify the Remote Control Receiving Sound Off/On Mode is in standby condition) and press "AC Reset" button at remote control.

Press "Auto OFF/ON button" to toggle remote control receiving sound.

- Short "beep": Turn OFF remote control receiving sound.
- Long "beep": Turn ON remote control receiving sound.

After Auto OFF/ON Button is pressed, the 20 seconds counter for Remote Control Receiving Sound OFF/ON Mode is restarted.

## 15.2. Remote Control Button

### 15.2.1. SET BUTTON

- To check remote control transmission code and store the transmission code to EEPROM
  - Press "SET" button continuously for 10 seconds by using pointer.
  - Press "TIMER SET" button until a "beep" sound is heard as confirmation of transmission code changed.
- To change the air quality sensor sensitivity
  - Press and release by using pointer.
  - Press the Timer Decrement button to select sensitivity:
    1. Low Sensitivity
    2. Standard (Default)
    3. Hi Sensitivity
  - Confirm setting by pressing Timer Set button, a "Beep" sound will be heard. LCD returns to original display after 2 seconds.
  - LCD returns to original display if remote control does not operate for 30 seconds.

### 15.2.2. RESET (RC)

- To clear and restore the remote control setting to factory default
  - Press once to clear the memory.

### 15.2.3. RESET (AC)

- To restore the unit's setting to factory default
  - Press once to restore the unit's setting.

### 15.2.4. TIMER ▲

- To change indoor unit indicator's LED intensity
  - Press continuously for 5 seconds.

### 15.2.5. TIMER ▼

- To change remote control display from Degree Celsius (°C) to Degree Fahrenheit (°F).
  - Press continuously for 10 seconds.

# 16 Troubleshooting Guide


## 16.1. Refrigeration Cycle System

In order to diagnose malfunctions, make sure that there are no electrical problems before inspecting the refrigeration cycle. Such problems include insufficient insulation, problem with the power source, malfunction of a compressor and a fan. The normal outlet air temperature and pressure of the refrigeration cycle depends on various conditions, the standard values for them are shown in the table on the right.







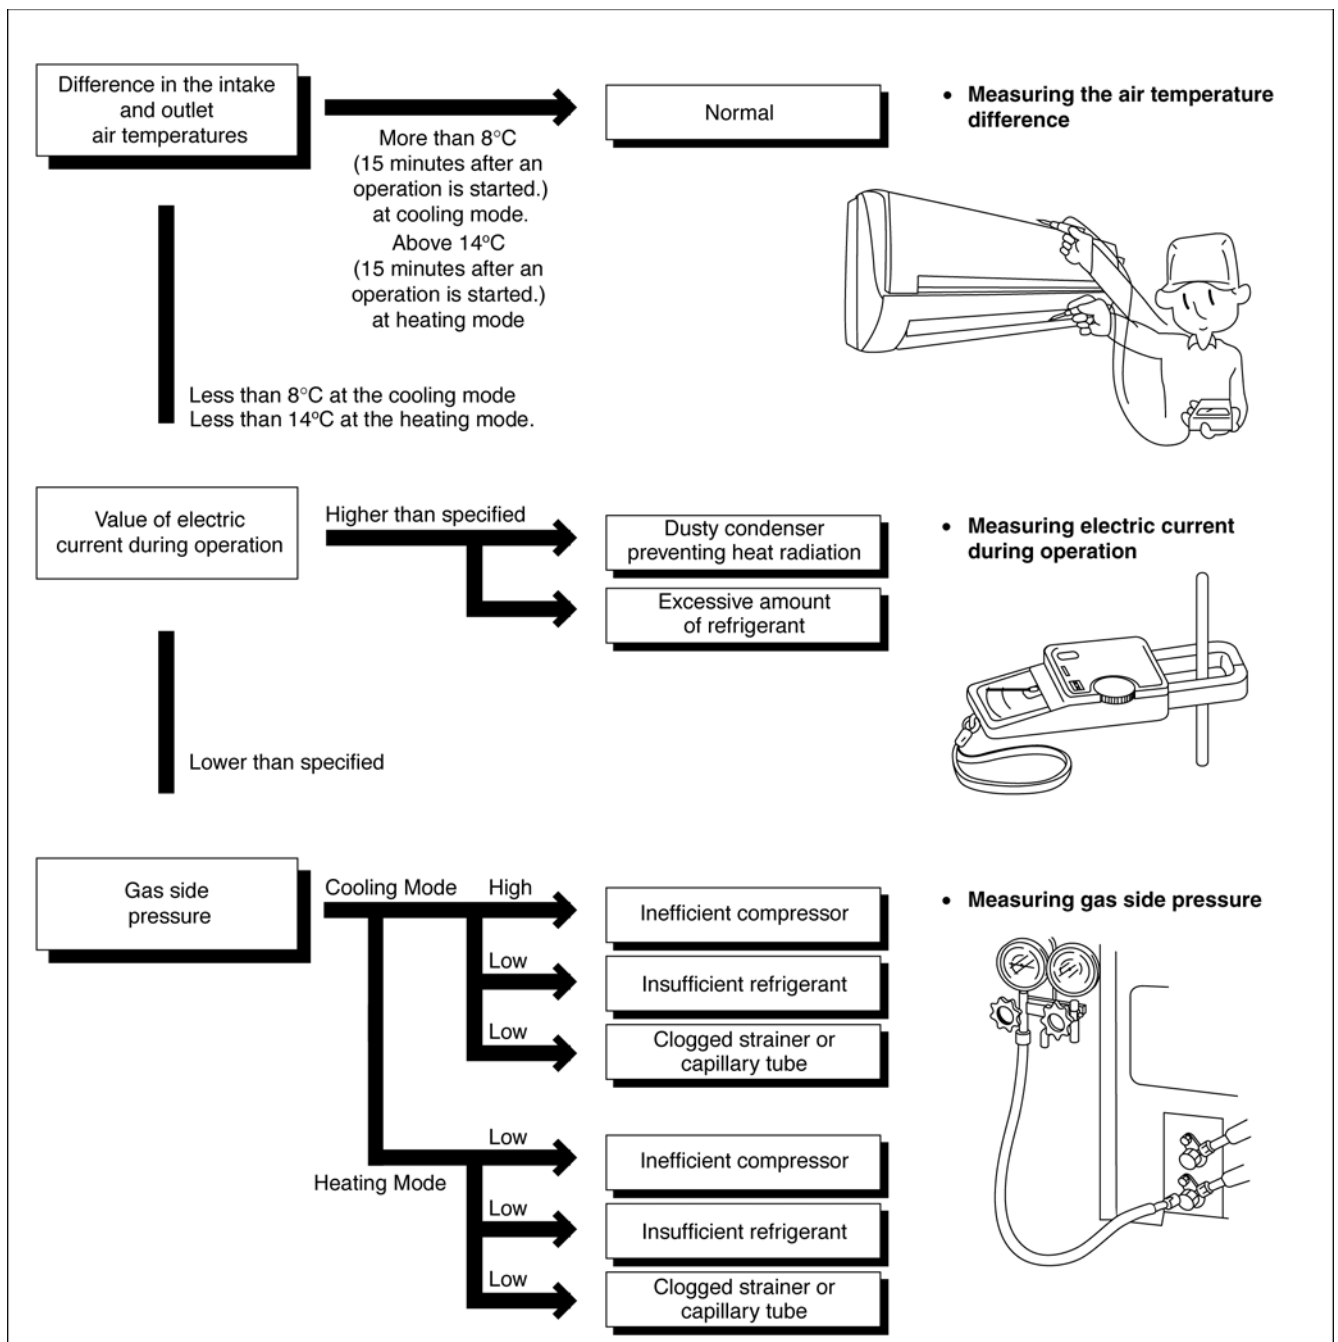























Normal Pressure and Outlet Air Temperature (Standard)

	Gas pressure MPa (kg/cm <sup>2</sup> G)	Outlet air temperature (°C)
Cooling Mode	0.9 ~ 1.2 (9 ~ 12)	12 ~ 16
Heating Mode	2.3 ~ 2.9 (23 ~ 29)	36 ~ 45

- ★ Condition:
- Indoor fan speed; High
  - Outdoor temperature 35°C at cooling mode and 7°C at heating mode.
  - Compressor operates at rated frequency



### 16.1.1. Relationship between the condition of the air conditioner and pressure and electric current

Condition of the air conditioner	Cooling Mode			Heating Mode		
	Low Pressure	High Pressure	Electric current during operating	Low Pressure	High Pressure	Electric current during operating
Insufficient refrigerant (gas leakage)						
Clogged capillary tube or Strainer						
Short circuit in the indoor unit						
Heat radiation deficiency of the outdoor unit						
Inefficient compression						

- Carry out the measurements of pressure, electric current, and temperature fifteen minutes after an operation is started.

## 16.2. Breakdown Self Diagnosis Function

### 16.2.1. Self Diagnosis Function (Three Digits Alphanumeric Code)

- Once abnormality has occurred during operation, the unit will stop its operation, and Timer LED blinks.
- Although Timer LED goes off when power supply is turned off, if the unit is operated under a breakdown condition, the LED will light up again.
- In operation after breakdown repair, the Timer LED will no more blink. The last error code (abnormality) will be stored in IC memory.


#### • To make a diagnosis

1. Timer LED start to blink and the unit automatically stops the operation.
2. Press the CHECK button on the remote controller continuously for 5 seconds.
3. “- -” will be displayed on the remote controller display.  
Note: Display only for “- -”. (No transmitting signal, no receiving sound and no Power LED blinking.)
4. Press the “TIMER” ▲ or ▼ button on the remote controller. The code “H00” (no abnormality) will be displayed and signal will be transmitted to the main unit.
5. Every press of the button (up or down) will increase abnormality numbers and transmit abnormality code signal to the main unit.
6. When the latest abnormality code on the main unit and code transmitted from the remote controller are matched, power LED will light up for 30 seconds and a beep sound (continuously for 4 seconds) will be heard. If no codes are matched, power LED will light up for 0.5 seconds and no sound will be heard.
7. The breakdown diagnosis mode will be canceled unless pressing the CHECK button continuously for 5 seconds or operating the unit for 30 seconds.
8. The LED will be off if the unit is turned off or the RESET button on the main unit is pressed.

#### • To display memorized error (Protective operation) status

1. Turn power on.
2. Press the CHECK button on the remote controller continuously for 5 seconds.
3. “- -” will be displayed on the remote controller display.  
Note: Display only for “- -”. (No transmitting signal, no receiving sound and no Power LED blinking.)
4. Press the “TIMER” ▲ or ▼ button on the remote controller. The code “H00” (no abnormality) will be displayed and signal will be transmitted to the main unit. The power LED lights up. If no abnormality is stored in the memory, three beeps sound will be heard.
5. Every press of the button (up or down) will increase abnormality numbers and transmit abnormality code signal to the main unit.
6. When the latest abnormality code on the main unit and code transmitted from the remote controller are matched, power LED will light up for 30 seconds and a beep sound (continuously for 4 seconds) will be heard. If no codes are matched, power LED will light up for 0.5 seconds and no sound will be heard.

7. The breakdown diagnosis mode will be canceled unless pressing the CHECK button continuously for 5 seconds or operating the unit for 30 seconds.
8. The same diagnosis can be repeated by turning power on again.

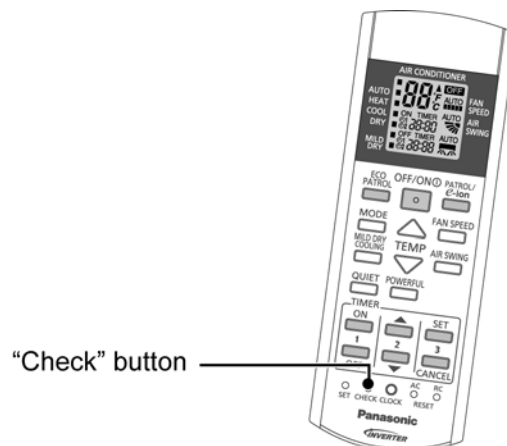

#### • To clear memorized error (Protective operation) status after repair:

1. Turn power on (in standby condition).
2. Press the AUTO button for 5 seconds (A beep receiving sound) on the main unit to operate the unit at Forced Cooling Operation modes.
3. Press the CHECK button on the remote controller for about 1 second with a pointed object to transmit signal to main unit. A beep sound is heard from main unit and the data is cleared.

#### • Temporary Operation (Depending on breakdown status)

1. Press the AUTO button (A beep receiving sound) on the main unit to operate the unit. (Remote control will become possible.)
2. The unit can temporarily be used until repaired.

## 16.3. Error Codes Table

Diagnosis display	Abnormality / Protection control	Abnormality Judgement	Protection operation	Problem	Check location
H00	No memory of failure	—	Normal operation	—	—
H11	Indoor/outdoor abnormal communication	After operation for 1 minute	Indoor fan only operation can start by entering into force cooling operation	Indoor/outdoor communication not establish	<ul style="list-style-type: none"> <li>Indoor/outdoor wire terminal</li> <li>Indoor/outdoor PCB</li> <li>Indoor/outdoor connection wire</li> </ul>
H12	Indoor unit capacity unmatched	90s after power supply	—	Total indoor capability more than maximum limit or less than minimum limit, or number of indoor unit less than two.	<ul style="list-style-type: none"> <li>Indoor/outdoor connection wire</li> <li>Indoor/outdoor PCB</li> <li>Specification and combination table in catalogue</li> </ul>
H14	Indoor intake air temperature sensor abnormality	Continuous for 5s	—	Indoor intake air temperature sensor open or short circuit	Indoor intake air temperature sensor lead wire and connector
H15	Compressor temperature sensor abnormality	Continuous for 5s	—	Compressor temperature sensor open or short circuit	Compressor temperature sensor lead wire and connector
H16	Outdoor current transformer (CT) abnormality	—	—	Current transformer faulty or compressor faulty	Outdoor PCB faulty or compressor faulty
H19	Indoor fan motor mechanism lock	Continuous happen for 7 times	—	Indoor fan motor lock or feedback abnormal	<ul style="list-style-type: none"> <li>Fan motor lead wire and connector</li> <li>Fan motor lock or block</li> </ul>
H23	Indoor heat exchanger temperature sensor abnormality	Continuous for 5s	—	Indoor heat exchanger temperature sensor open or short circuit	Indoor heat exchanger temperature sensor lead wire and connector
H25	Indoor E-Ion abnormality	Port is ON for 10s during E-Ion off	—	—	E-Ion PCB
H27	Outdoor air temperature sensor abnormality	Continuous for 5s	—	Outdoor air temperature sensor open or short circuit	Outdoor air temperature sensor lead wire and connector
H28	Outdoor heat exchanger temperature sensor 1 abnormality	Continuous for 5s	—	Outdoor heat exchanger temperature sensor 1 open or short circuit	Outdoor heat exchanger temperature sensor 1 lead wire and connector
H30	Outdoor discharge pipe temperature sensor abnormality	Continuous for 5s	—	Outdoor discharge pipe temperature sensor open or short circuit	Outdoor discharge pipe temperature sensor lead wire and connector
H32	Outdoor heat exchanger temperature sensor 2 abnormality	Continuous for 5s	—	Outdoor heat exchanger temperature sensor 2 open or short circuit	Outdoor heat exchanger temperature sensor 2 lead wire and connector
H33	Indoor / outdoor misconnection abnormality	—	—	Indoor and outdoor rated voltage different	Indoor and outdoor units check
H34	Outdoor heat sink temperature sensor abnormality	Continuous for 2s	—	Outdoor heat sink temperature sensor open or short circuit	Outdoor heat sink sensor
H36	Outdoor gas pipe temperature sensor abnormality	Continuous for 5s	Heating protection operation only	Outdoor gas pipe temperature sensor open or short circuit	Outdoor gas pipe temperature sensor lead wire and connector
H37	Outdoor liquid pipe temperature sensor abnormality	Continuous for 5s	Cooling protection operation only	Outdoor liquid pipe temperature sensor open or short circuit	Outdoor liquid pipe temperature sensor lead wire and connector
H38	Indoor/Outdoor mismatch (brand code)	—	—	Brand code not match	Check indoor unit and outdoor unit.



Diagnosis display	Abnormality / Protection control	Abnormality Judgement	Protection operation	Problem	Check location
H39	Abnormal indoor operating unit or standby units	3 times happen within 40 minutes	—	Wrong wiring and connecting pipe, expansion valve abnormality, indoor heat exchanger sensor open circuit	<ul style="list-style-type: none"> <li>• Check indoor/outdoor connection wire and connection pipe</li> <li>• Indoor heat exchanger sensor lead wire and connector</li> <li>• Expansion valve and lead wire and connector</li> </ul>
H41	Abnormal wiring or piping connection	—	—	Wrong wiring and connecting pipe, expansion valve abnormality	<ul style="list-style-type: none"> <li>• Check indoor/outdoor connection wire and connection pipe</li> <li>• Expansion valve and lead wire and connector.</li> </ul>
H58	Indoor gas sensor abnormality	Continuous for 6 hours	—	Indoor gas sensor open or short circuit	<ul style="list-style-type: none"> <li>• Indoor gas sensor</li> <li>• Indoor PCB</li> </ul>
H59	ECO patrol sensor abnormality	Continuous for 70s	—	ECO patrol sensor open or short circuit	<ul style="list-style-type: none"> <li>• ECO patrol sensor</li> <li>• ECO patrol and Indoor PCB</li> </ul>
H64	Outdoor high pressure sensor abnormality	Continuous for 1 minutes	—	High pressure sensor open circuit during compressor stop	<ul style="list-style-type: none"> <li>• High pressure sensor</li> <li>• Lead wire and connector</li> </ul>
H97	Outdoor fan motor mechanism lock	2 times happen within 30 minutes	—	Outdoor fan motor lock or feedback abnormal	<ul style="list-style-type: none"> <li>• Outdoor fan motor lead wire and connector</li> <li>• Fan motor lock or block</li> </ul>
H98	Indoor high pressure protection	—	—	Indoor high pressure protection (Heating)	<ul style="list-style-type: none"> <li>• Check indoor heat exchanger</li> <li>• Air filter dirty</li> <li>• Air circulation short circuit</li> </ul>
H99	Indoor operating unit freeze protection	—	—	Indoor freeze protection (Cooling)	<ul style="list-style-type: none"> <li>• Check indoor heat exchanger</li> <li>• Air filter dirty</li> <li>• Air circulation short circuit</li> </ul>
F11	4-way valve switching abnormality	4 times happen within 30 minutes	—	4-way valve switching abnormal	<ul style="list-style-type: none"> <li>• 4-way valve</li> <li>• Lead wire and connector.</li> </ul>
F17	Indoor standby units freezing abnormality	3 times happen within 40 minutes	—	Wrong wiring and connecting pipe, expansion valve leakage, indoor heat exchanger sensor open circuit	<ul style="list-style-type: none"> <li>• Check indoor/outdoor connection wire and pipe</li> <li>• Indoor heat exchanger sensor lead wire and connector</li> <li>• Expansion valve lead wire and connector.</li> </ul>
F90	Power factor correction (PFC) circuit protection	4 times happen within 10 minutes	—	Power factor correction circuit abnormal	<ul style="list-style-type: none"> <li>• Outdoor PCB faulty</li> </ul>
F91	Refrigeration cycle abnormality	2 times happen within 20 minutes	—	Refrigeration cycle abnormal	<ul style="list-style-type: none"> <li>• Insufficient refrigerant or valve close</li> </ul>
F93	Compressor abnormal revolution	4 times happen within 20 minutes	—	Compressor abnormal revolution	<ul style="list-style-type: none"> <li>• Power transistor module faulty or compressor lock</li> </ul>
F94	Compressor discharge pressure overshoot protection	4 times happen within 30 minutes	—	Compressor discharge pressure overshoot	<ul style="list-style-type: none"> <li>• Check refrigeration system</li> </ul>
F95	Outdoor cooling high pressure protection	4 times happen within 20 minutes	—	Cooling high pressure protection	<ul style="list-style-type: none"> <li>• Check refrigeration system</li> <li>• Outdoor air circuit</li> </ul>
F96	Power transistor module overheating protection	4 times happen within 30 minutes	—	Power transistor module overheat	<ul style="list-style-type: none"> <li>• PCB faulty</li> <li>• Outdoor air circuit (fan motor)</li> </ul>
F97	Compressor overheating protection	3 times happen within 30 minutes	—	Compressor overheat	<ul style="list-style-type: none"> <li>• Insufficient refrigerant</li> </ul>
F98	Total running current protection	3 times happen within 20 minutes	—	Total current protection	<ul style="list-style-type: none"> <li>• Check refrigeration system</li> <li>• Power source or compressor lock</li> </ul>
F99	Outdoor direct current (DC) peak detection	Continuous happen for 7 times	—	Power transistor module current protection	<ul style="list-style-type: none"> <li>• Power transistor module faulty or compressor lock</li> </ul>

## 16.4. Self-diagnosis Method

### 16.4.1. H11 (Indoor/Outdoor Abnormal Communication)


#### Malfunction Decision Conditions

During startup and operation of cooling and heating, the data received from outdoor unit in indoor unit signal transmission is checked whether it is normal.

#### Malfunction Caused

- Faulty indoor unit PCB.
- Faulty outdoor unit PCB.
- Indoor unit-outdoor unit signal transmission error due to wrong wiring.
- Indoor unit-outdoor unit signal transmission error due to breaking of wire in the connection wires between the indoor and outdoor units.
- Indoor unit-outdoor unit signal transmission error due to disturbed power supply waveform.

#### Troubleshooting

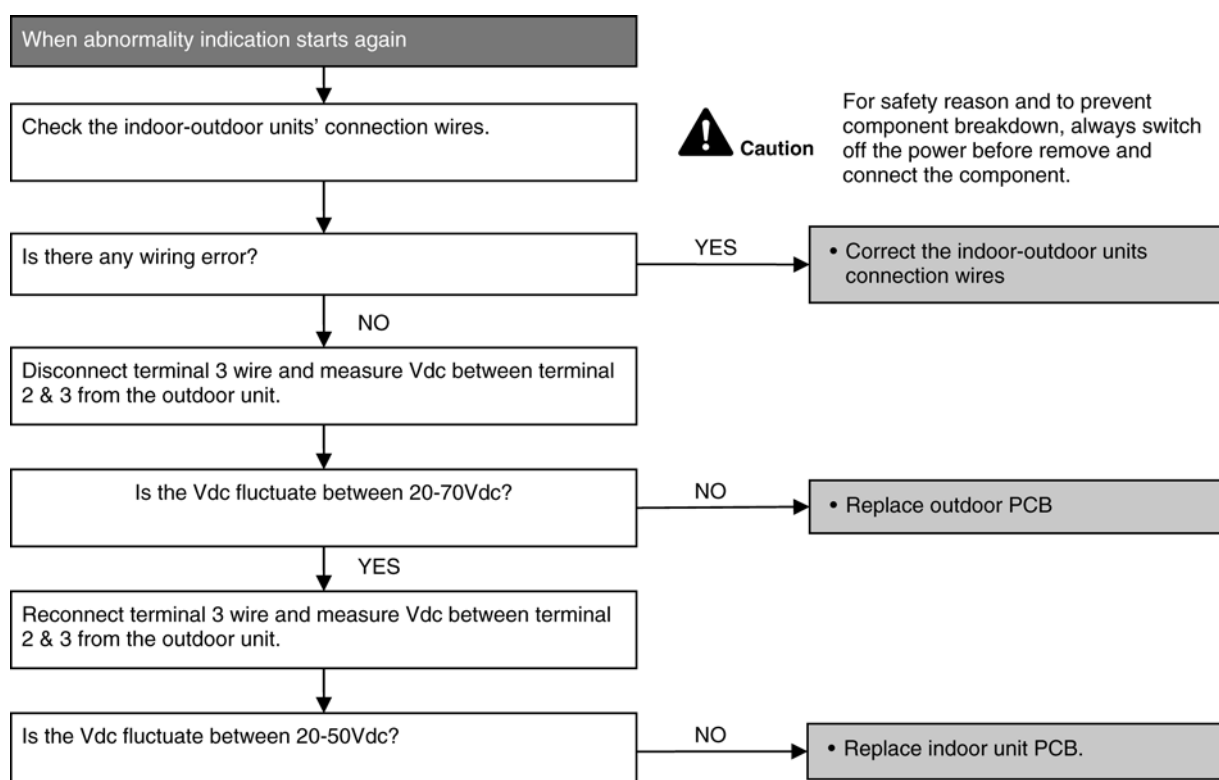

## 16.4.2. H12 (Indoor/Outdoor Capacity Rank Mismatched)


### Malfunction Decision Conditions

During startup, error code appears when different types of indoor and outdoor units are interconnected.

### Malfunction Caused

- Wrong models interconnected.
- Wrong indoor unit or outdoor unit PCBs mounted.
- Indoor unit or outdoor unit PCBs defective.
- Indoor-outdoor unit signal transmission error due to wrong wiring.
- Indoor-outdoor unit signal transmission error due to breaking of wire 3 in the connection wires between the indoor and outdoor units.

### Troubleshooting

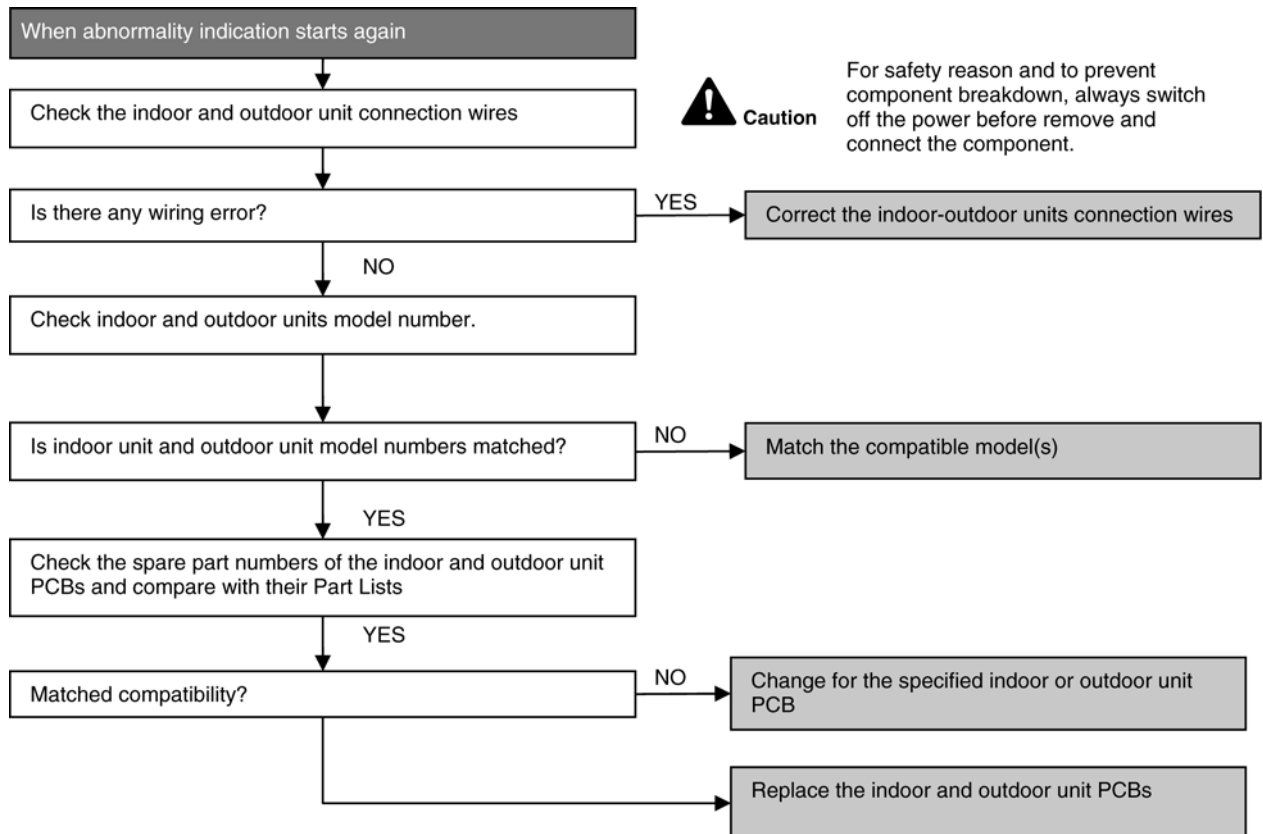

### 16.4.3. H14 (Indoor Intake Air Temperature Sensor Abnormality)



#### Malfunction Decision Conditions

During startup and operation of cooling and heating, the temperatures detected by the indoor intake air temperature sensor are used to determine sensor errors.

#### Malfunction Caused

- Faulty connector connection.
- Faulty sensor.
- Faulty PCB.

#### Troubleshooting

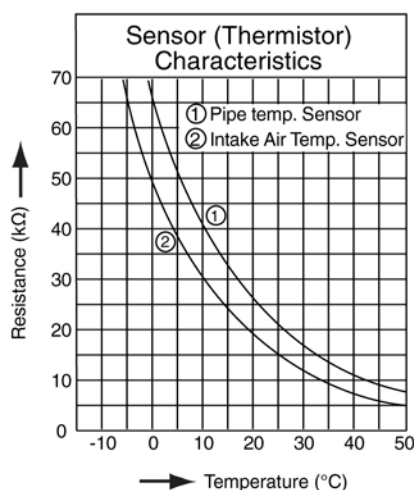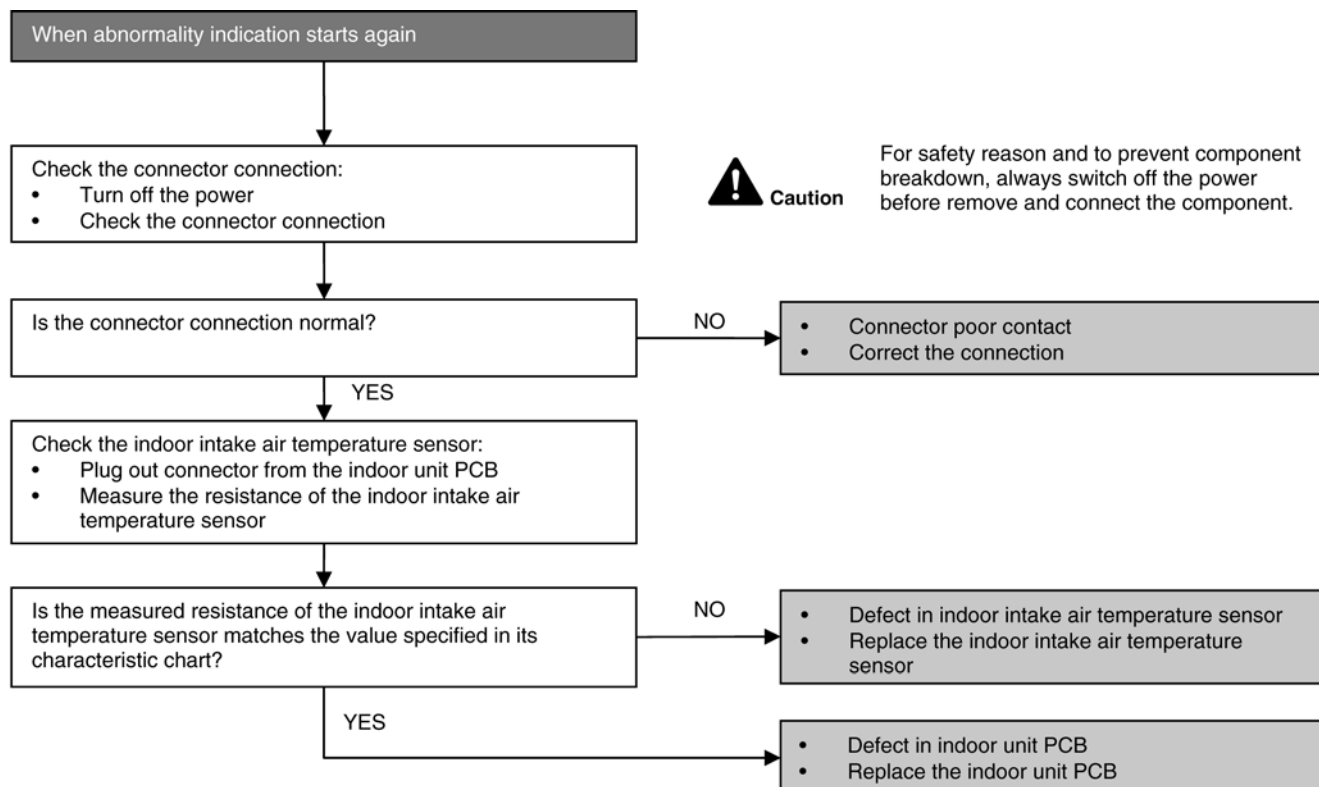

#### 16.4.4. H15 (Compressor Temperature Sensor Abnormality)



##### Malfunction Decision Conditions

During startup and operation of cooling and heating, the temperatures detected by the outdoor compressor temperature sensor are used to determine sensor errors.

##### Malfunction Caused

- Faulty connector connection.
- Faulty sensor.
- Faulty PCB.

##### Troubleshooting

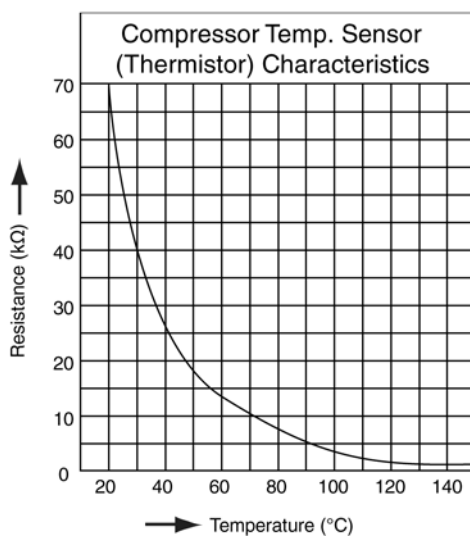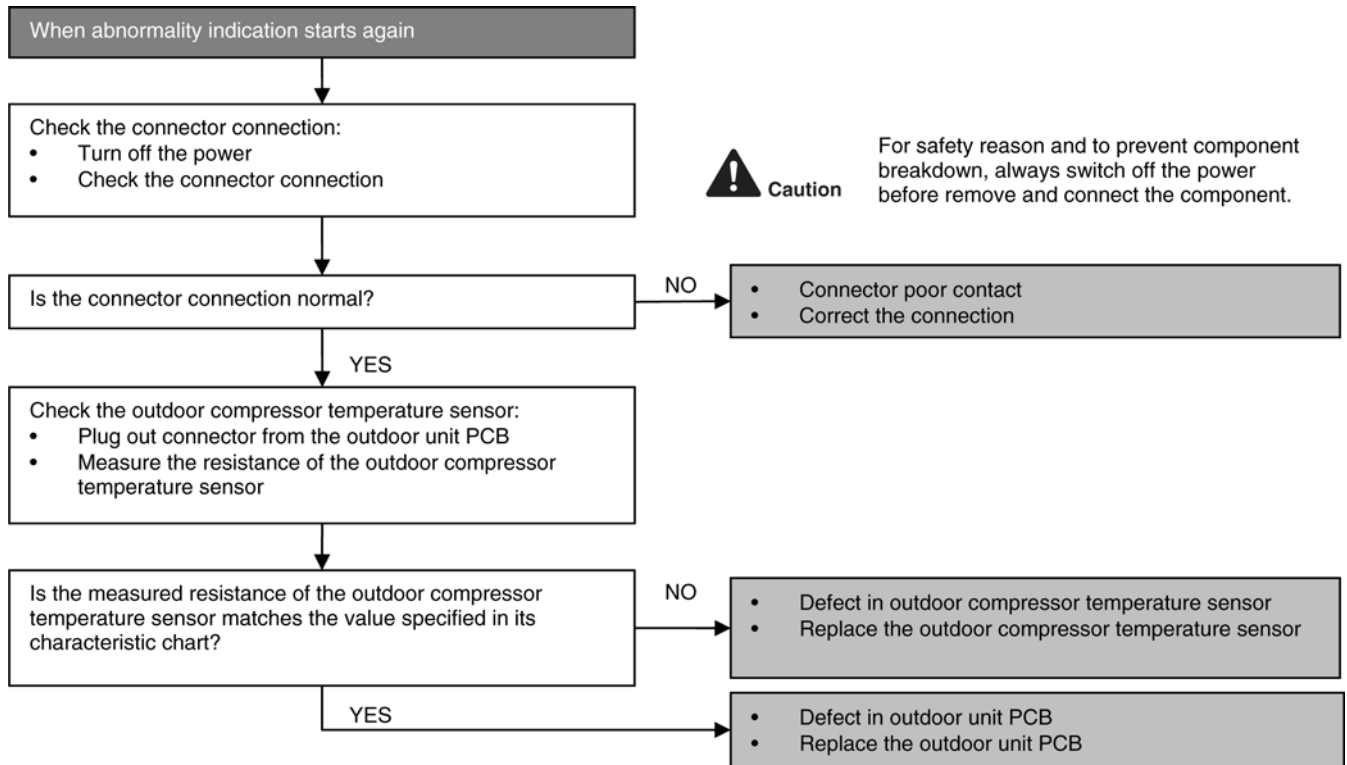

### 16.4.5. H16 (Outdoor Current Transformer Open Circuit)


#### Malfunction Decision Conditions

A current transformer (CT) is detected by checking the compressor running frequency ( $\geq$  rated frequency) and CT detected input current (less than 0.65A) for continuously 20 seconds.

#### Malfunction Caused

- CT defective
- Outdoor PCB defective
- Compressor defective (low compression)

#### Troubleshooting

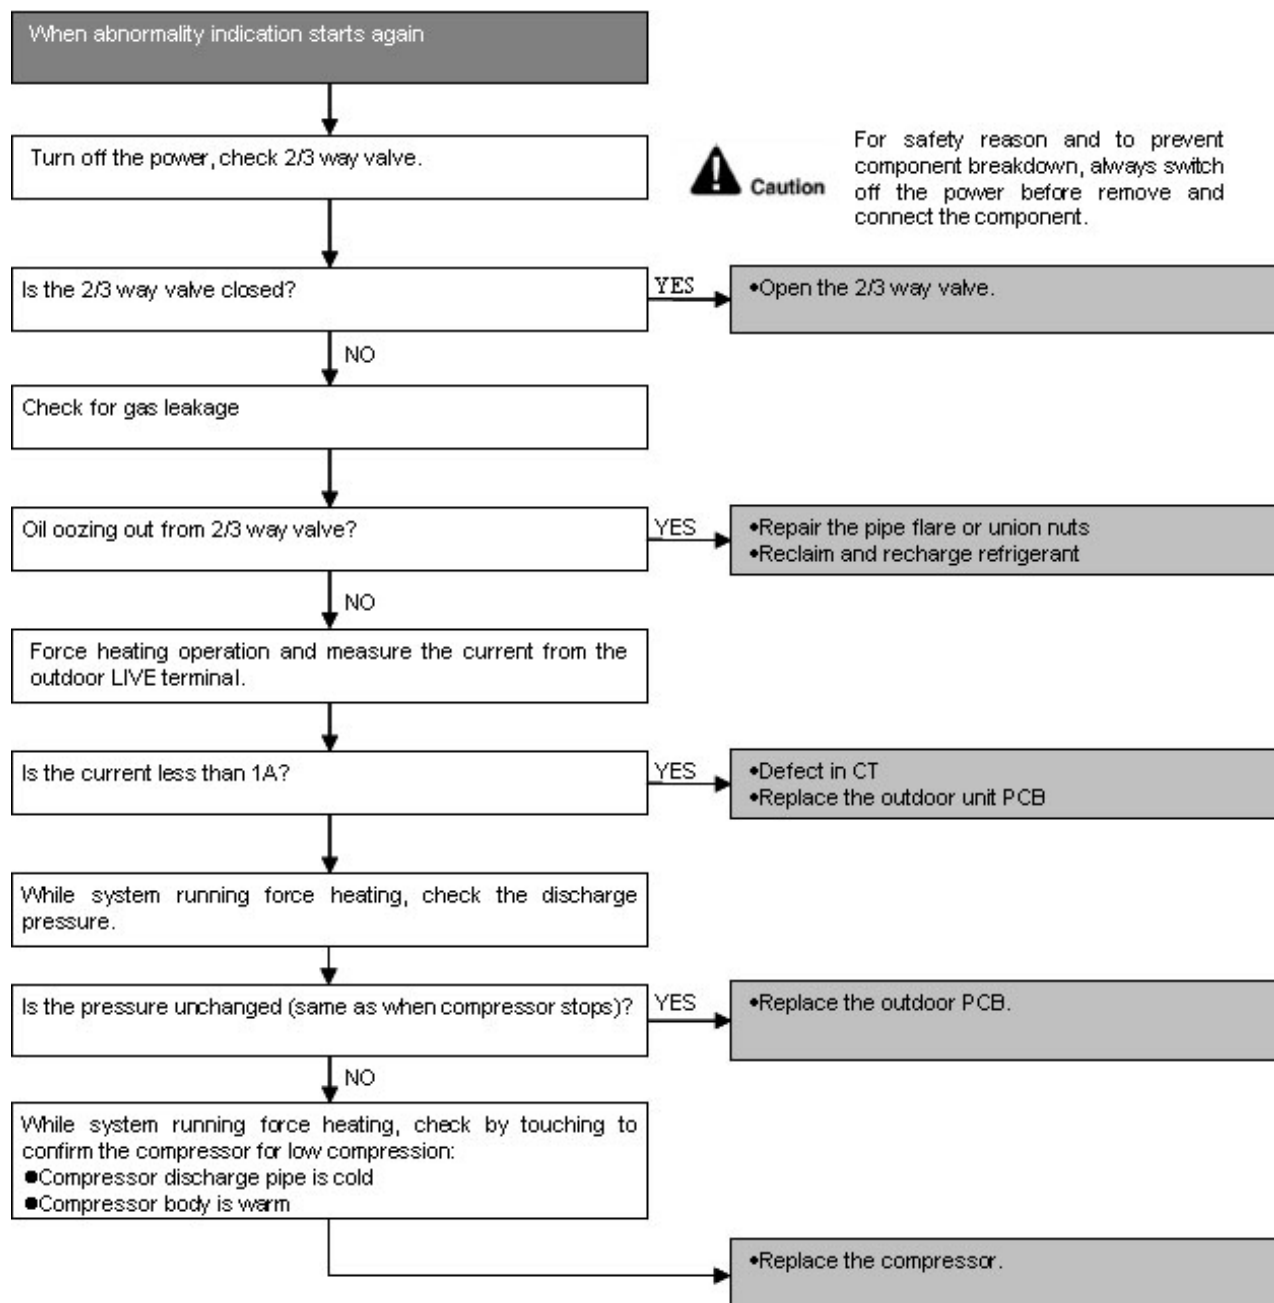

## 16.4.6. H19 (Indoor Fan Motor - DC Motor Mechanism Locked)


### Malfunction Decision Conditions

The rotation speed detected by the Hall IC during fan motor operation is used to determine abnormal fan motor (feedback of rotation > 2550rpm or < 50rpm)

### Malfunction Caused

- Operation stops due to short circuit inside the fan motor winding.
- Operation stops due to breaking of wire inside the fan motor.
- Operation stops due to breaking of fan motor lead wires.
- Operation stops due to Hall IC malfunction.
- Operation error due to faulty indoor unit PCB.

### Troubleshooting

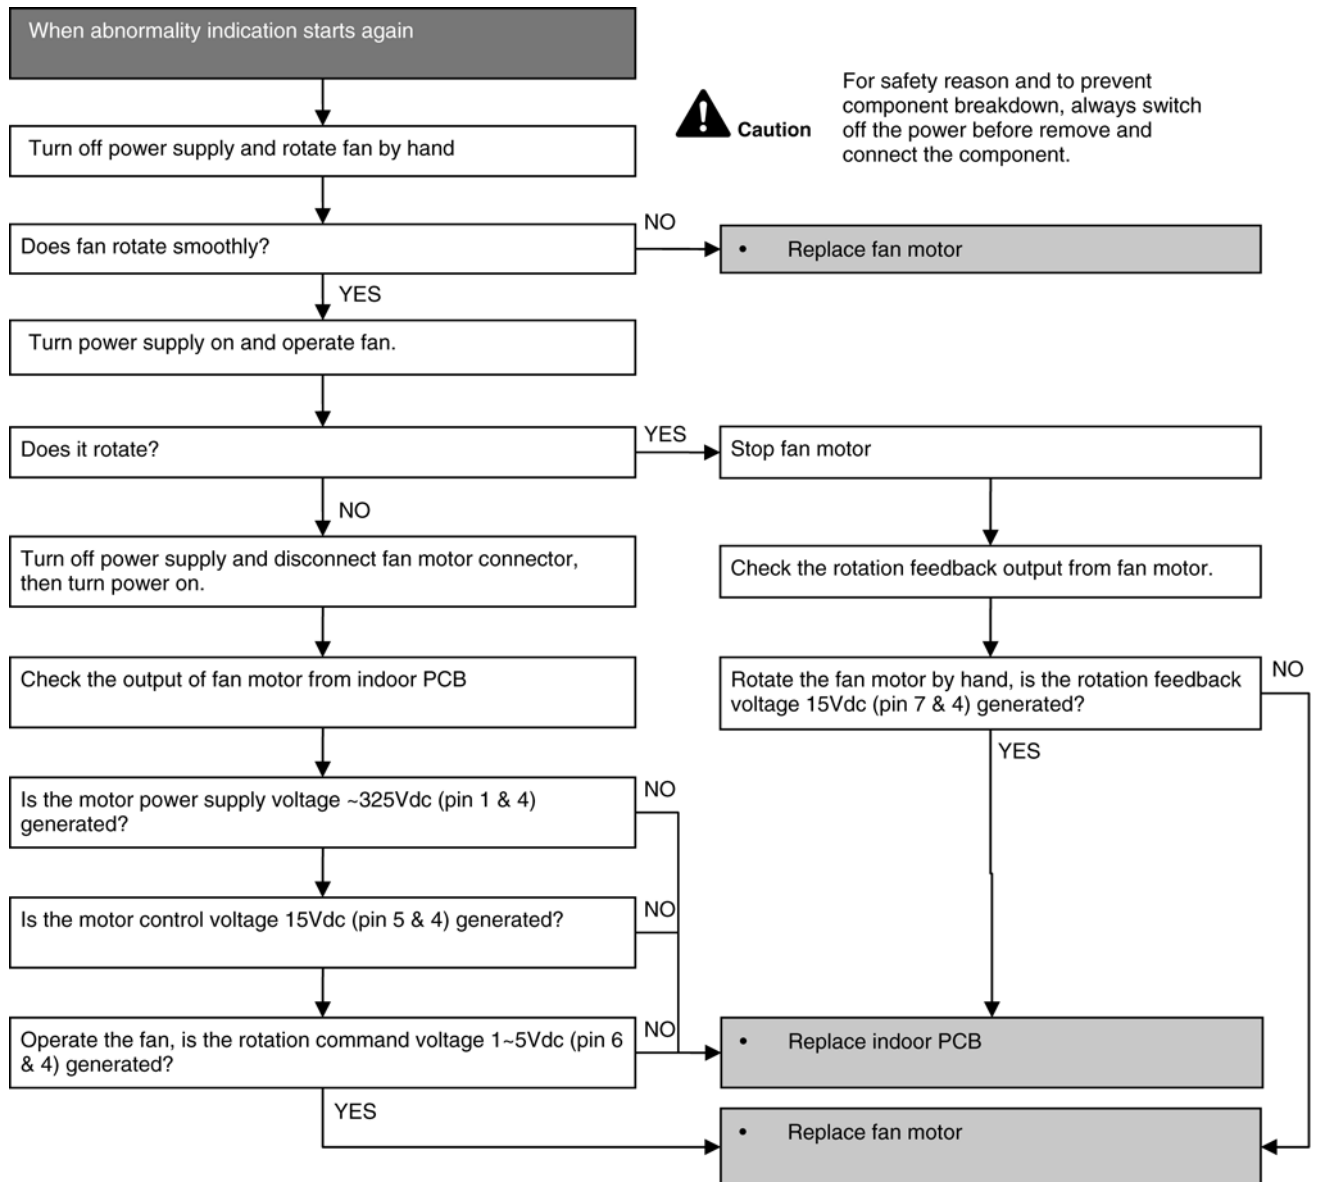

## 16.4.7. H23 (Indoor Pipe Temperature Sensor Abnormality)



### Malfunction Decision Conditions

During startup and operation of cooling and heating, the temperatures detected by the indoor heat exchanger temperature sensor are used to determine sensor errors.

### Malfunction Caused

- Faulty connector connection.
- Faulty sensor.
- Faulty PCB.

### Troubleshooting

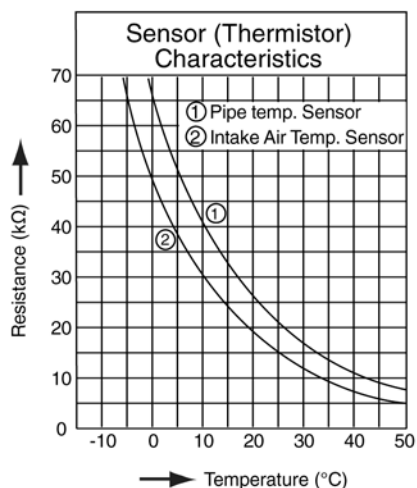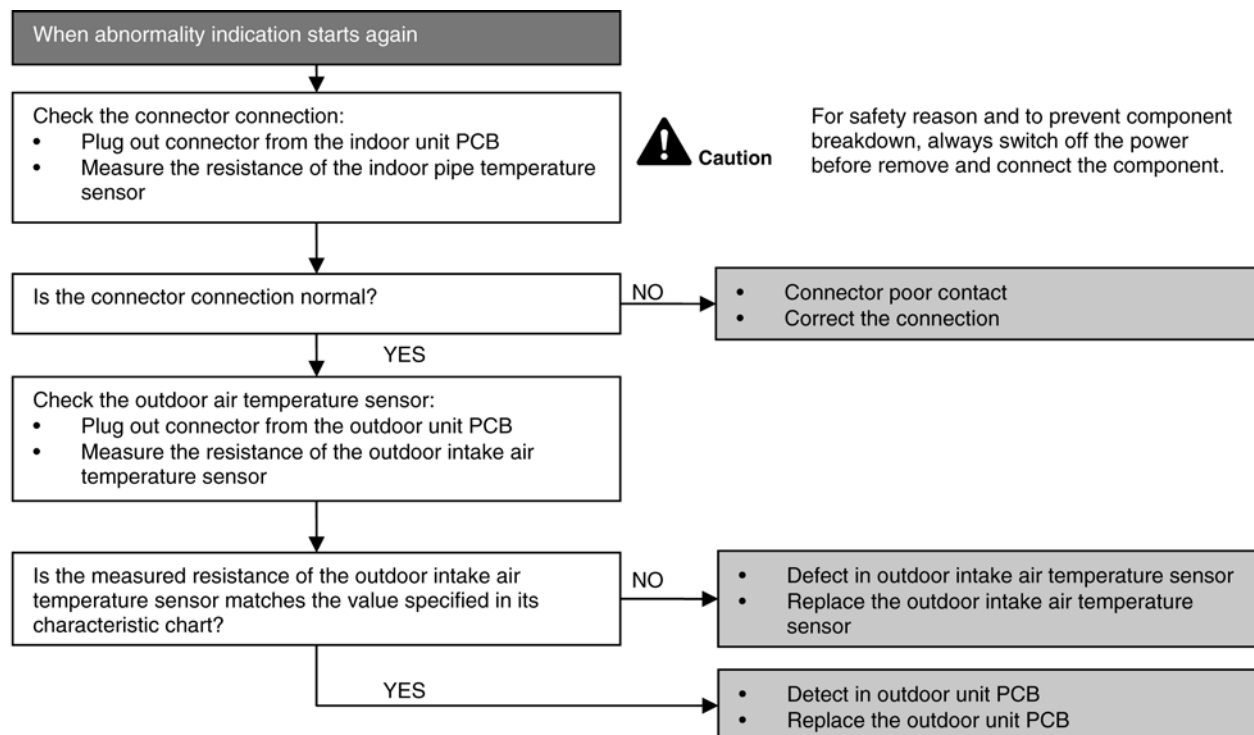



## 16.4.8. H25 (e-ion Air Purifying System Abnormal)


### Malfunction Decision Conditions

During standby of cooling and heating operation, e-ion breakdown occurs and air conditioner stops operation.

### Malfunction Caused

- Faulty indoor main PCB.
- Faulty indoor e-ion power module.

### Troubleshooting

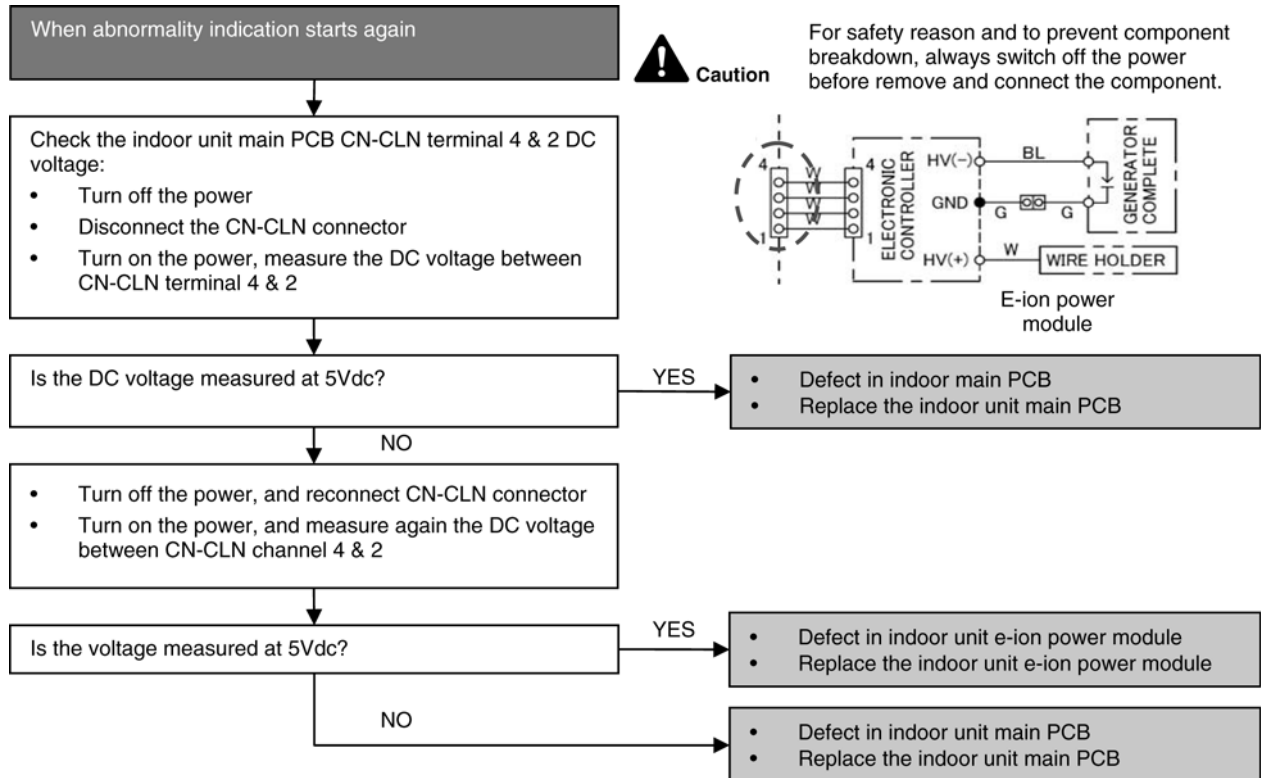

## 16.4.9. H27 (Outdoor Air Temperature Sensor Abnormality)



### Malfunction Decision Conditions

During startup and operation of cooling and heating, the temperatures detected by the outdoor air temperature sensor are used to determine sensor errors.

### Malfunction Caused

- Faulty connector connection.
- Faulty sensor.
- Faulty PCB.

### Troubleshooting

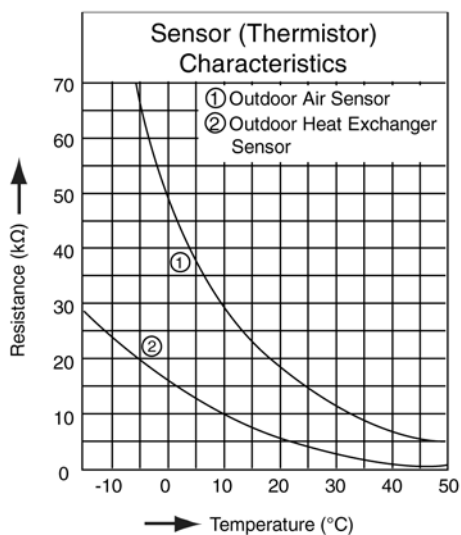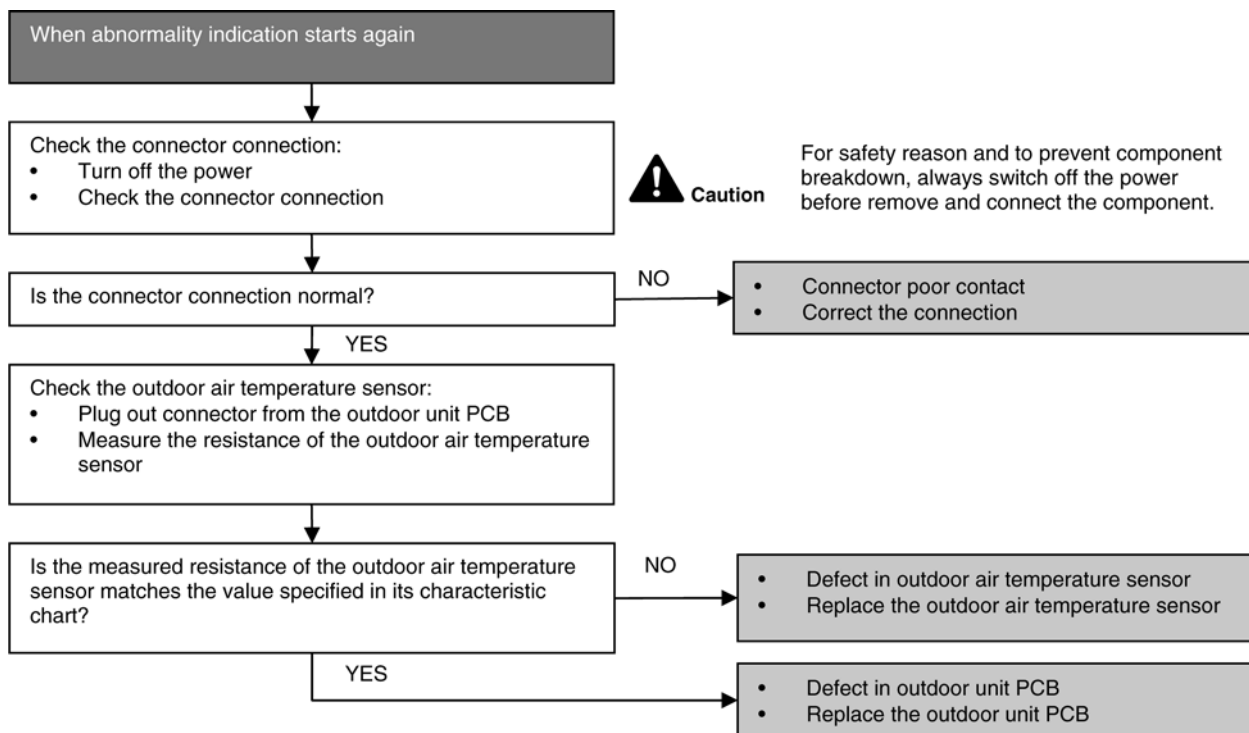

## 16.4.10. H28 (Outdoor Pipe Temperature Sensor Abnormality)



### Malfunction Decision Conditions

During startup and operation of cooling and heating, the temperatures detected by the outdoor pipe temperature sensor are used to determine sensor errors.

### Malfunction Caused

- Faulty connector connection.
- Faulty sensor.
- Faulty PCB.

### Troubleshooting

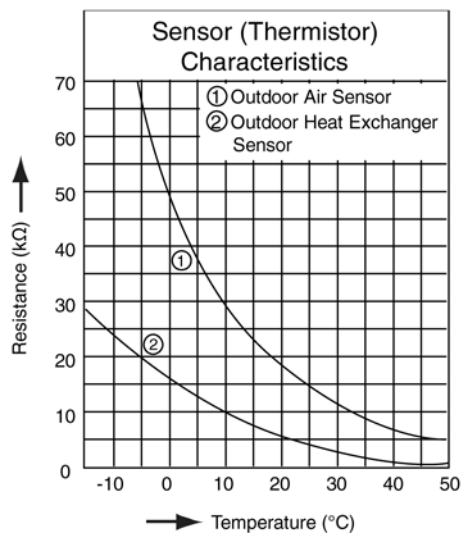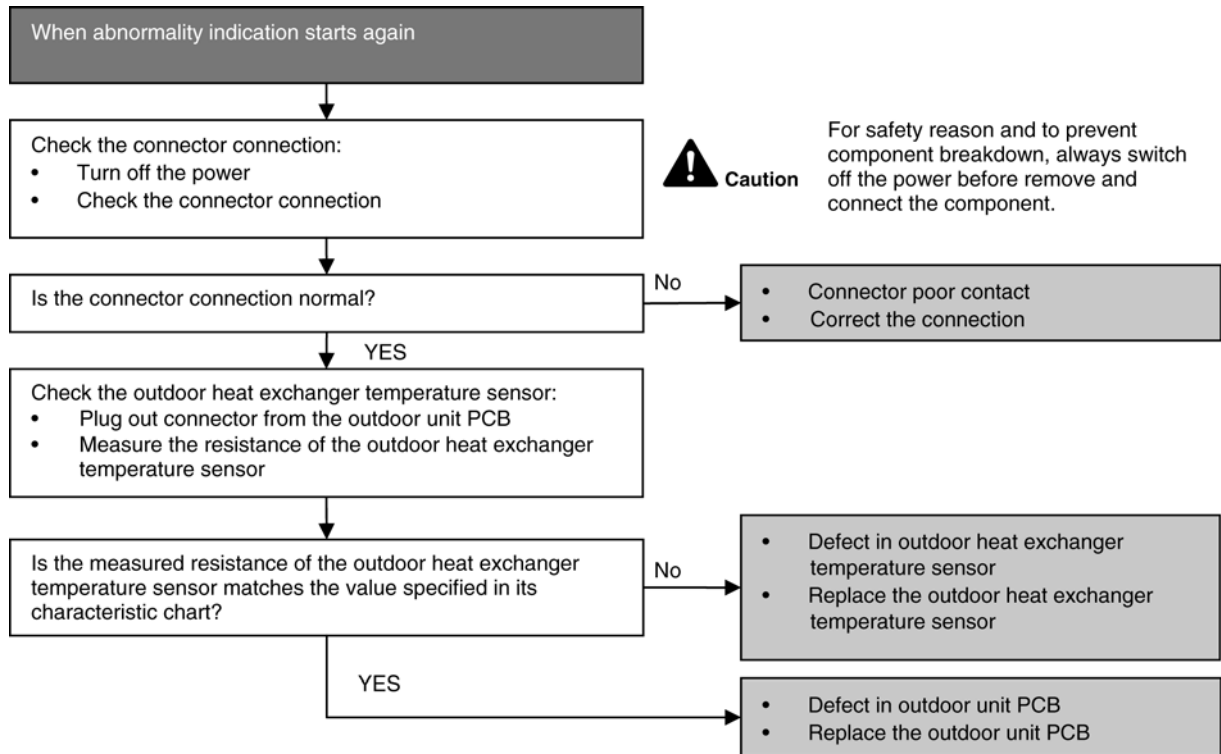

## 16.4.11. H30 (Compressor Discharge Temperature Sensor Abnormality)


### Malfunction Decision Conditions

During startup and operation of cooling and heating, the temperatures detected by the outdoor discharge pipe temperature sensor are used to determine sensor errors.

### Malfunction Caused

- Faulty connector connection.
- Faulty sensor.
- Faulty PCB.

### Troubleshooting

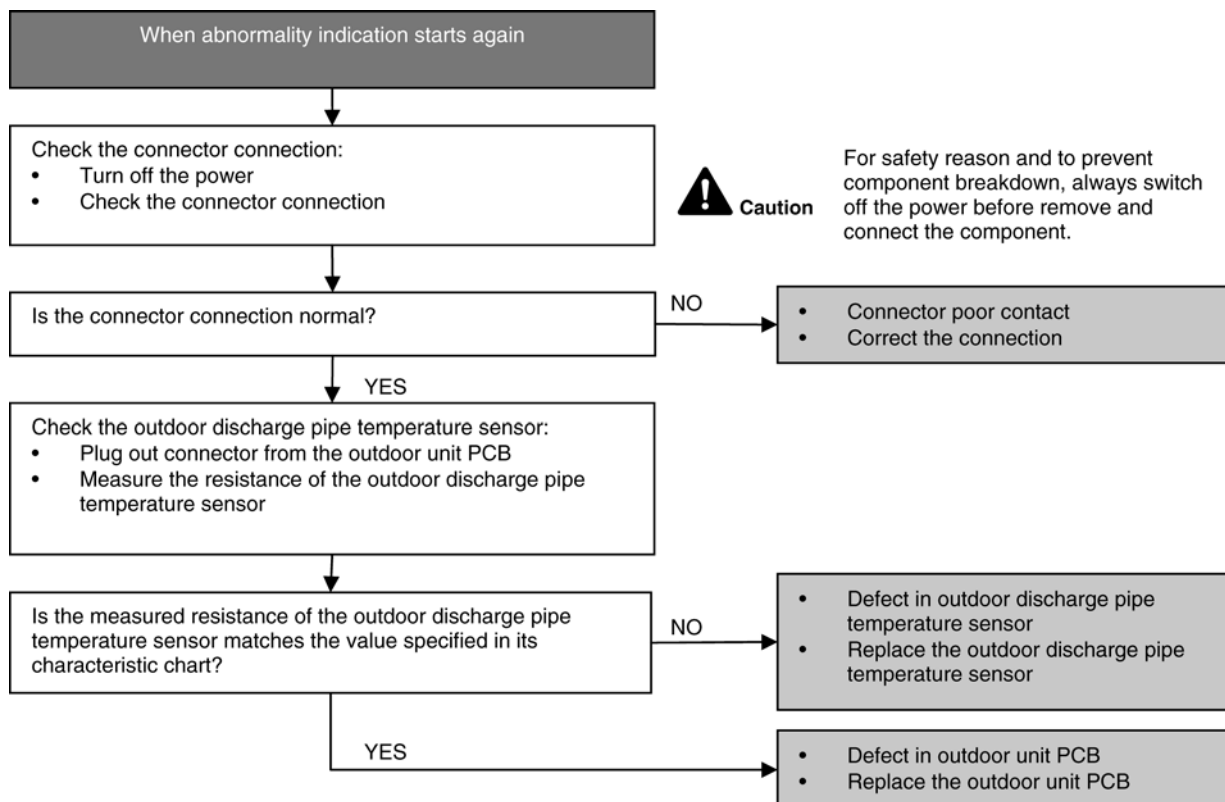

## 16.4.12. H32 (Outdoor Heat Exchanger Temperature Sensor 2 Abnormality)


### Malfunction Decision Conditions

During startup and operation of cooling and heating, the temperatures detected by the outdoor heat exchanger temperature sensor are used to determine sensor errors.

### Malfunction Caused

- Faulty connector connection.
- Faulty sensor.
- Faulty PCB.

### Troubleshooting

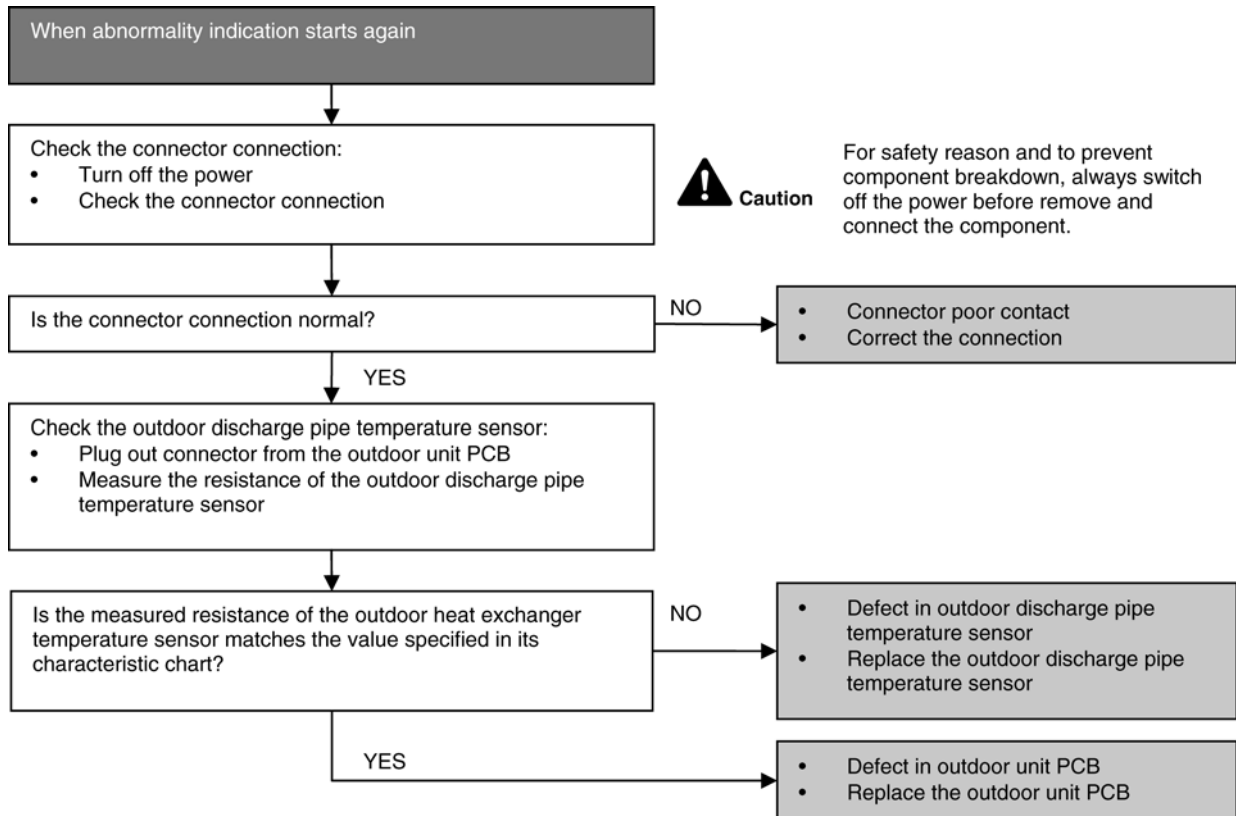

### 16.4.13. H33 (Unspecified Voltage between Indoor and Outdoor)


#### Malfunction Decision Conditions

The supply power is detected for its requirement by the indoor/outdoor transmission.

#### Malfunction Caused

- Wrong models interconnected.
- Wrong indoor unit and outdoor unit PCBs used.
- Indoor unit or outdoor unit PCB defective.

#### Troubleshooting

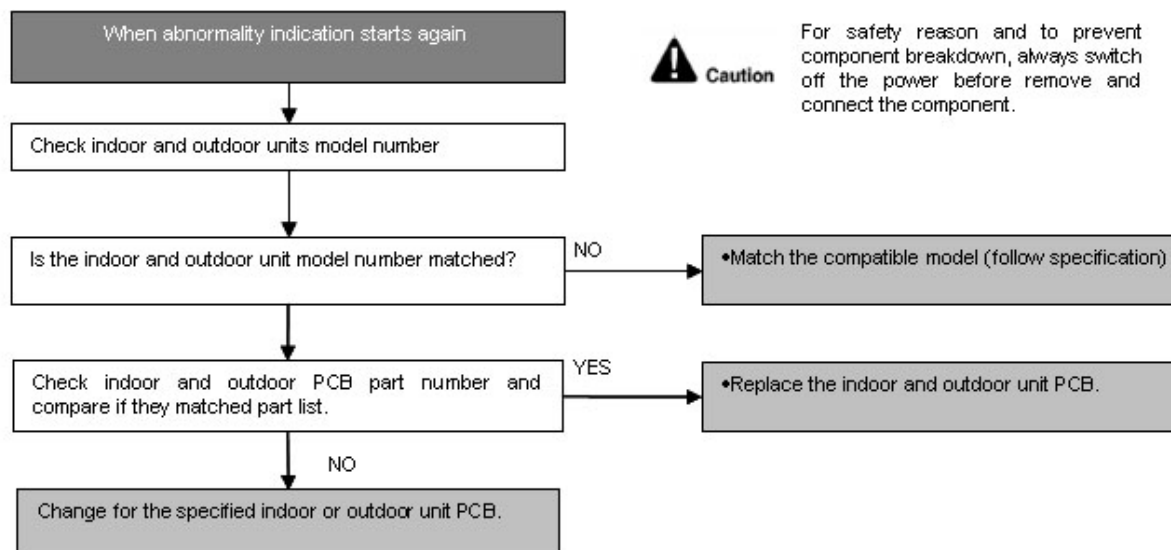

## 16.4.14. H34 (Outdoor Heat Sink Temperature Sensor Abnormality)


### Malfunction Decision Conditions

During startup and operation of cooling and heating, the temperatures detected by the outdoor heat sink temperature sensor are used to determine sensor errors.

### Malfunction Caused

- Faulty connector connection.
- Faulty sensor.
- Faulty PCB.

### Troubleshooting

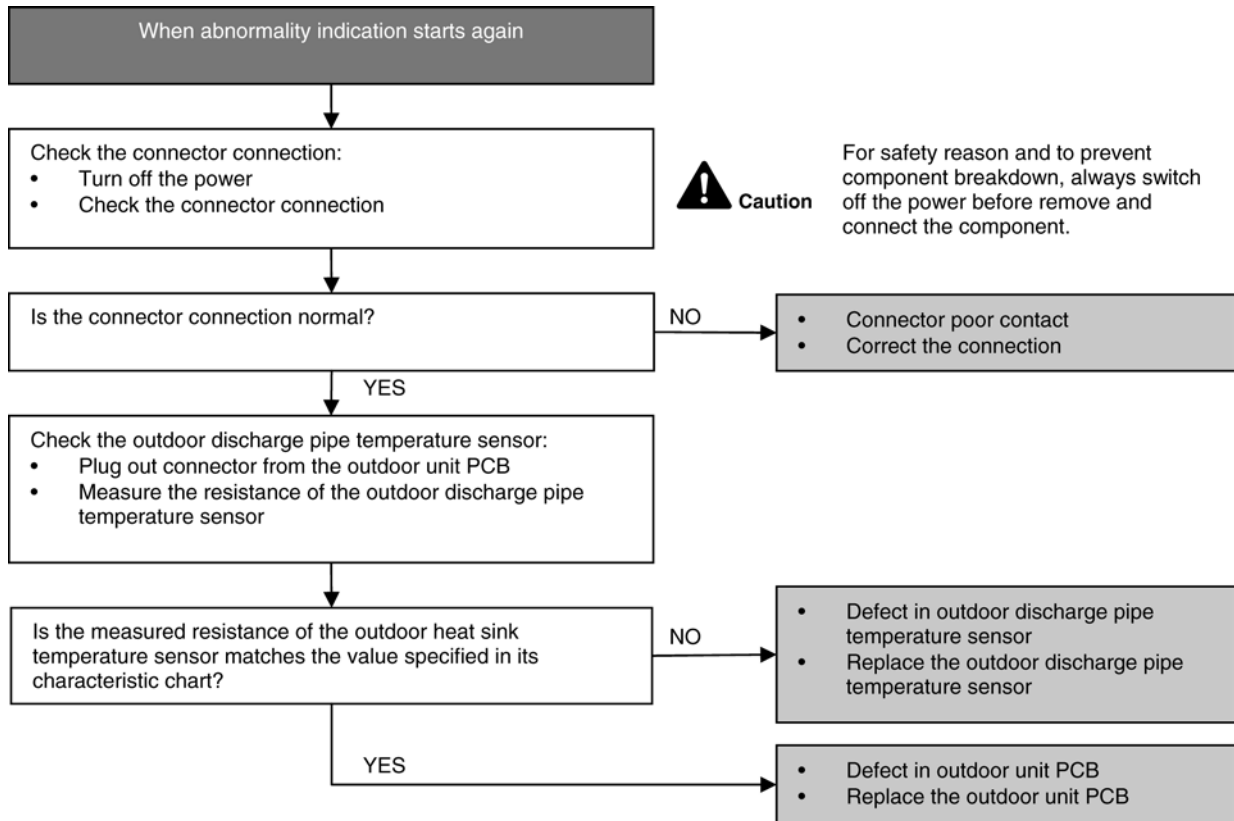

## 16.4.15. H36 (Outdoor Gas Pipe Sensor Abnormality)


### Malfunction Decision Conditions

During startup and operation of cooling and heating, the temperatures detected by the outdoor gas pipe temperature sensor are used to determine sensor errors.

### Malfunction Caused

- Faulty connector connection.
- Faulty sensor.
- Faulty PCB.

### Troubleshooting

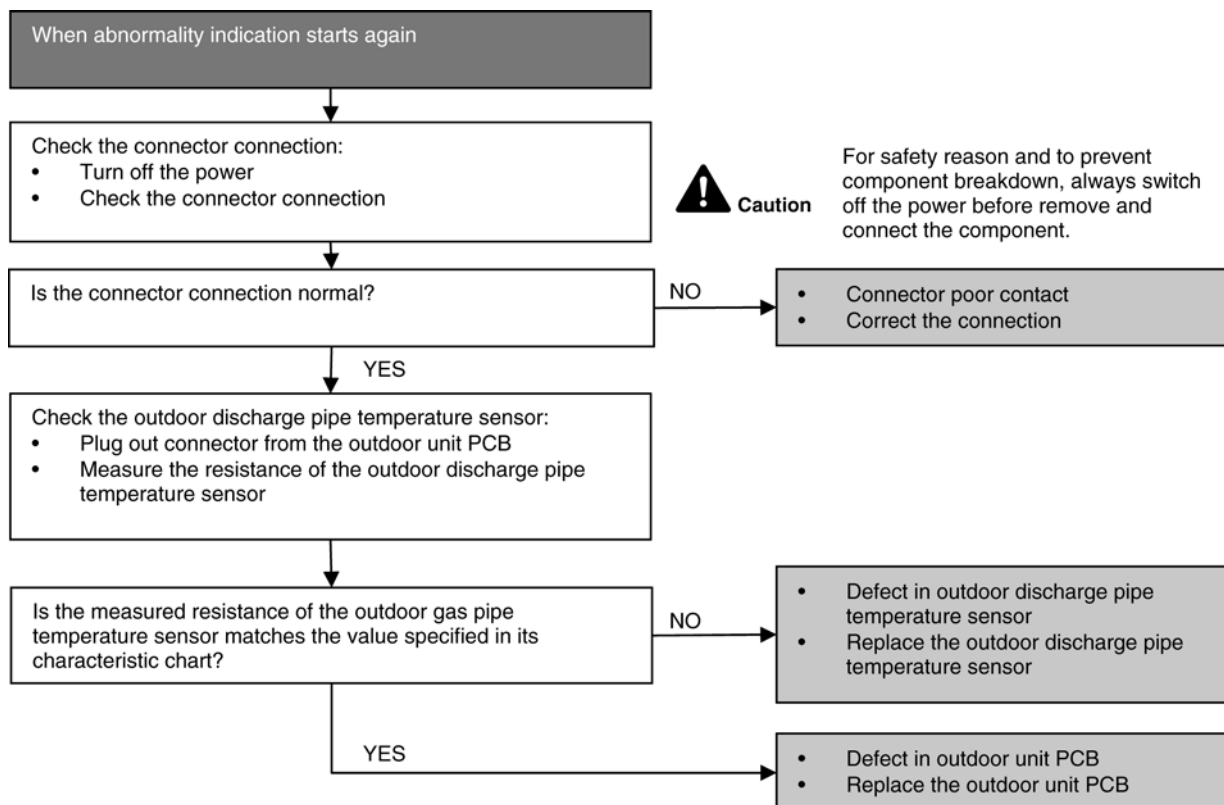



## 16.4.16. H37 (Outdoor Liquid Pipe Temperature Sensor Abnormality)


### Malfunction Decision Conditions

During startup and operation of cooling and heating, the temperatures detected by the outdoor liquid pipe temperature sensor are used to determine sensor errors.

### Malfunction Caused

- Faulty connector connection.
- Faulty sensor.
- Faulty PCB.

### Troubleshooting

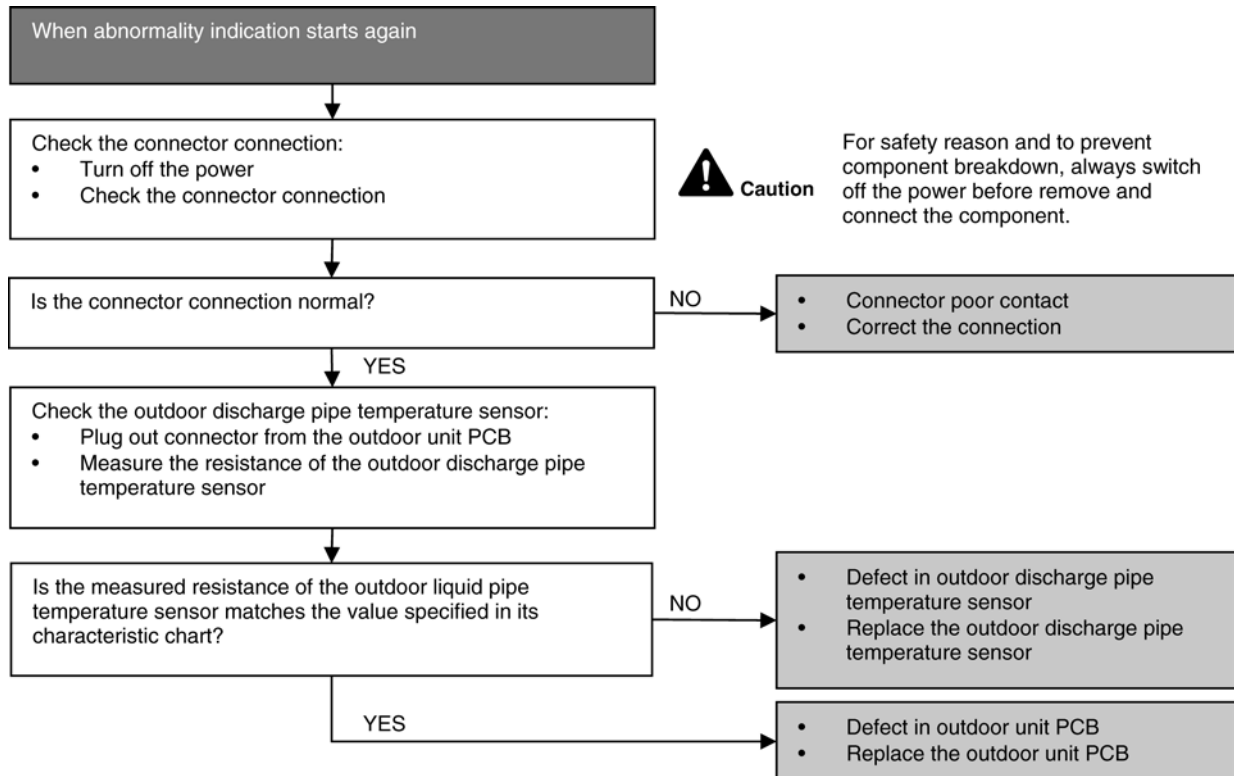

16.4.17. H58 (Patrol Sensor Abnormality)


Malfunction Decision Conditions

- If Patrol sensor feedback is 0V or 5V continuous for 6 hours.
- Error will display only when the Patrol operation is ON.

Malfunction Caused

- Faulty connector connection.
- Faulty Patrol sensor.

Troubleshooting

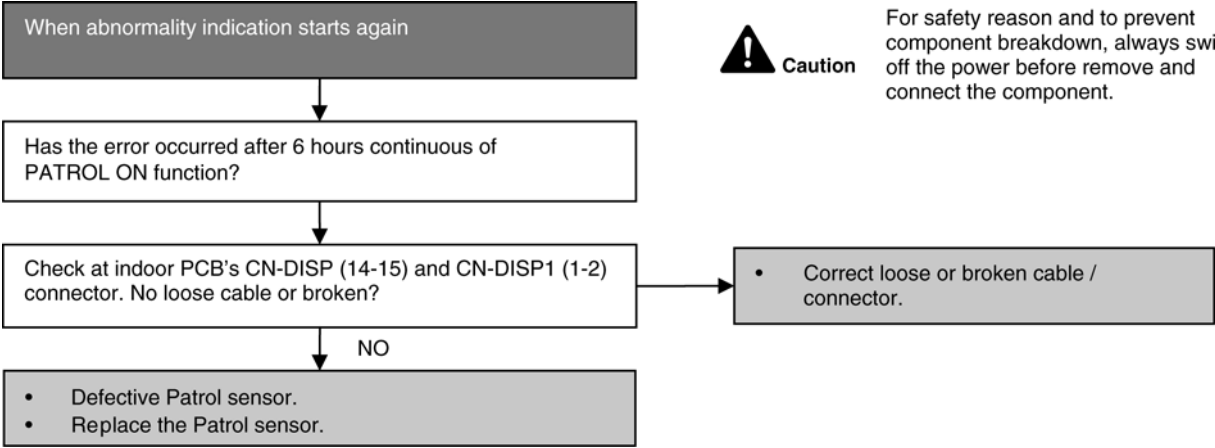

Caution

For safety reason and to prevent component breakdown, always switch off the power before remove and connect the component.

## 16.4.18. H97 (Outdoor Fan Motor - DC Motor Mechanism Locked)


### Malfunction Decision Conditions

The rotation speed detected by the Hall IC during fan motor operation is used to determine abnormal fan motor.

### Malfunction Caused

- Operation stops due to short circuit inside the fan motor winding.
- Operation stops due to breaking of wire inside the fan motor.
- Operation stops due to breaking of fan motor lead wires.
- Operation stops due to Hall IC malfunction.
- Operation error due to faulty outdoor unit PCB.

### Troubleshooting

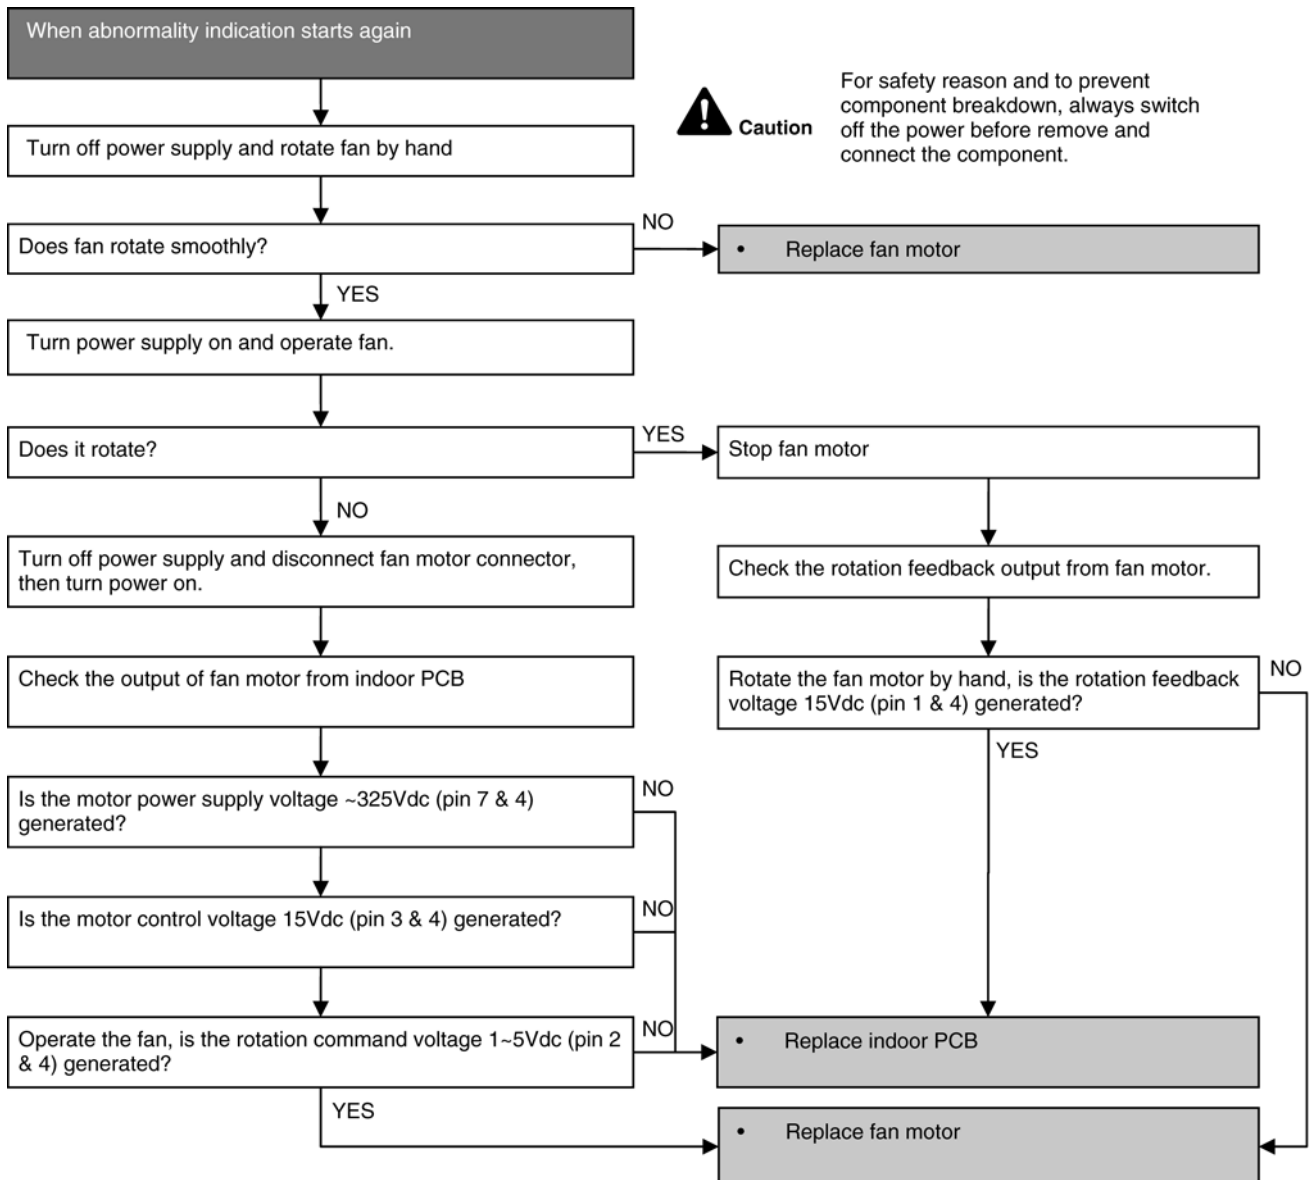

## 16.4.19. H98 (Indoor High Pressure Protection)

Error Code will not display (no Timer LED blinking) but store in EEPROM


### Malfunction Decision Conditions

During heating operation, the temperature detected by the indoor pipe temperature sensor is above 60°C.

### Malfunction Caused

- Air short circuit at indoor unit
- Clogged indoor unit air filter
- Dust accumulation on the indoor unit heat exchanger
- 2/3 way valve closed
- Faulty indoor unit fan motor
- Excessive refrigerant
- Clogged expansion valve or strainer
- Faulty indoor pipe temperature sensor
- Faulty indoor unit PCB

### Troubleshooting

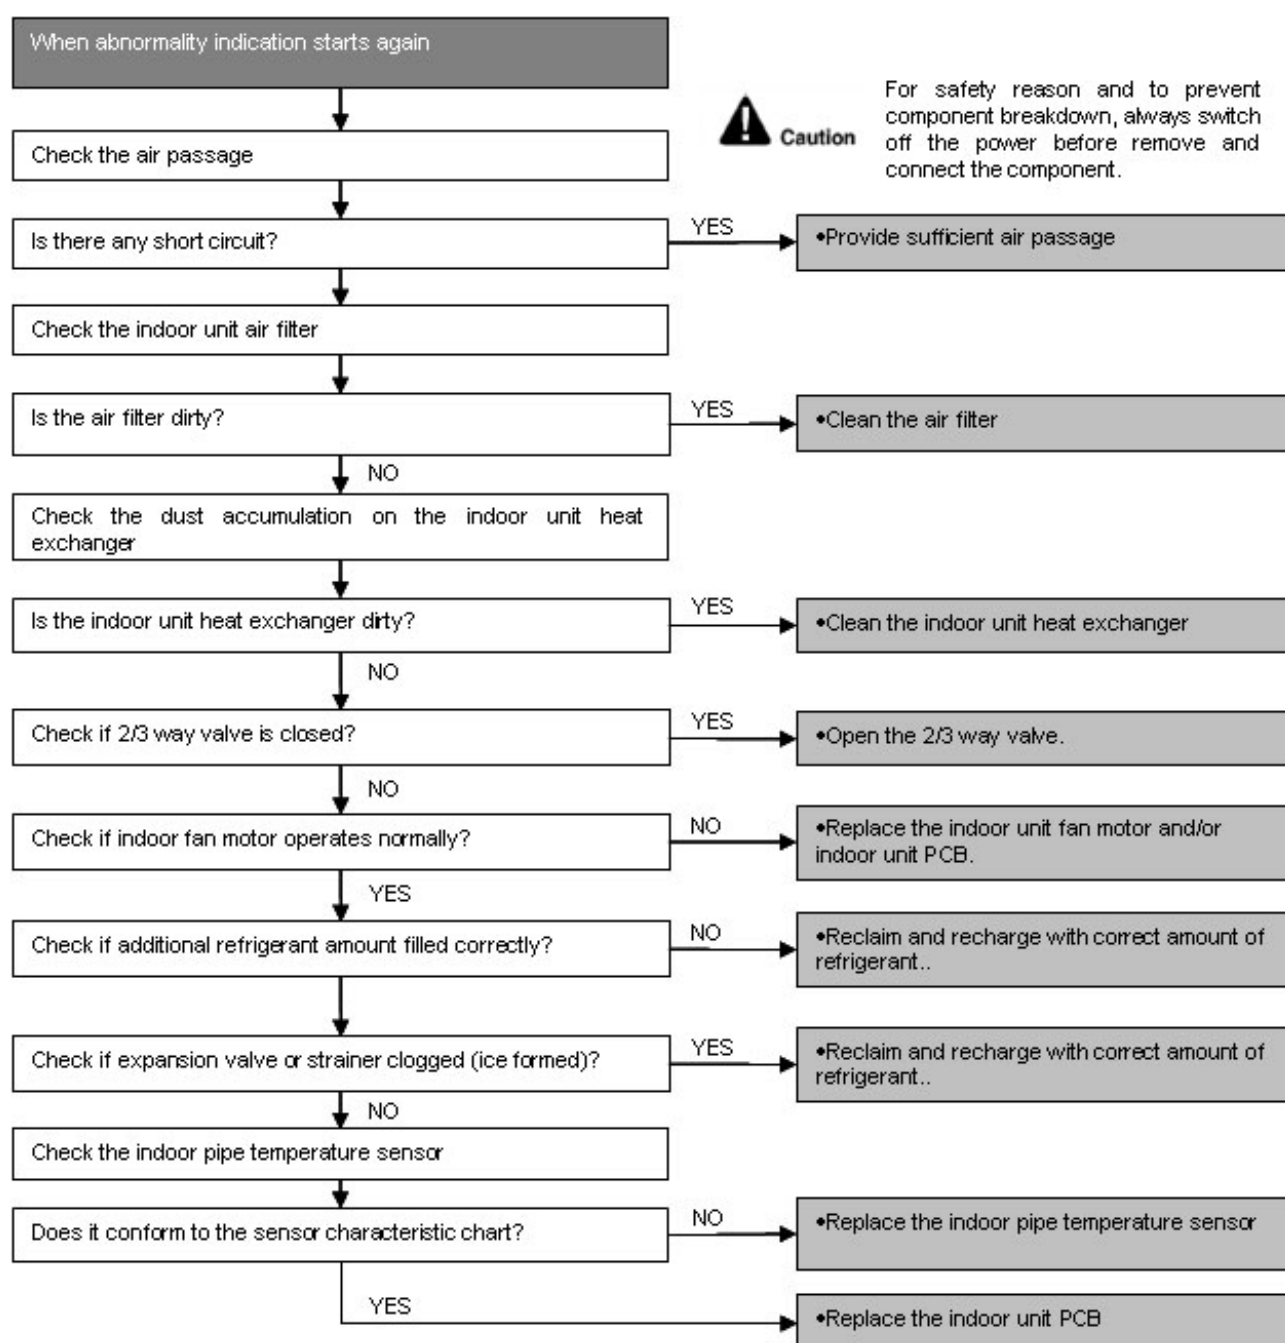

## 16.4.20. H99 (Indoor Freeze Prevention Protection: Cooling or Soft Dry)

Error code will not display (no TIMER LED blinking) but store in EEPROM


### Malfunction Decision Conditions

Freeze prevention control takes place (when indoor pipe temperature is lower than 2°C)

### Malfunction Caused

- Air short circuit at indoor unit
- Clogged indoor unit air filter
- Dust accumulation on the indoor unit heat exchanger
- 2/3 way valve closed
- Faulty indoor unit fan motor
- Refrigerant shortage (refrigerant leakage)
- Clogged expansion valve or strainer
- Faulty indoor pipe temperature sensor
- Faulty indoor unit PCB

### Troubleshooting

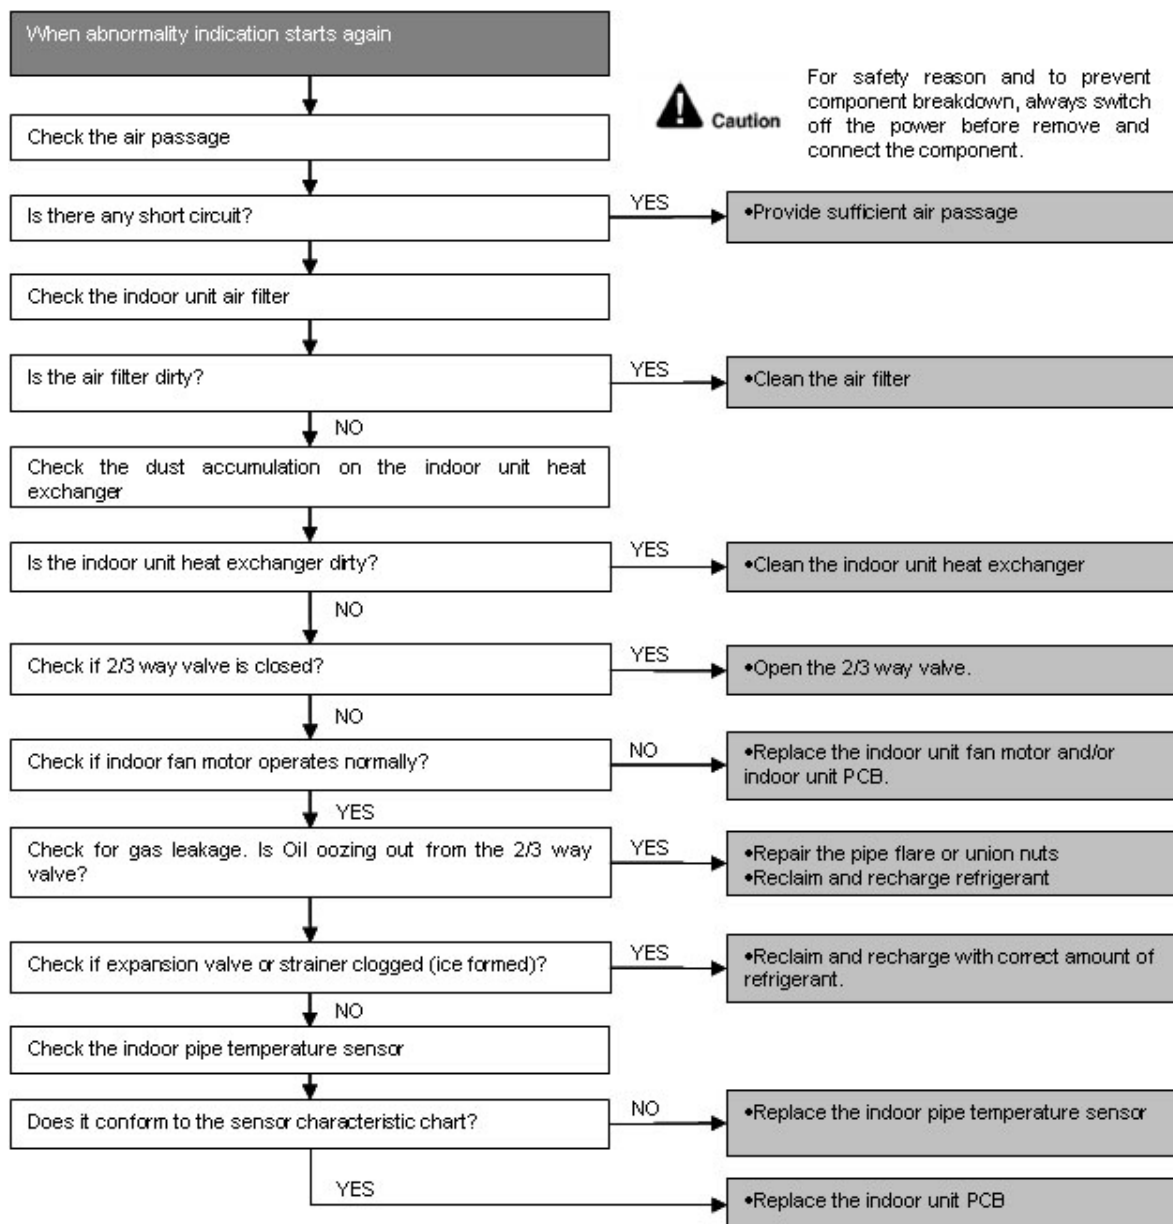

## 16.4.21. F11 (4-way valve Abnormality)


### Malfunction Decision Conditions

- When heating operation, when indoor pipe temperature is below 10°C
- When cooling operation, when indoor pipe temperature is above 45°C

### Malfunction Caused

- Connector in poor contact
- Faulty sensor
- Faulty outdoor unit PCB
- 4-way valve defective

### Troubleshooting

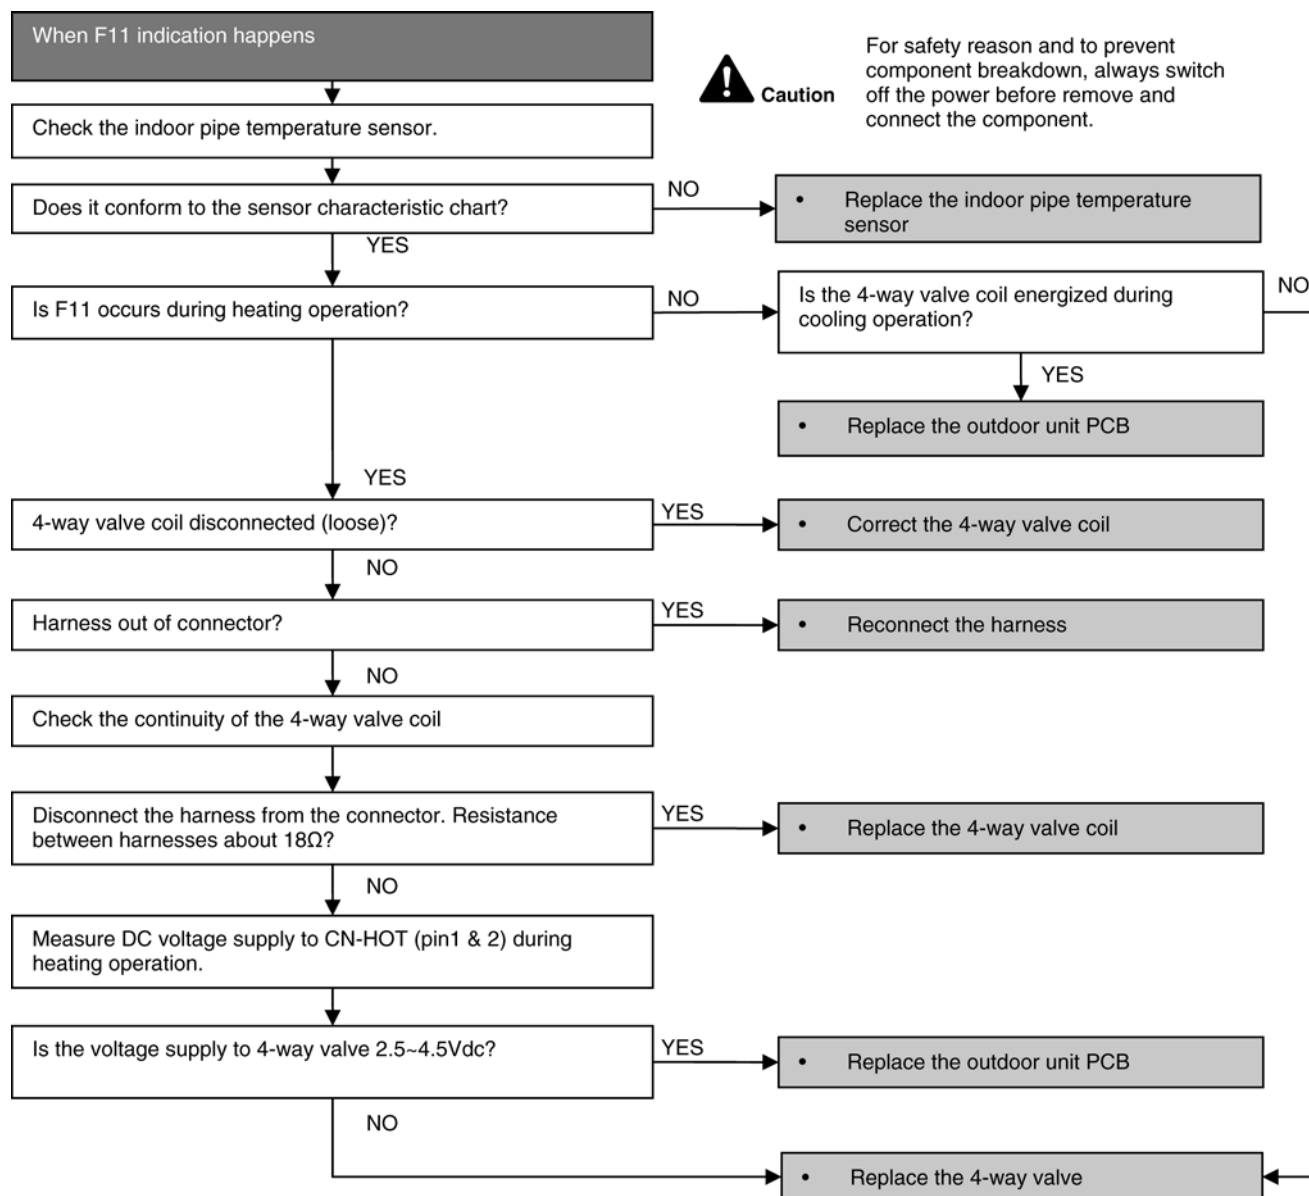

## 16.4.22. F17 (Indoor Standby Units Freezing Abnormality)

### Malfunction Decision Conditions

- When the different between indoor intake air temperature and indoor pipe temperature is above 10°C or indoor pipe temperature is below -1.0°C


### Remark:

When the indoor standby unit is freezing, the outdoor unit transfers F17 error code to the corresponding indoor unit and H39 to other indoor unit(s).

### Malfunction Caused

- Wrong wiring connection
- Faulty sensor
- Faulty expansion valve

### Troubleshooting

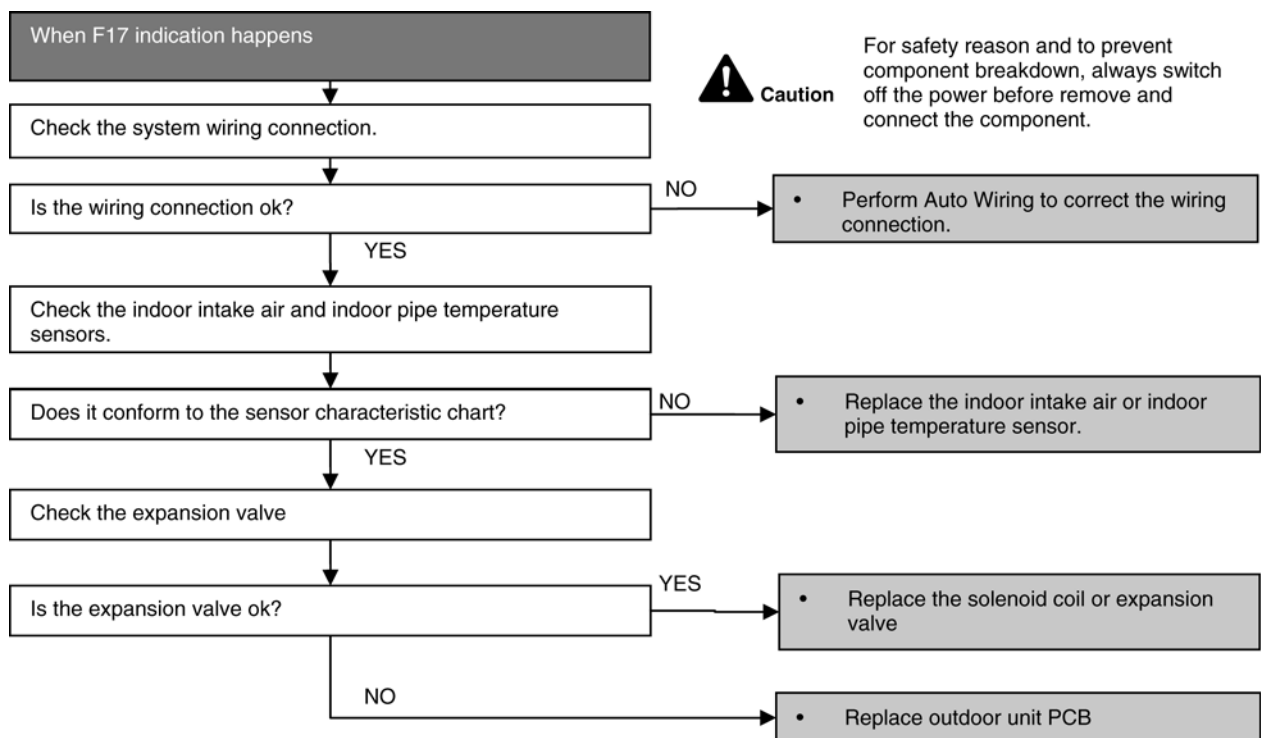

## 16.4.23. F90 (Power Factor Correction Protection)


### Malfunction Decision Conditions

During startup and operation of cooling and heating, when Power Factor Correction (PFC) protection circuitry at the outdoor unit main PCB senses abnormal high DC voltage level.

### Malfunction Caused

- DC voltage peak due to power supply surge.
- DC voltage peak due to compressor windings not uniform.
- Faulty outdoor PCB.

### Troubleshooting

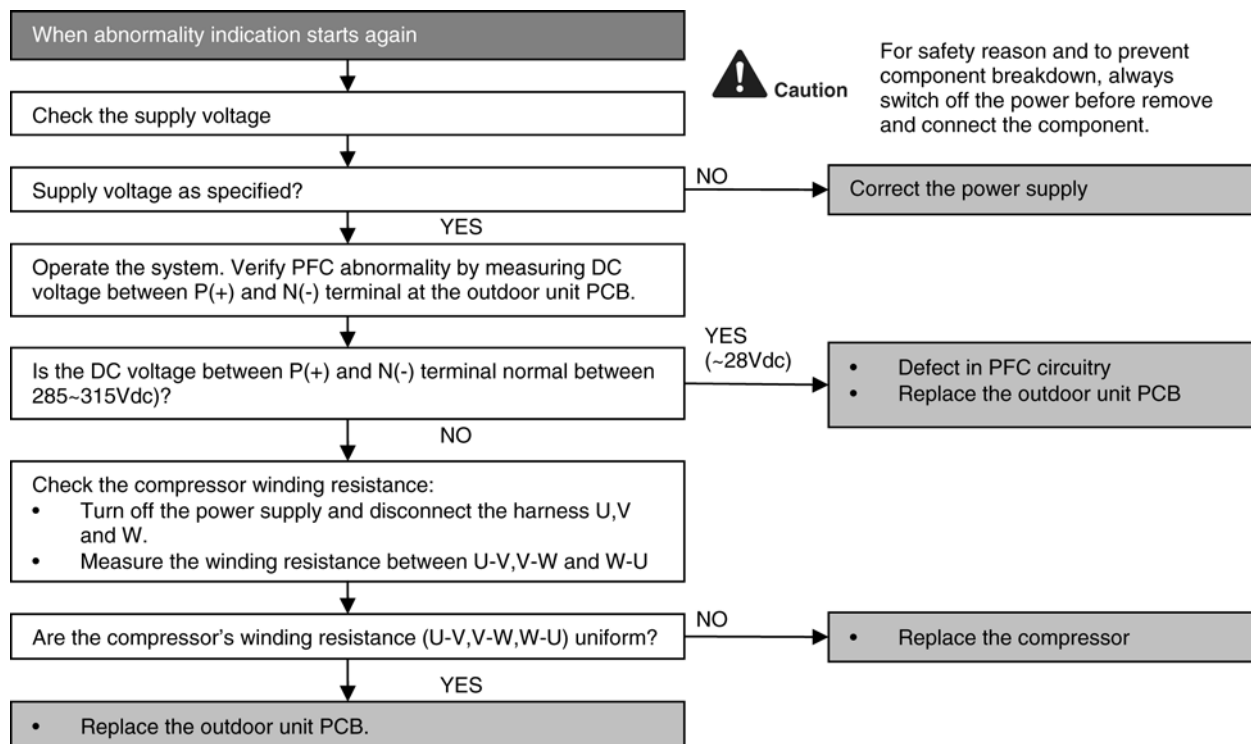



## 16.4.24. F91 (Refrigeration Cycle Abnormality)

### Malfunction Decision Conditions

- During cooling, compressor frequency = F<sub>max</sub>.
- During heating, compressor frequency > F<sub>rated</sub>.
- During cooling and heating operation, running current:  $0.65A < I < 1.65A$ .
- During cooling, indoor intake - indoor pipe < 4°C
- During heating, indoor pipe - indoor intake < 5°C


#### Multi Models Only

- Gas shortage detection 1: A gas shortage is detected by checking the CT-detected input current value and the compressor running frequency. During startup and operating of cooling and heating, input current <  $8.78/256 (A/Hz) \times$  compressor running frequency + 0.25.
- Gas shortage detection 2: A gas shortage is detected by checking the difference between indoor pipe temperature and indoor intake air temperature during cooling and heating.

### Malfunction Caused

- Faulty indoor intake air or pipe temperature sensor
- 2/3 way valve closed
- Refrigerant shortage (refrigerant leakage)
- Clogged expansion valve or strainer
- Faulty outdoor unit
- Poor compression of compressor

### Troubleshooting

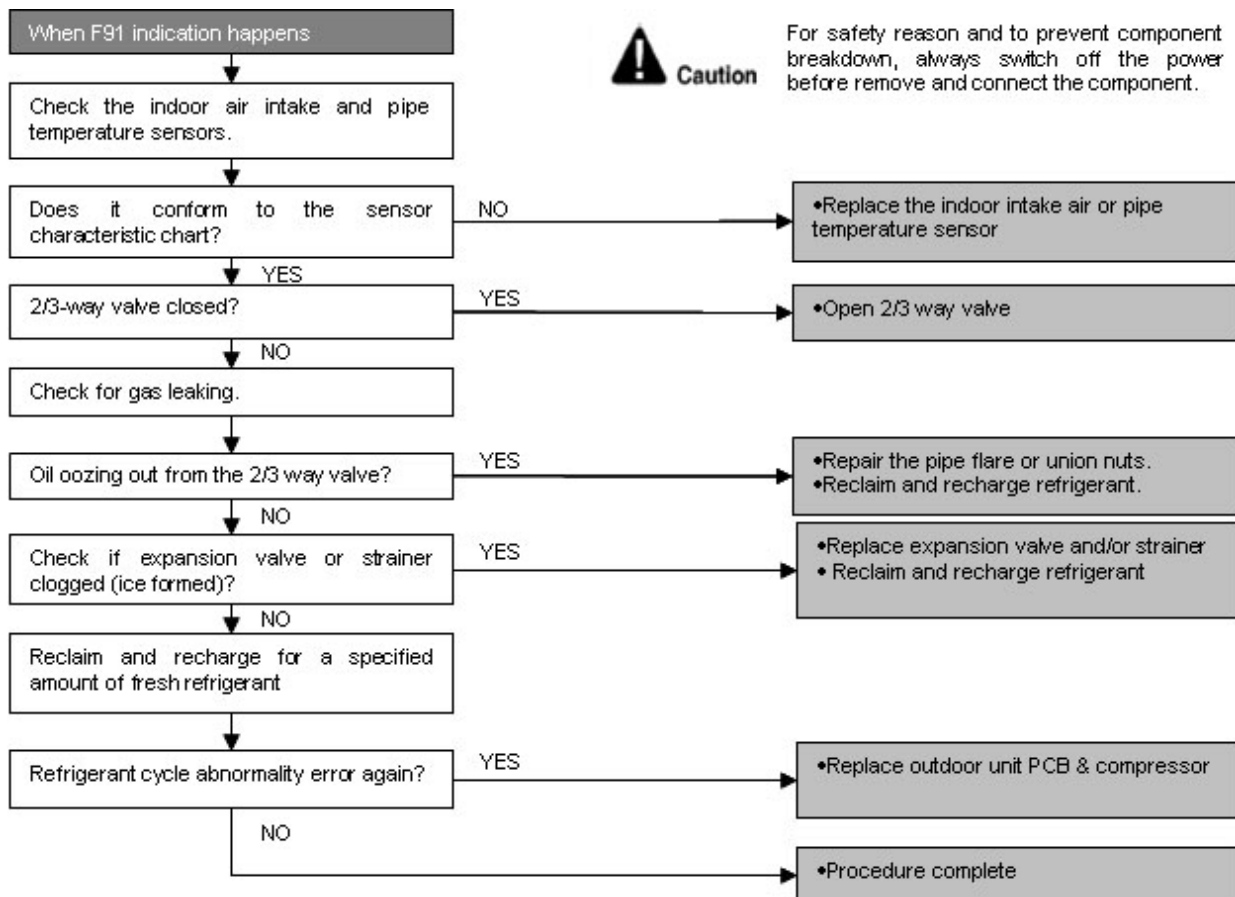

## 16.4.25. F93 (Compressor Rotation Failure)


### Malfunction Decision Conditions

A compressor rotation failure is detected by checking the compressor running condition through the position detection circuit.

### Malfunction Caused

- Compressor terminal disconnect
- Faulty Outdoor PCB
- Faulty compressor

### Troubleshooting

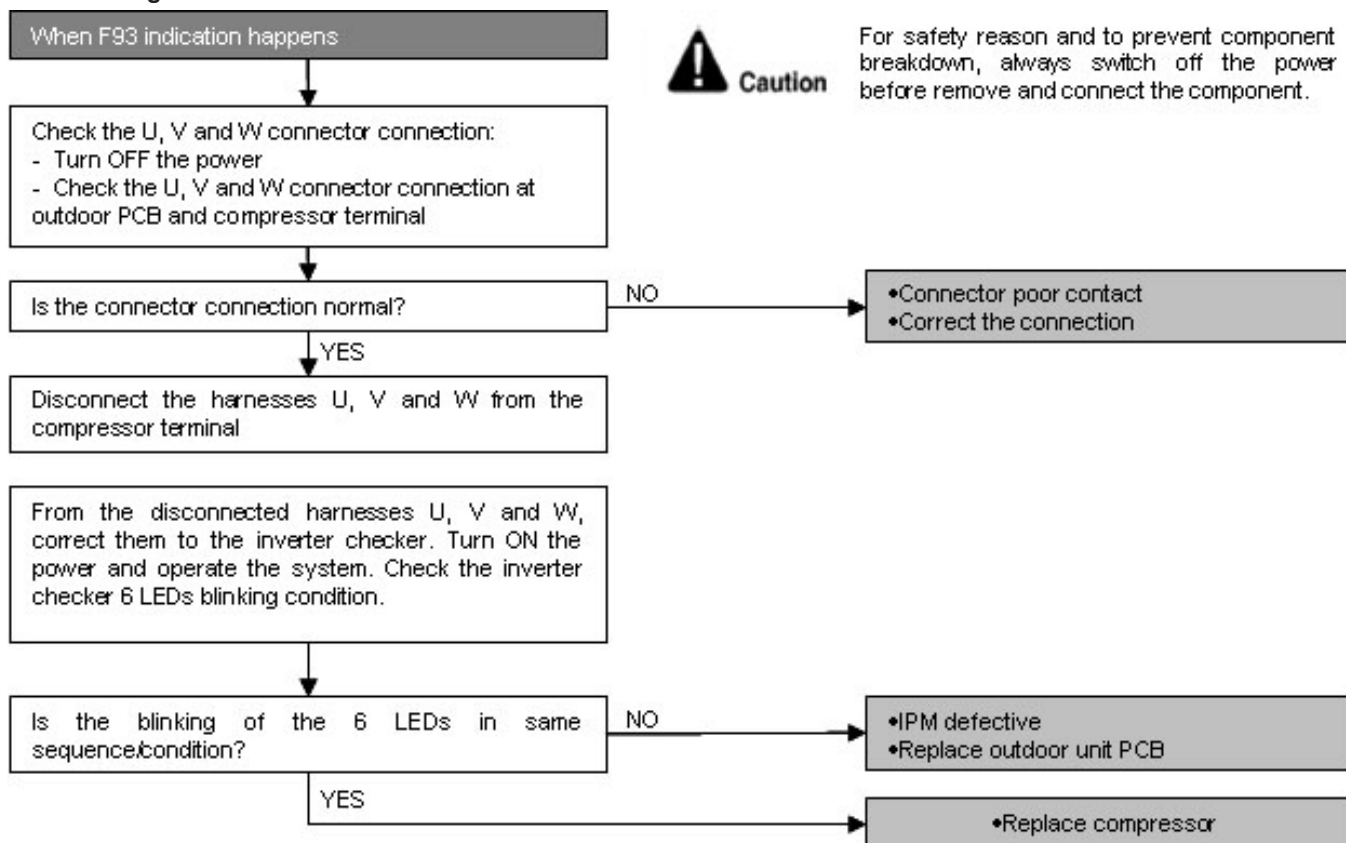

## 16.4.26. F95 (Cooling High Pressure Abnormality)


### Malfunction Decision Conditions

During operation of cooling, when outdoor unit heat exchanger high temperature data (61°C) is detected by the outdoor pipe temperature sensor.

### Malfunction Caused

- Air short circuit at outdoor unit
- Dust accumulation on the outdoor unit heat exchanger
- 2/3 way valve closed
- Faulty outdoor unit fan motor
- Excessive refrigerant
- Clogged expansion valve or strainer
- Faulty outdoor pipe temperature sensor
- Faulty outdoor unit PCB

### Troubleshooting

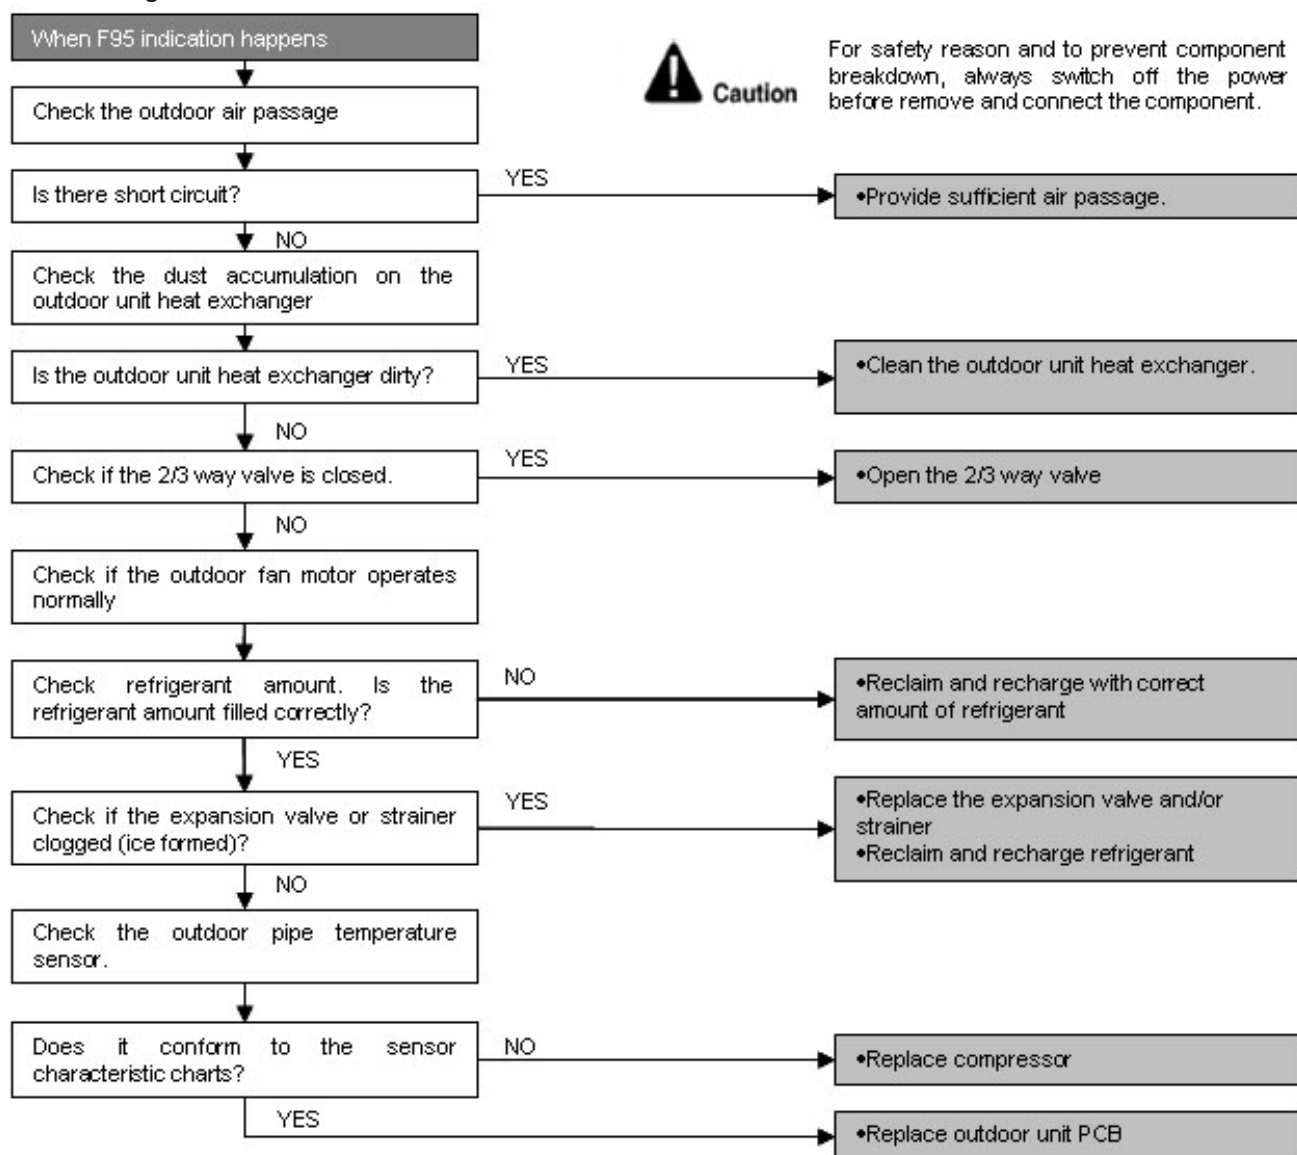

16.4.27. F96 (IPM Overheating)

Malfunction Decision Conditions

During operating of cooling and heating, when IPM temperature data (100°C) is detected by the IPM temperature sensor.

Multi Models Only

- Compressor Overheating: During operation of cooling and heating, when the compressor OL is activated.
- Heat Sink Overheating: During operation of cooling and heating, when heat sink temperature data (90°C) is detected by the heat sink temperature sensor.


Malfunction Caused

- IPM overheats due to short circuit of hot discharge air flow.
- IPM overheats due to defective of outdoor fan motor.
- IPM overheats due to defective of internal circuitry of IPM.
- IPM overheats due to defective IPM temperature sensor.

Multi Models Only

- Compressor OL connector poor contact.
- Compressor OL faulty.

Troubleshooting

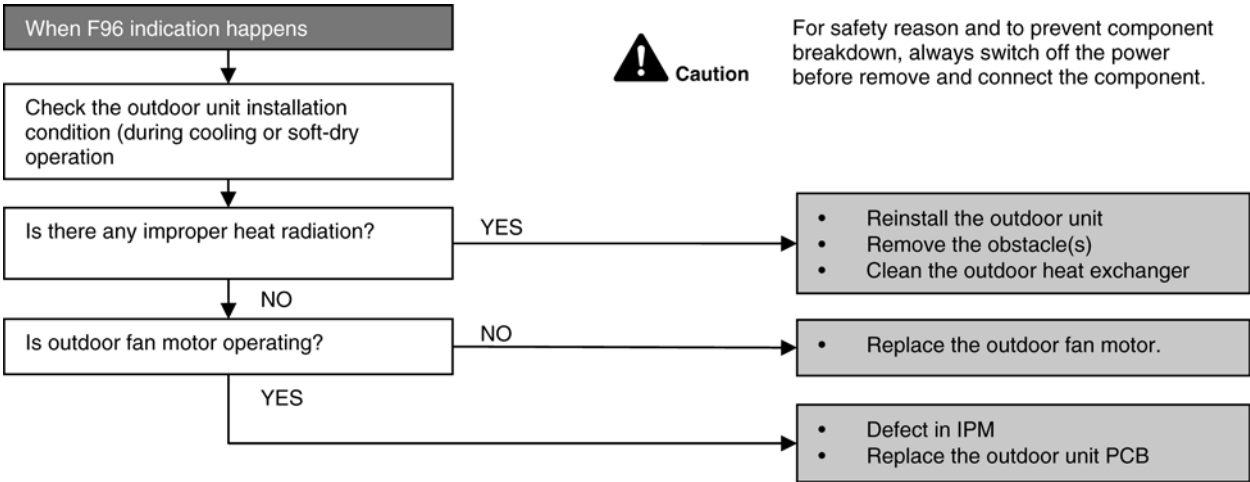

## 16.4.28. F97 (Compressor Overheating)


### Malfunction Decision Conditions

During operation of cooling and heating, when compressor tank temperature data (112°C) is detected by the compressor tank temperature sensor.

### Malfunction Caused

- Faulty compressor tank temperature sensor
- 2/3 way valve closed
- Refrigerant shortage (refrigerant leakage)
- Faulty outdoor unit PCB
- Faulty compressor

### Troubleshooting

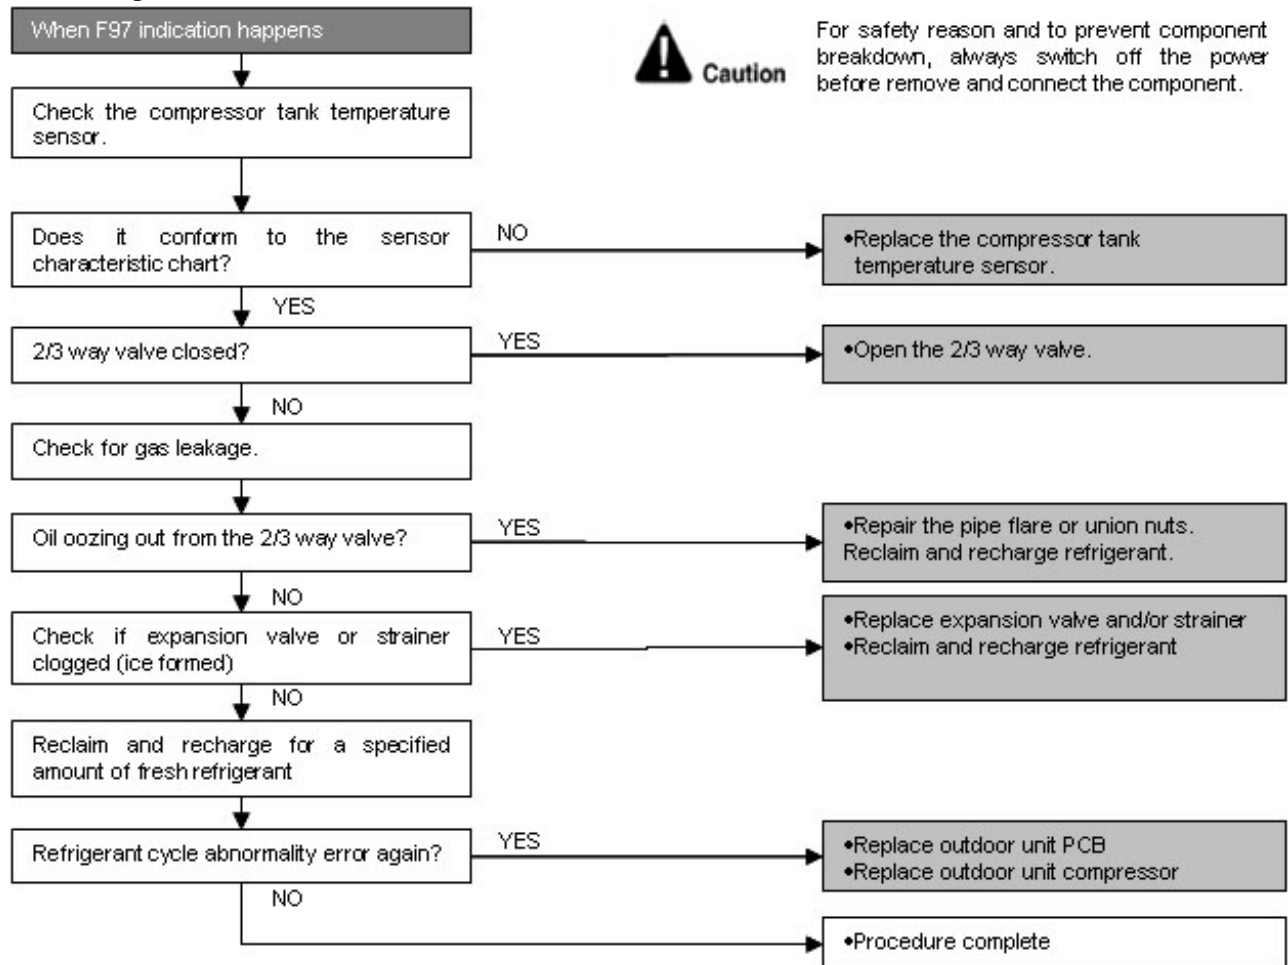

## 16.4.29. F98 (Input Over Current Detection)


### Malfunction Decision Conditions

During operation of cooling and heating, when an input over-current (X value in Total Running Current Control) is detected by checking the input current value being detected by current transformer (CT) with the compressor running.

### Malfunction Caused

- Excessive refrigerant.
- Faulty outdoor unit PCB.

### Troubleshooting

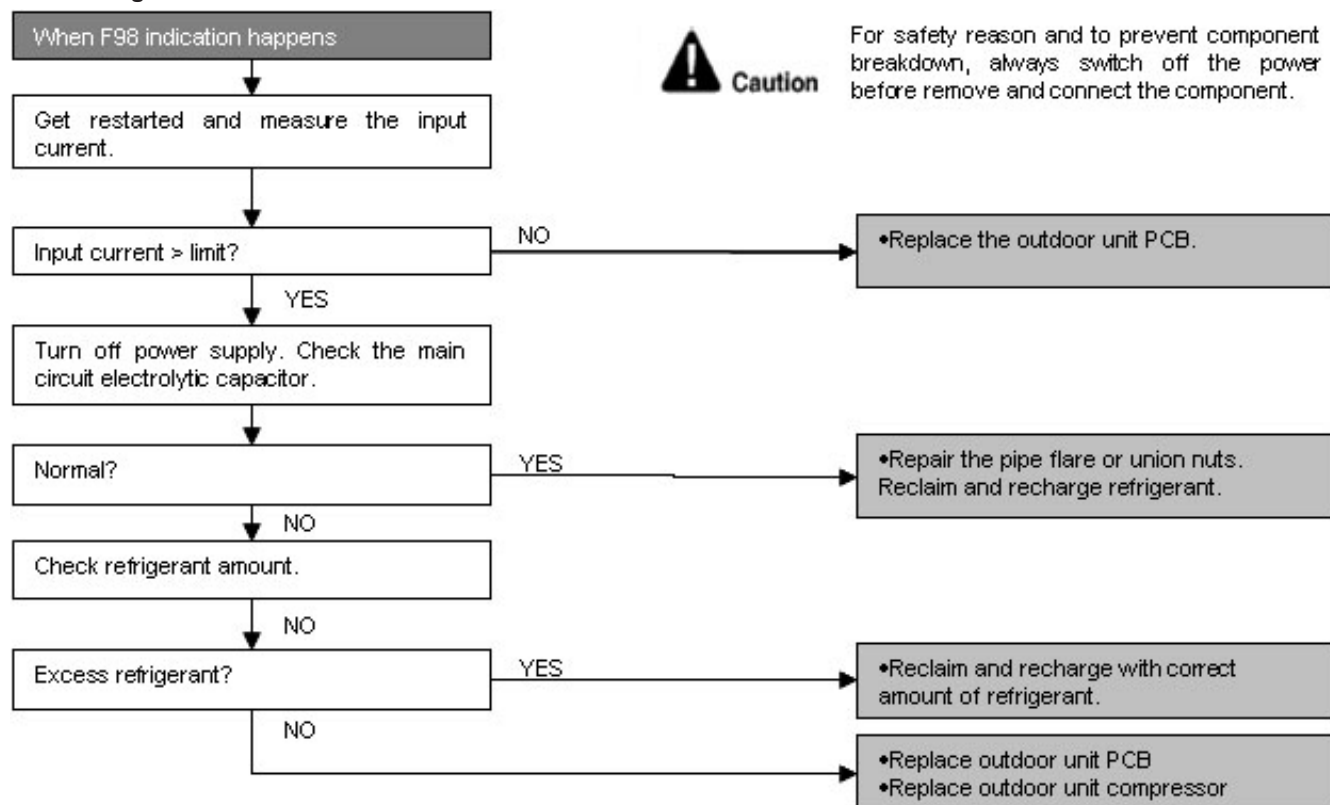

### 16.4.30. F99 (Output Over Current Detection)


#### Malfunction Decision Conditions

During operation of cooling and heating, when an output over-current (DC peak current value at IPM Prevention Control) is detected by checking the current that flows in the inverter DC peak sensing circuitry.

#### Malfunction Caused

- Faulty outdoor unit PCB
- Faulty compressor

#### Troubleshooting

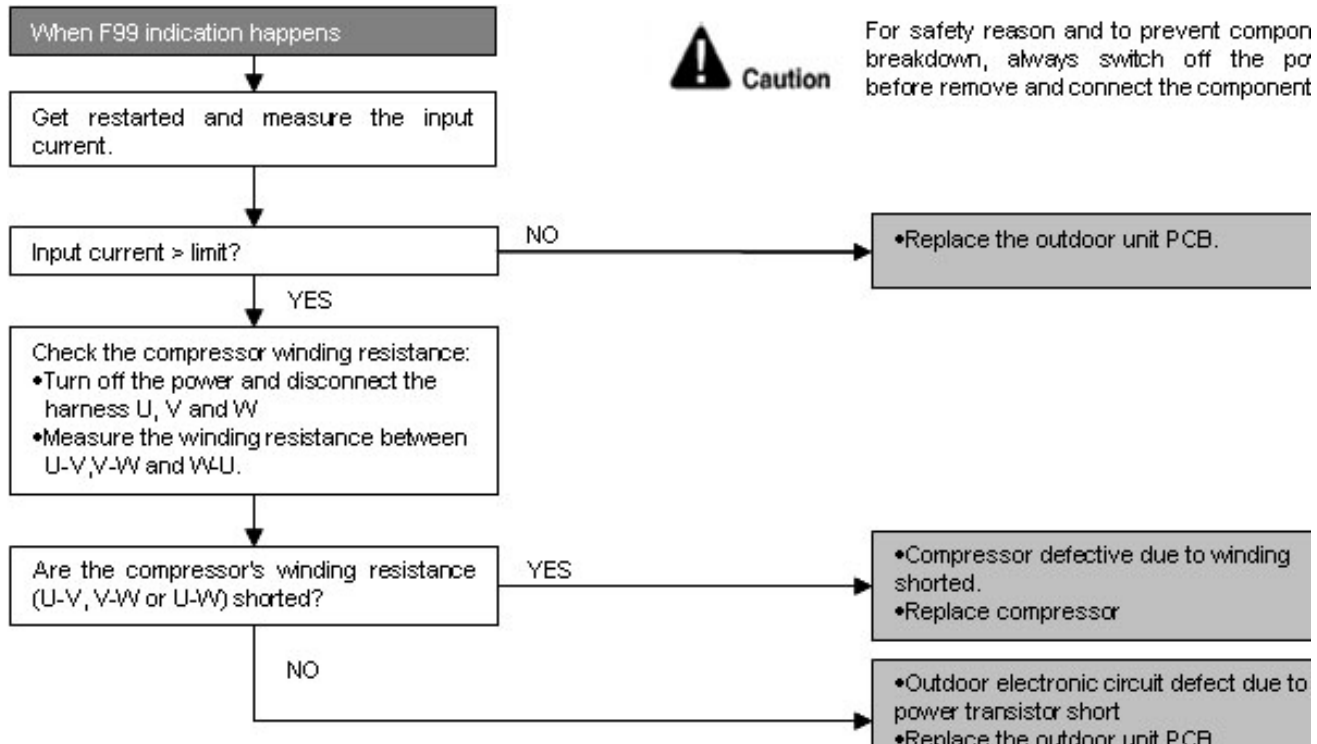

- Checking the power transistor
- Never touch any live parts for at least 10 minutes after turning off the circuit breaker.
- If unavoidable necessary to touch a live part, make sure the power transistor's supply voltage is below 50V using the tester.
- For the UVW, make measurement at the Faston terminal on the board of the relay connector.

Tester's negative terminal	Power transistor (+)	UVW	Power transistor (-)	UVW
Tester's positive terminal	UVW	Power transistor (+)	UVW	Power transistor (-)
Normal resistance	Several kΩ to several MΩ			
Abnormal resistance	0 or ∞			

# 17 Disassembly and Assembly Instructions

## WARNING

High voltages are generated in the electrical parts area by the capacitor. Ensure that the capacitor has discharged sufficiently before proceeding with repair work. Failure to heed this caution may result in electric shocks.

### 17.1. CS-E7LK CS-E9LK CS-E12LK CS-E15LK

#### 17.1.1. Indoor Electronic Controllers, Cross Flow Fan and Indoor Fan Motor Removal Procedures

##### 17.1.1.1. To remove front grille


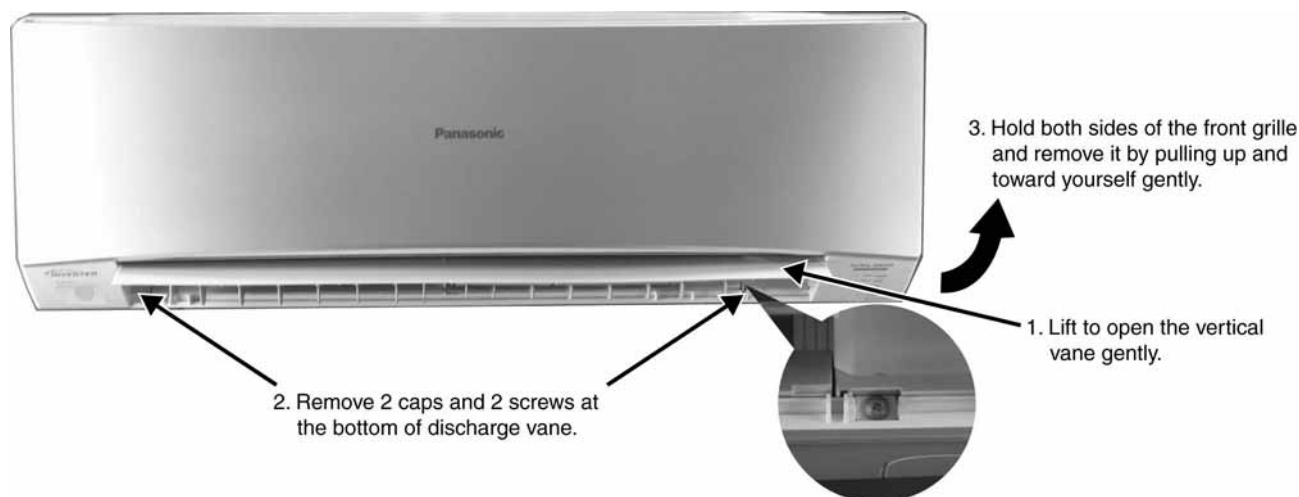


Figure 1

##### 17.1.1.2. To remove power electronic controller



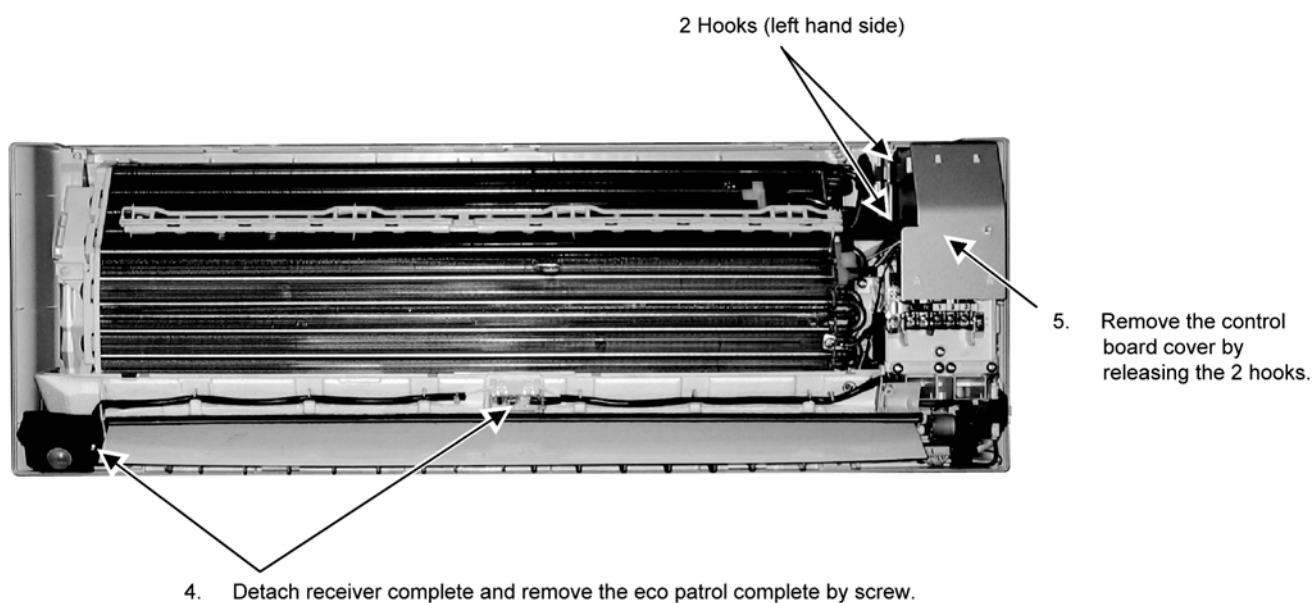

### 17.1.1.3. To remove power electronic controller

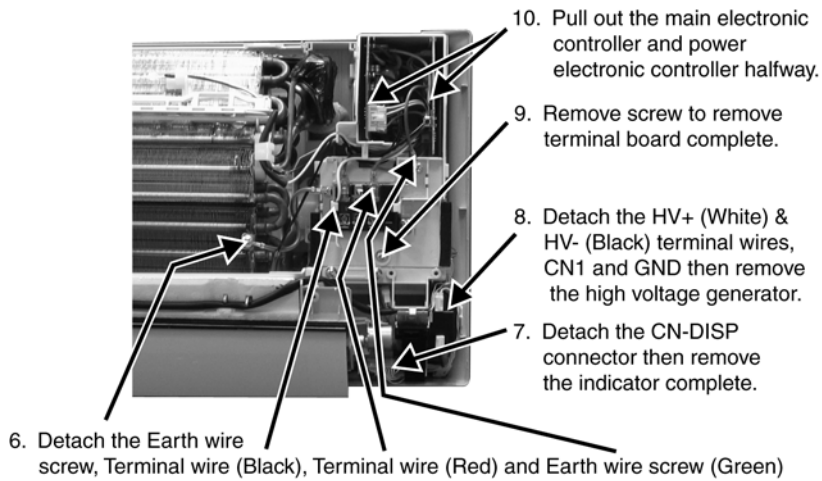


Figure 3

11. Detach 5 connectors as labeled from the electronic controller. Then pull out main controller gently.

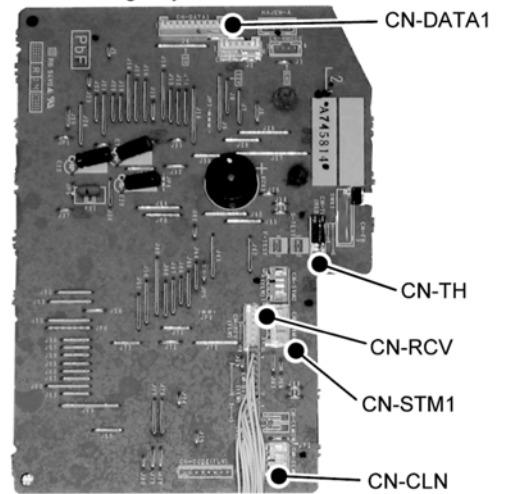


Figure 4

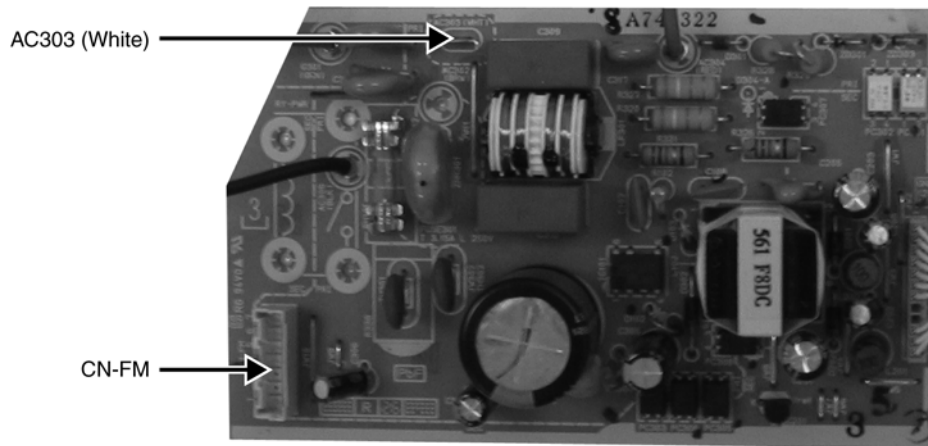


Figure 5

12. Detach the AC303 and CN-FM connectors from the electronic controller. Then, pull out power electronic controller gently.

### 17.1.1.4. To remove discharge grille

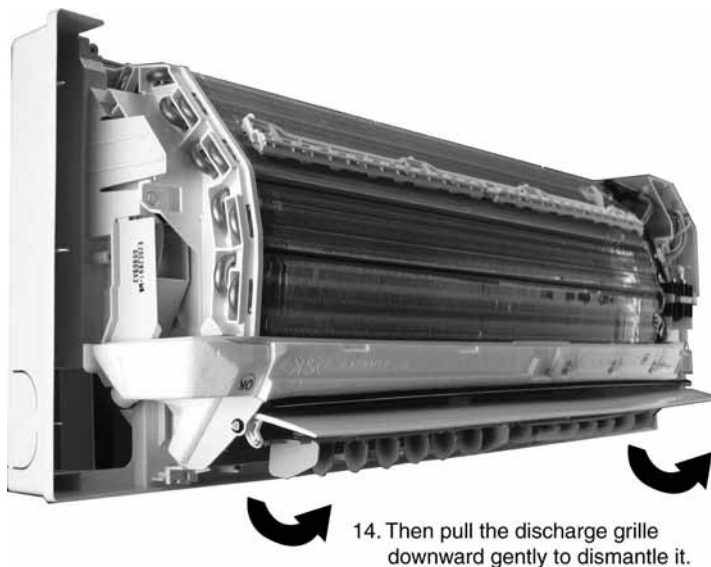


Figure 6

#### 17.1.1.5. To remove control board

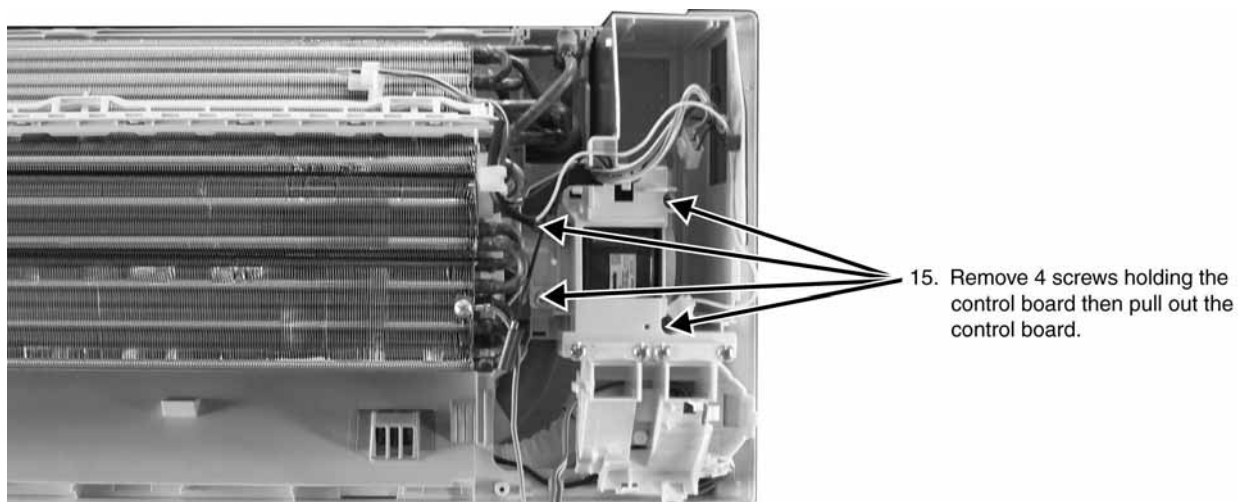


Figure 7

#### 17.1.1.6. To remove cross flow fan and indoor fan motor

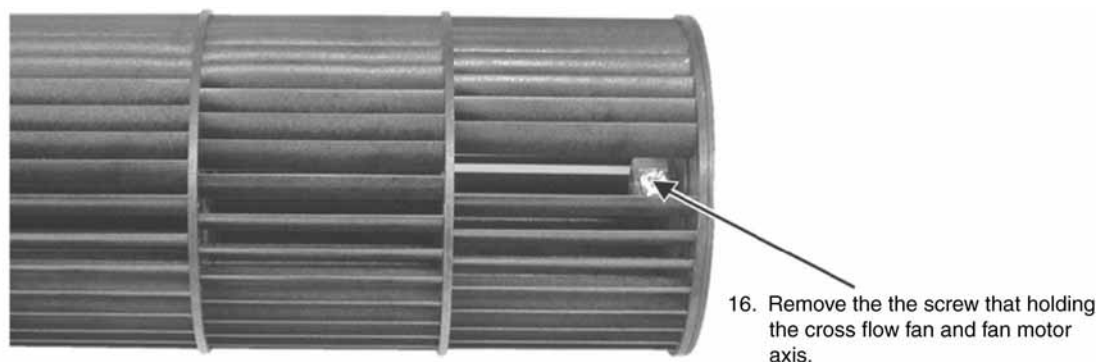


Figure 8

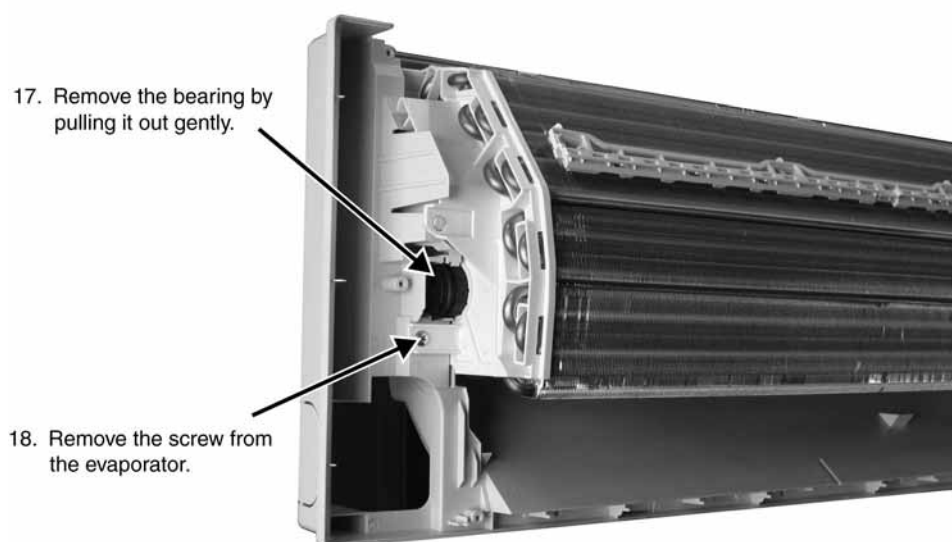
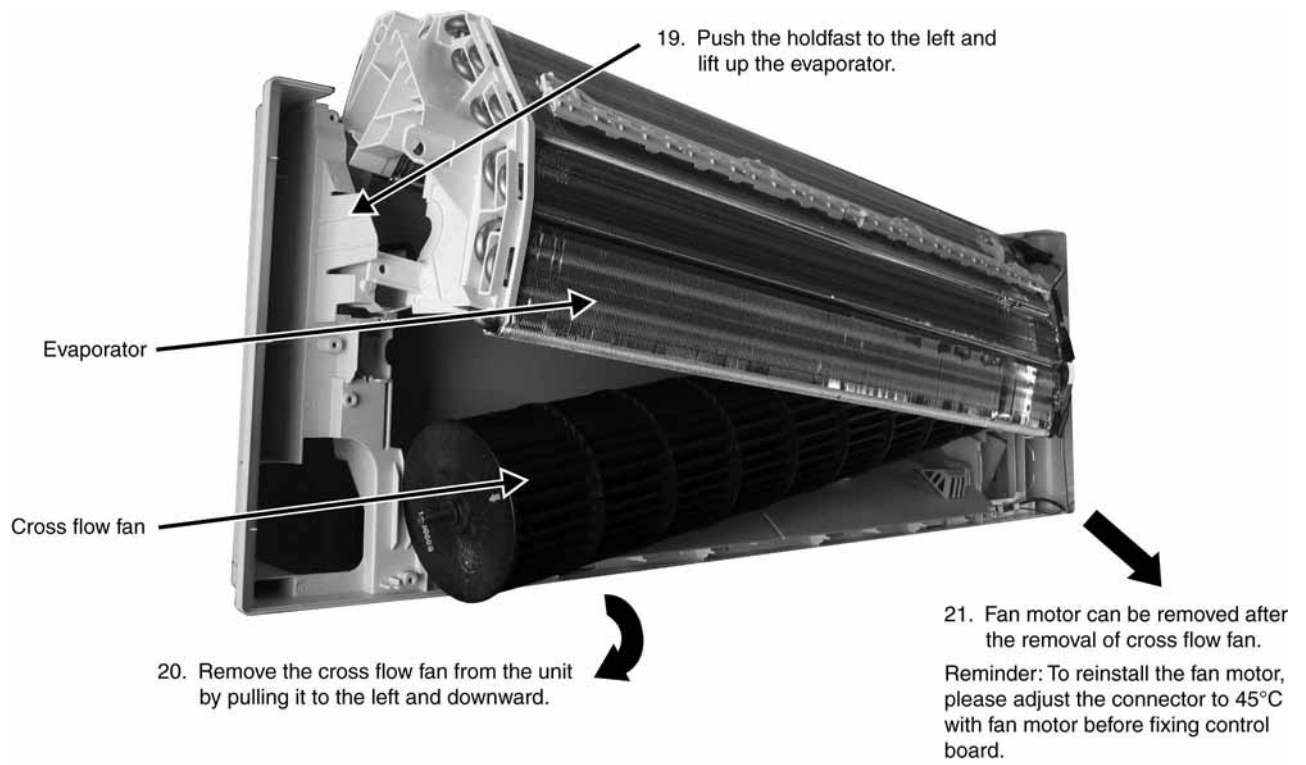
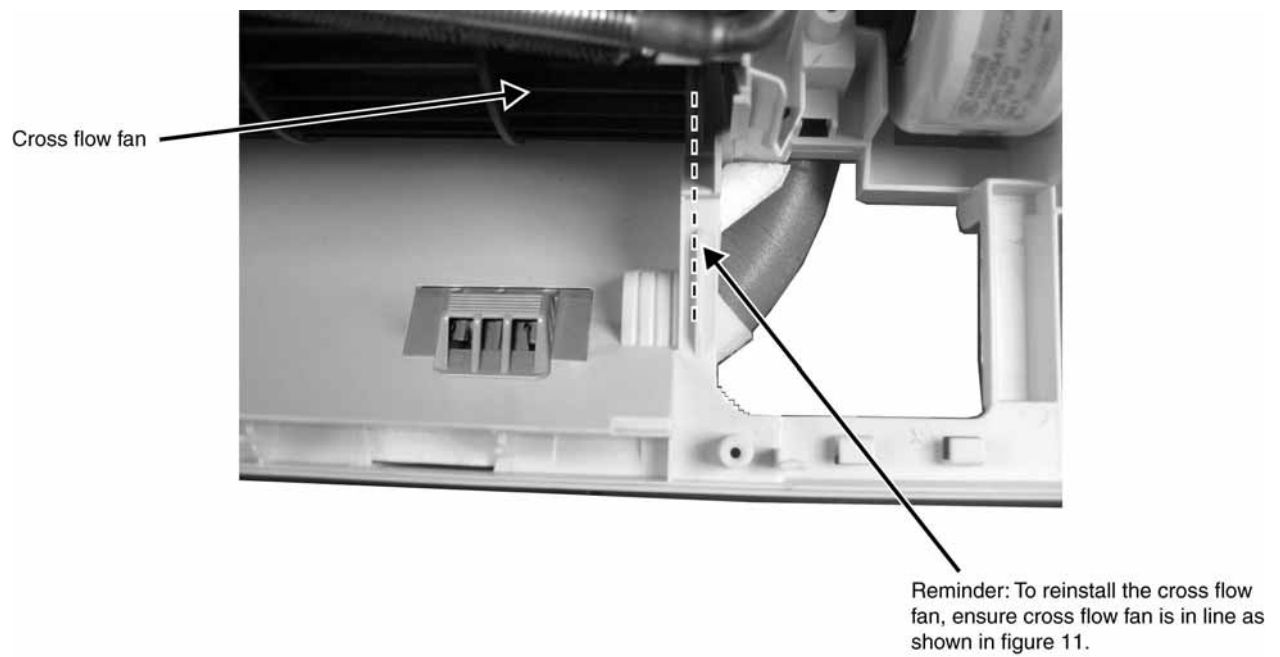


Figure 9



**Figure 10**



**Figure 11**

## 17.2. CS-E18LK CS-E21LK

### 17.2.1. Indoor Electronic Controllers, Cross Flow Fan and Indoor Fan Motor Removal Procedures

#### 17.2.1.1. To remove front grille

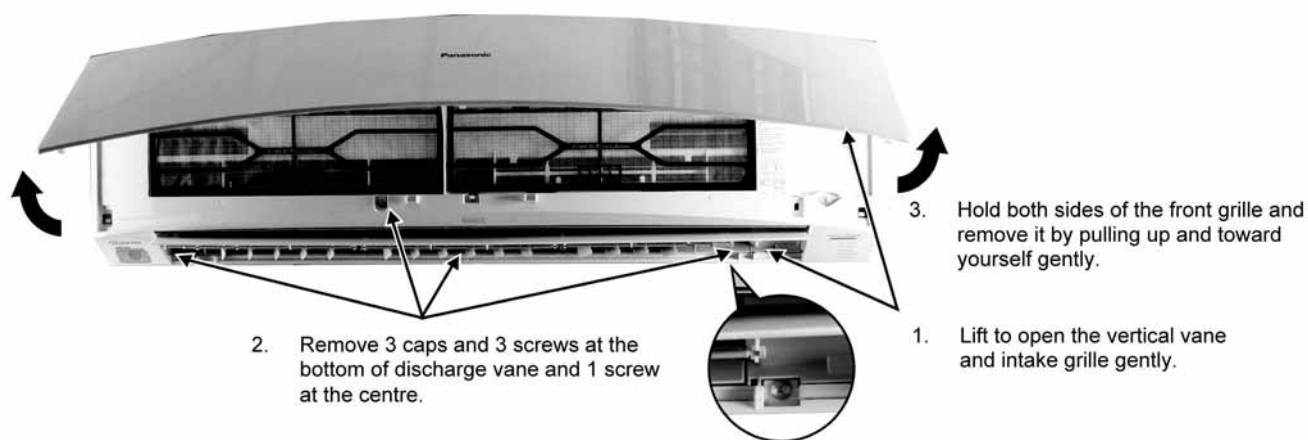


Figure 1

#### 17.2.1.2. To remove horizontal vane

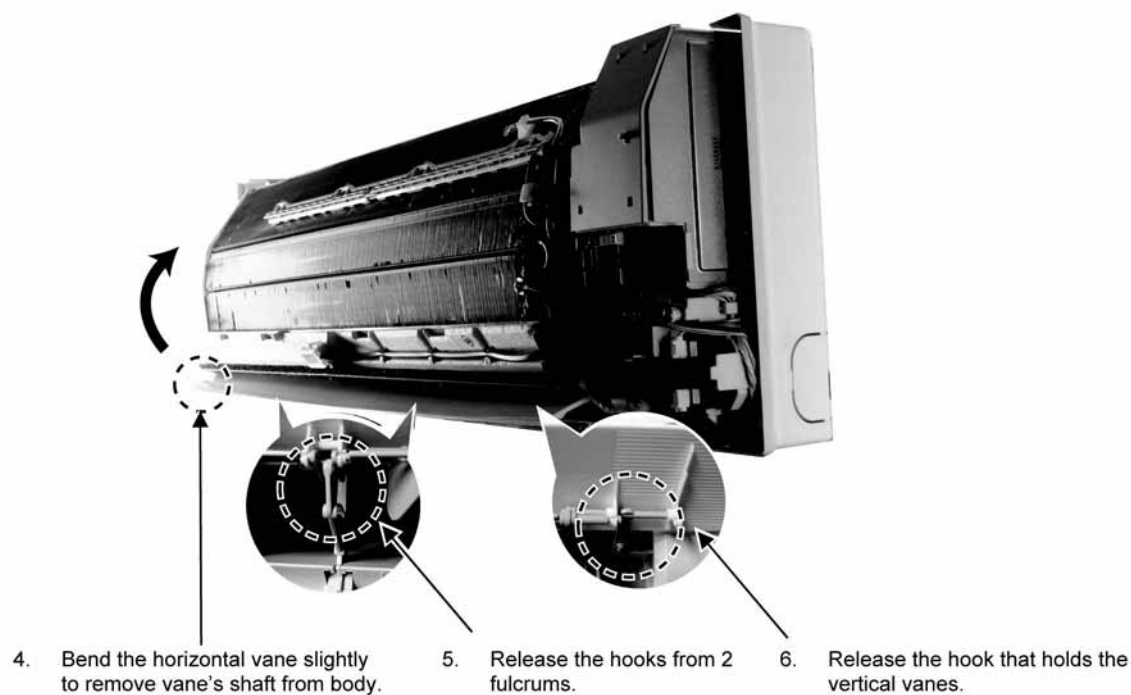


Figure 2

### 17.2.1.3. To remove power electronic controller

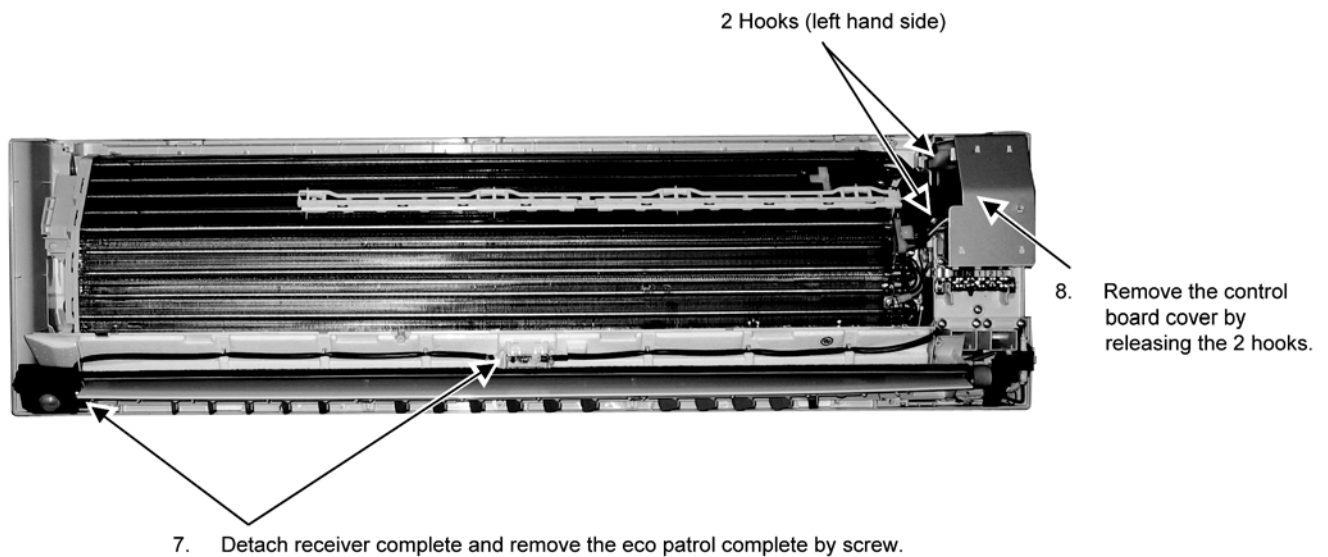


Figure 3

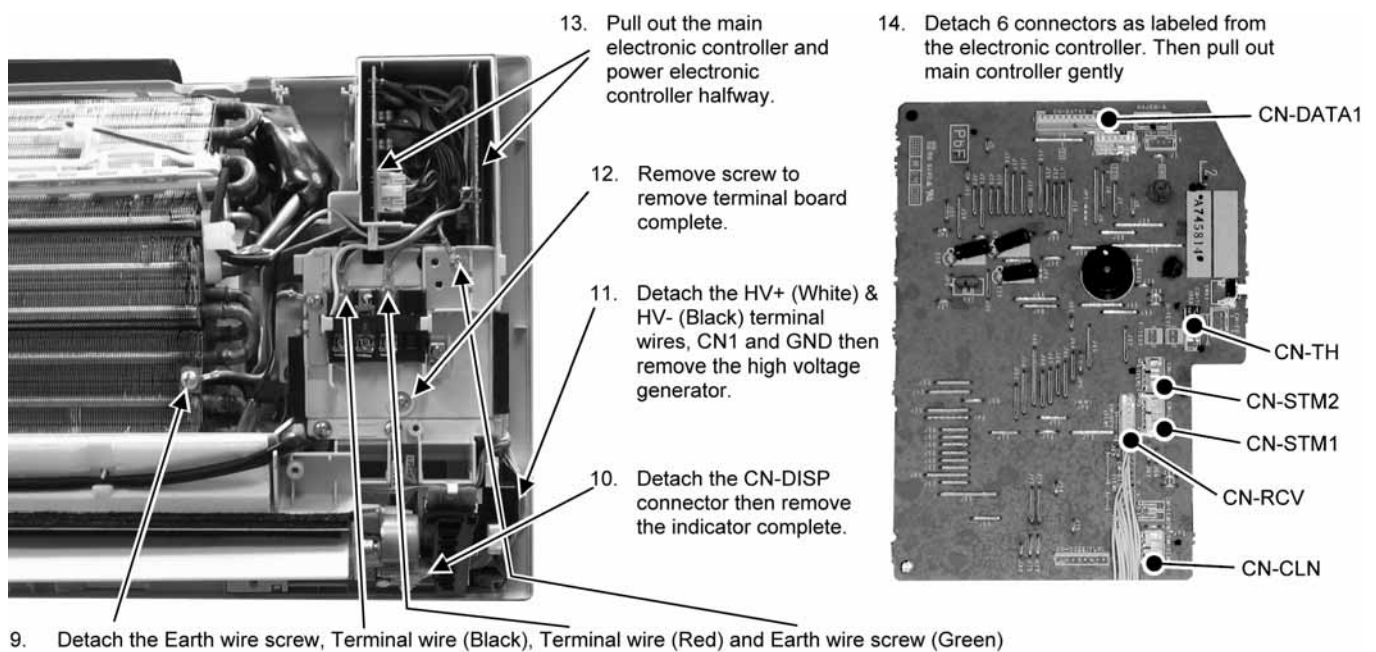


Figure 4

Figure 5

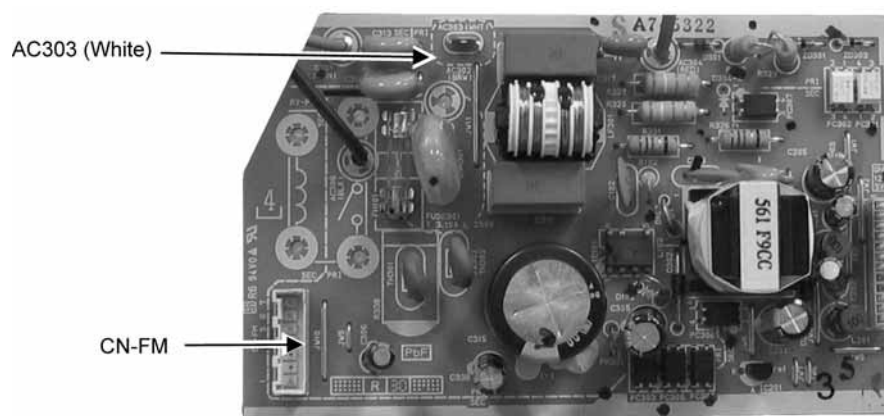


Figure 6

15. Detach the AC303 and CN-FM connectors from the electronic controller. Then pull out power electronic controller gently.

#### 17.2.1.4. To remove discharge grille

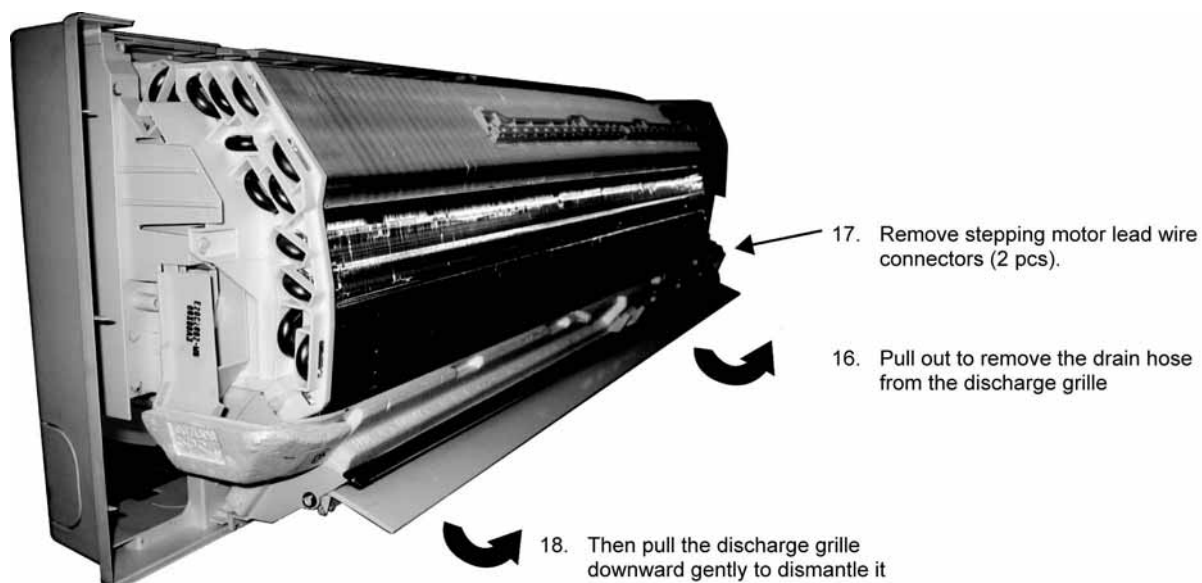


Figure 7

#### 17.2.1.5. To remove control board

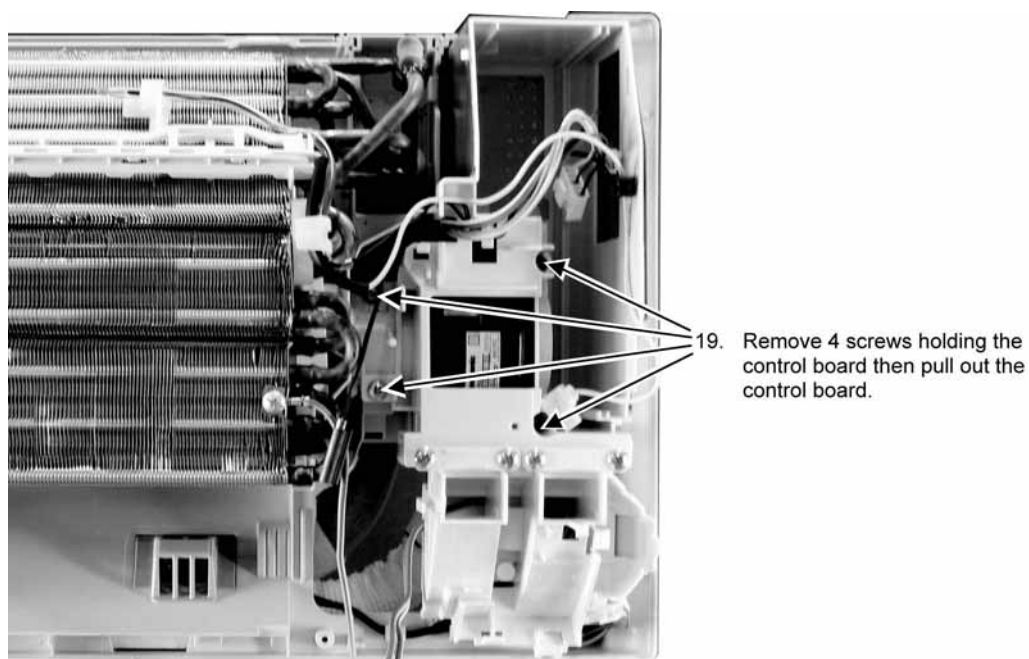


Figure 8

#### 17.2.1.6. To remove cross flow fan and indoor fan motor

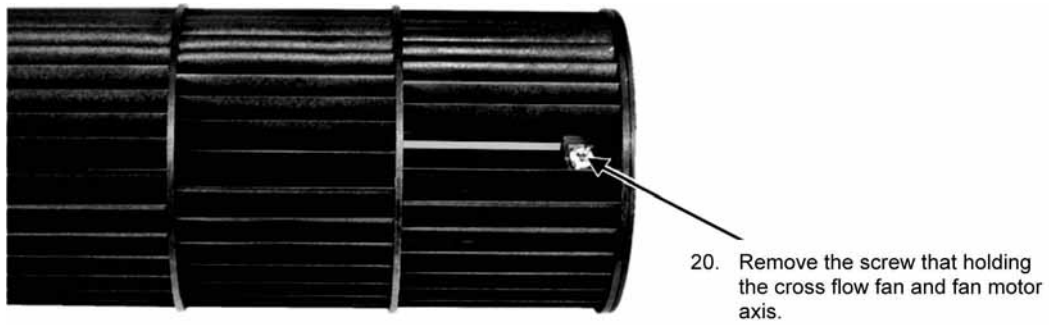


Figure 9


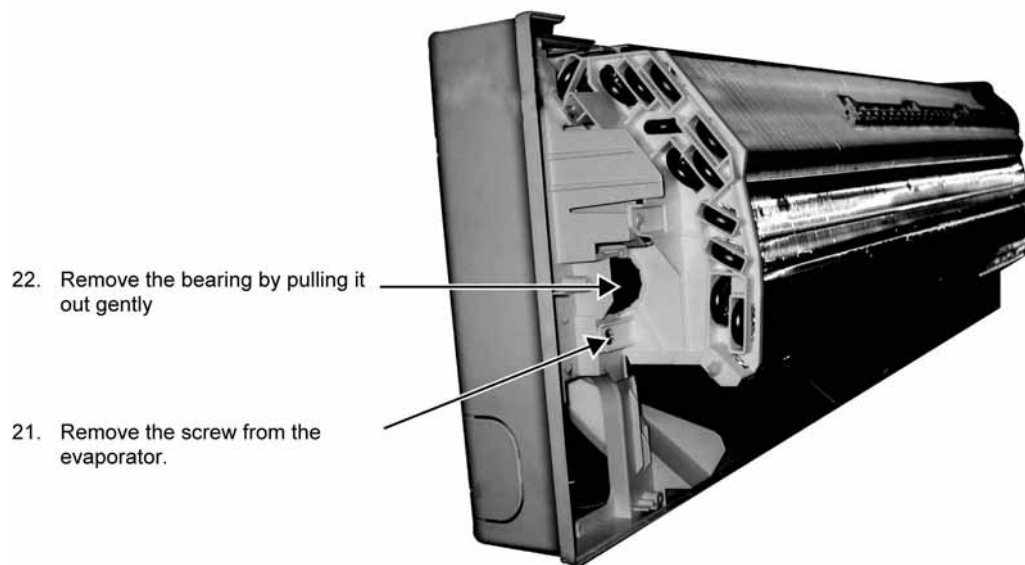


Figure 10

23. Push the holdfast to the left and lift up the evaporator.

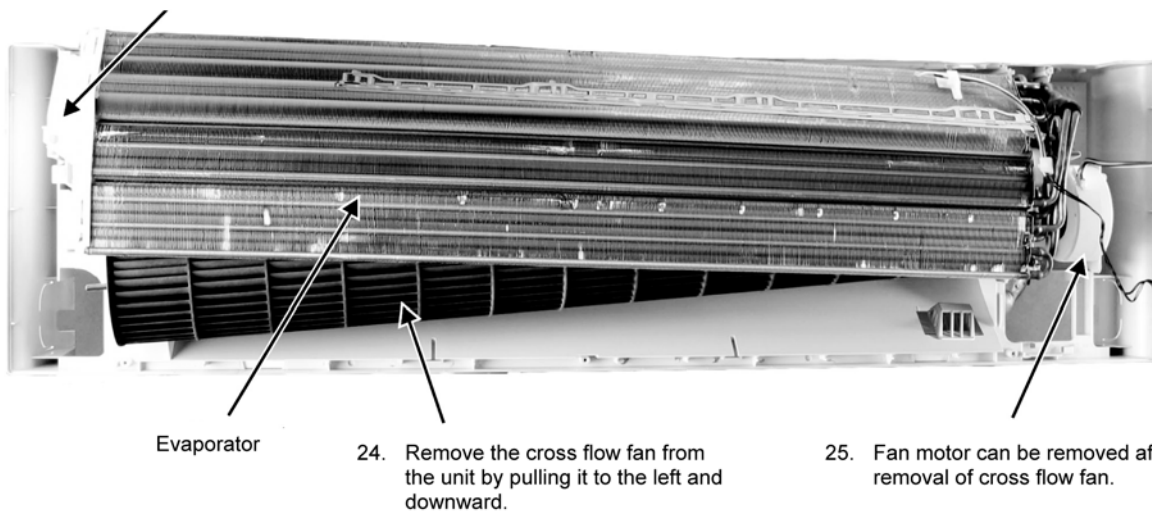

Reminder: To reinstall the fan motor, adjust the fan motor connector to 45° towards you before fixing control board.

Figure 11

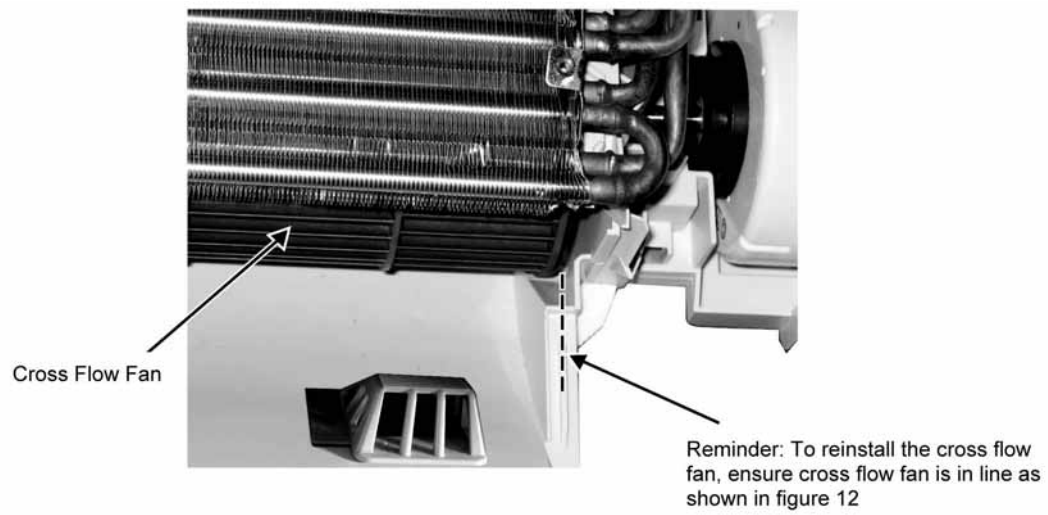



Figure 12



## 17.3. Outdoor Electronic Controller Removal Procedure

### 17.3.1. CU-E7LKE CU-E9LKE CU-E12LKE CU-E15LKE CU-E7LKE-3 CU-E9LKE-3 CU-E12LKE-3

 Caution! When handling electronic controller, be careful of electrostatic discharge.

1. Remove the 3 screws of the Top Panel.

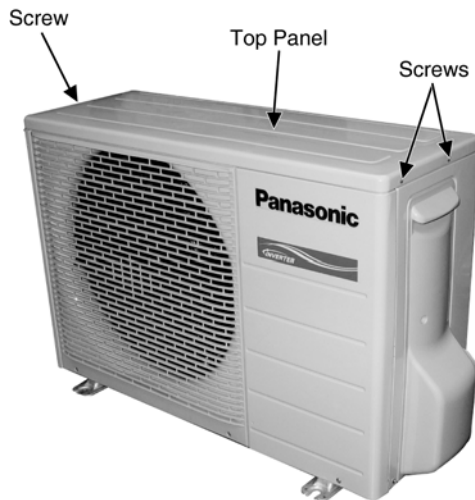


Fig. 1

2. Remove the 6 screws of the Front Panel.

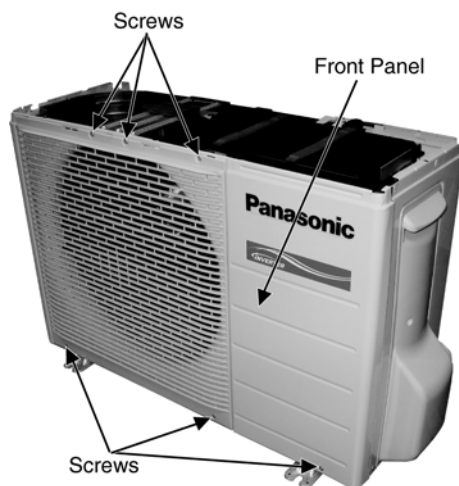


Fig. 2

3. Remove the screw of the Terminal Board Cover.  
4. Remove the Top Cover of the Control Board by 4 hooks.

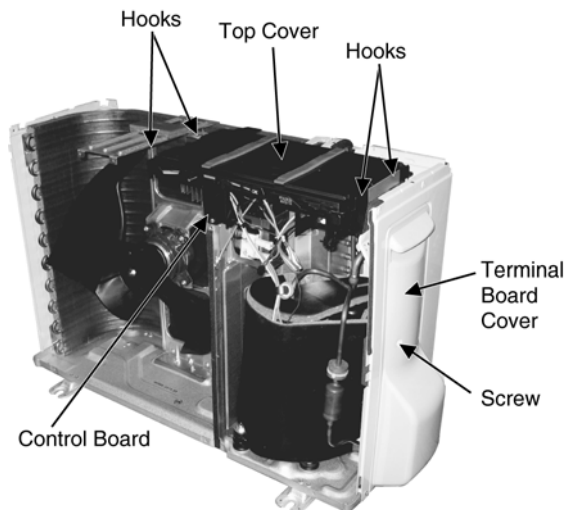


Fig. 3

5. Remove the Control Board as follows:

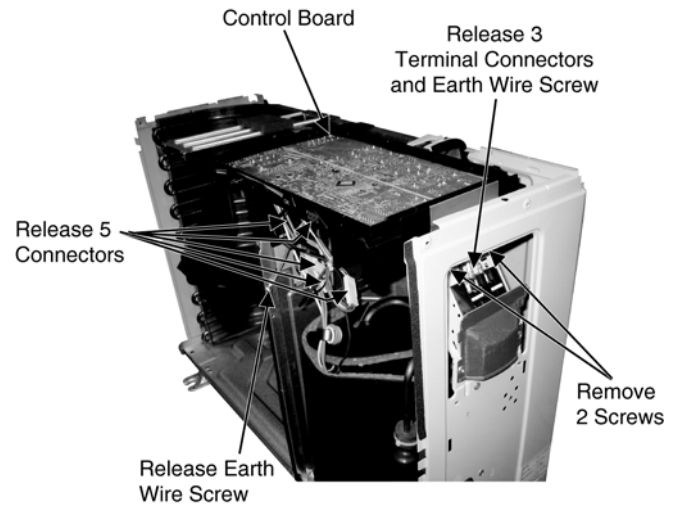


Fig. 4

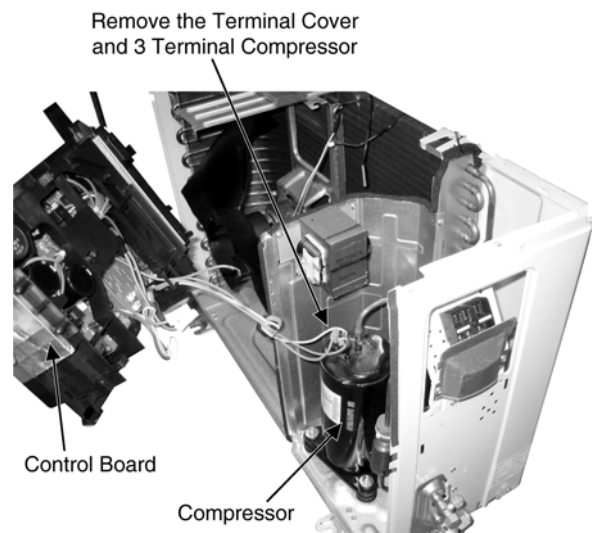


Fig. 5

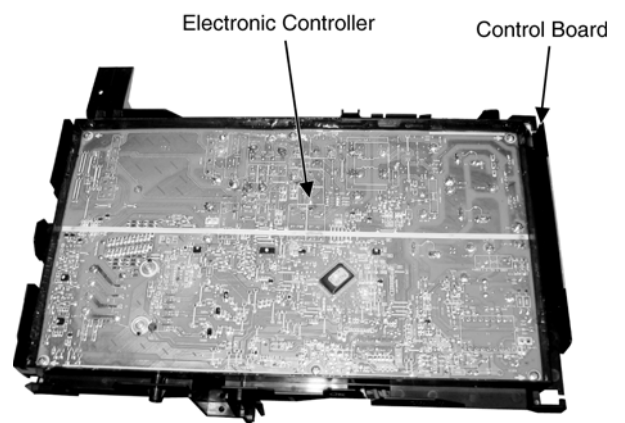


Fig. 6

### 17.3.2. CU-E18LKE CU-E21LKE

1. Remove the 4 screws of the Top Panel.

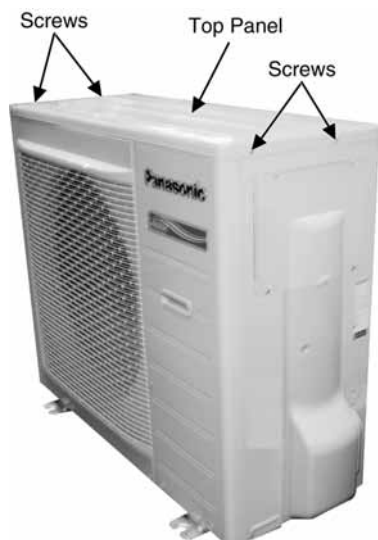


Fig. 1

2. Remove the 10 screws of the Front Panel.

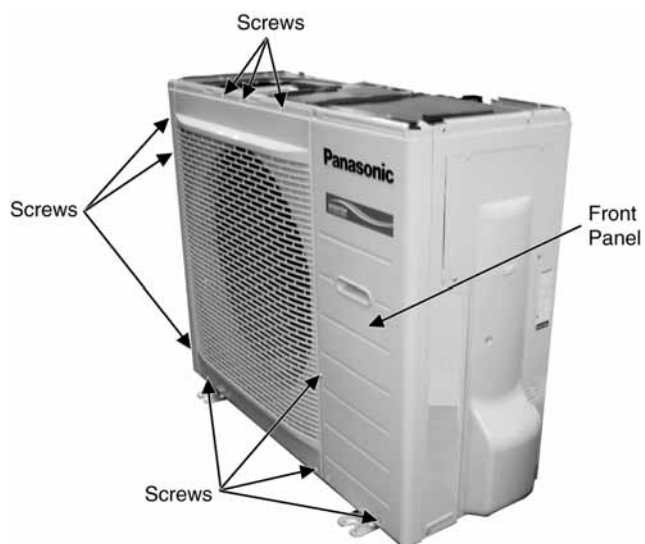


Fig. 2

3. Remove the Top Cover of the Electronic Controller.



Fig. 3

4. Remove the Control Board.

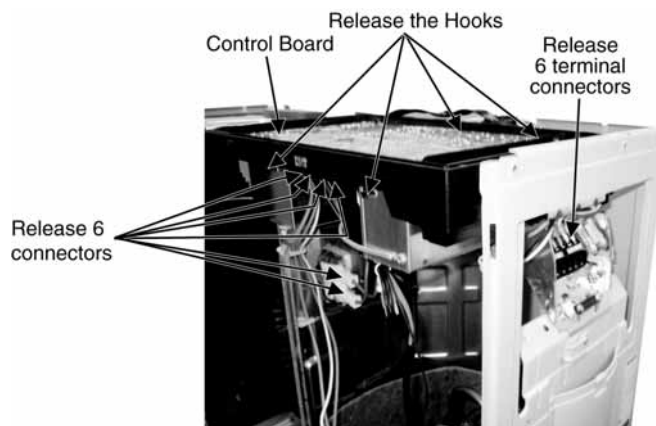


Fig. 4

5. Remove the 8 screws of the Electronic Controller.

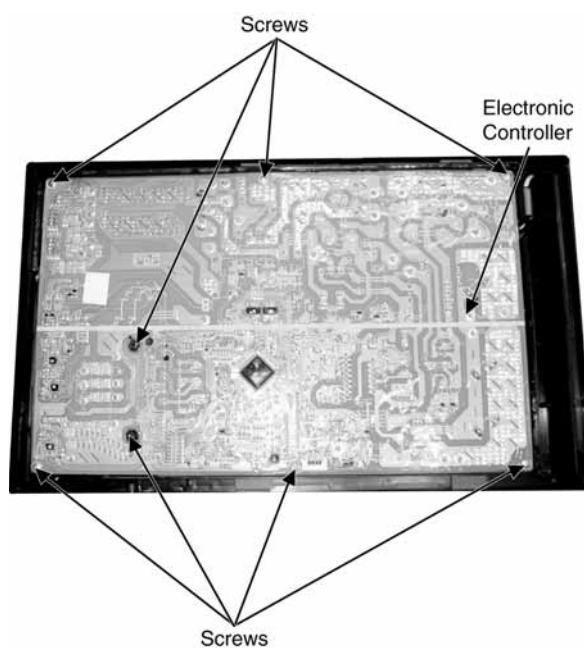


Fig. 5

⚠ Caution! When handling electronic controller, be careful of electrostatic discharge.


# 18 Technical Data

## 18.1. Operation Characteristics

### 18.1.1. CU-E7LKE





• Cooling Characteristic

[Condition] Indoor temperature: 27/19°C  
Remote condition: High fan speed, Cool 16°C  
Comp. Hz: F<sub>c</sub>  
Voltage: 230V

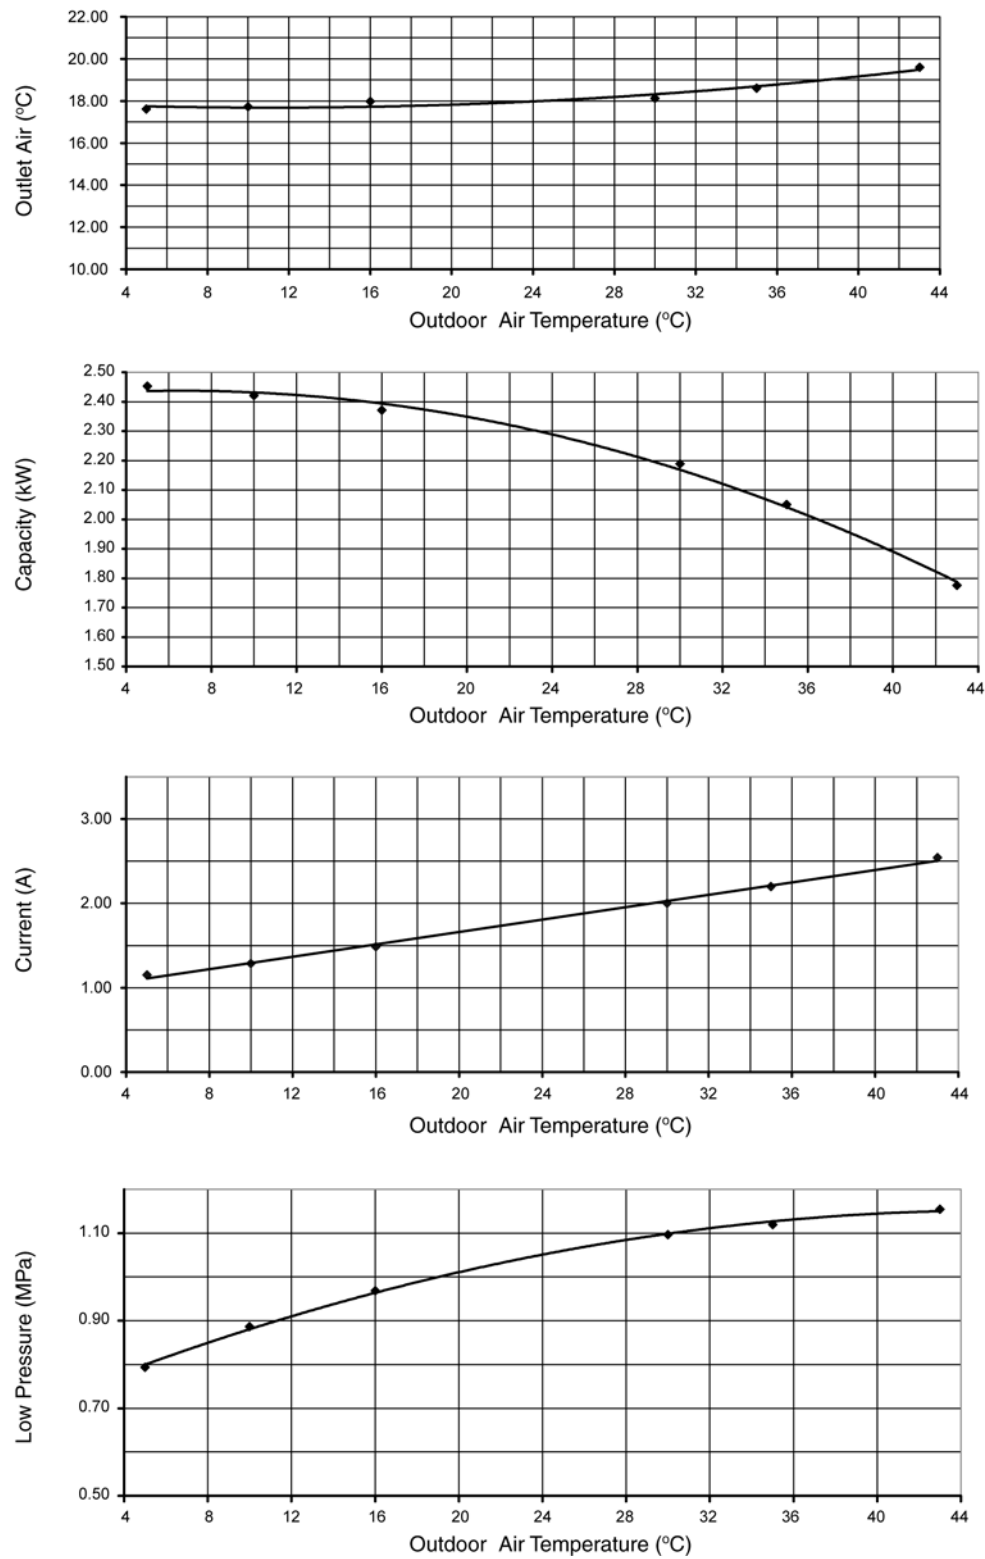

• Piping Length Characteristic

[Condition] Indoor temperature: 27/19°C, 35/-°C  
Remote condition: High fan speed, Cool 16°C  
Comp. Hz: F<sub>c</sub>  
Voltage: 230V

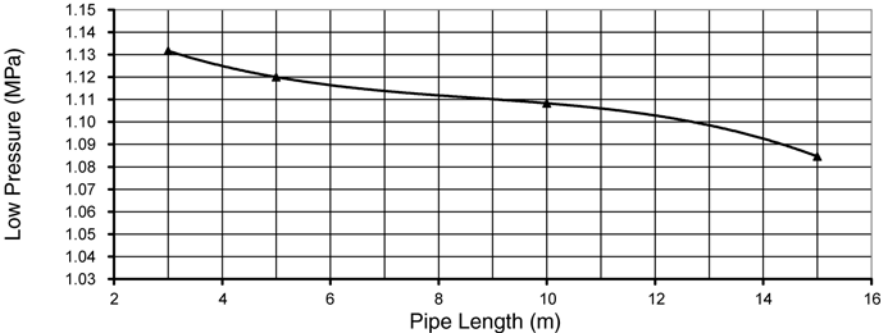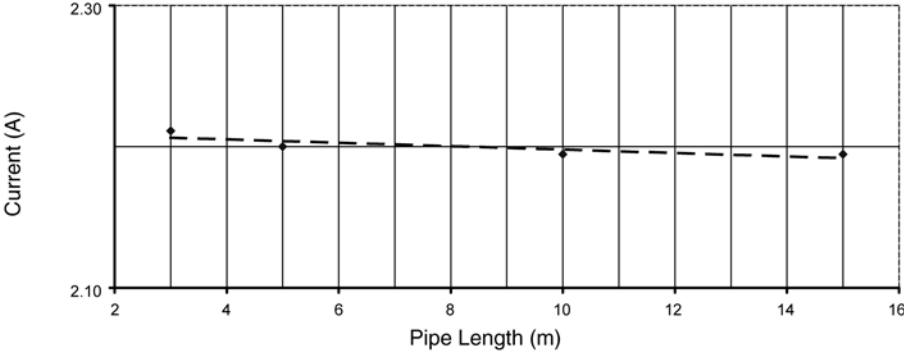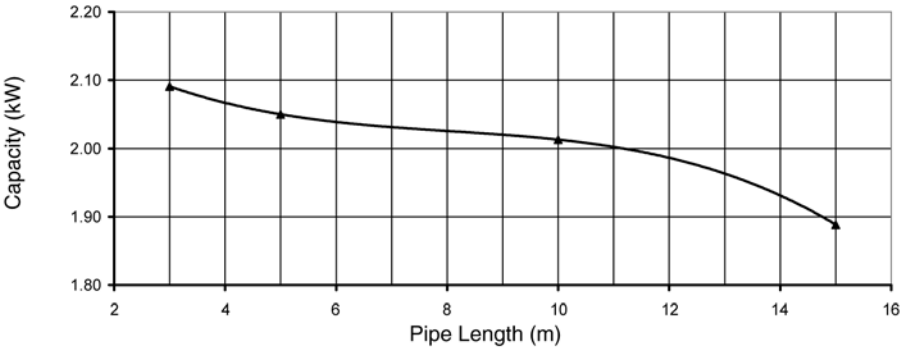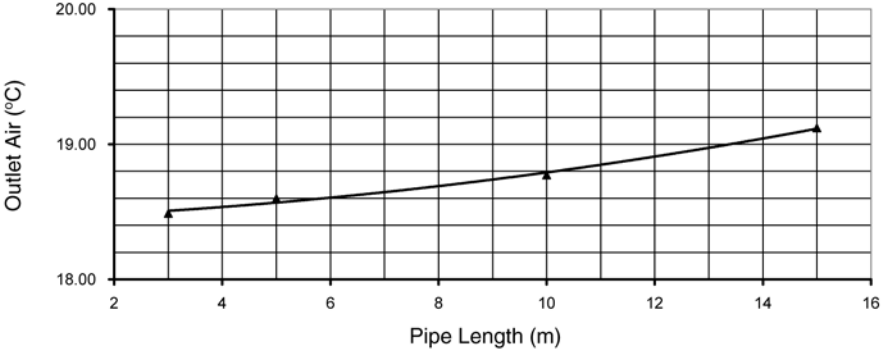





## • Heating Characteristic

[Condition] Indoor temperature: 20/-°C

Remote condition: High fan speed, Heat 30°C





Comp. Hz:  $F_h$

Voltage: 230V

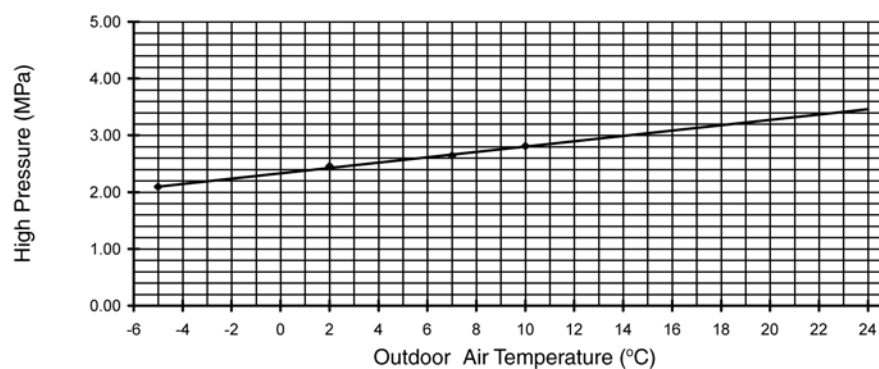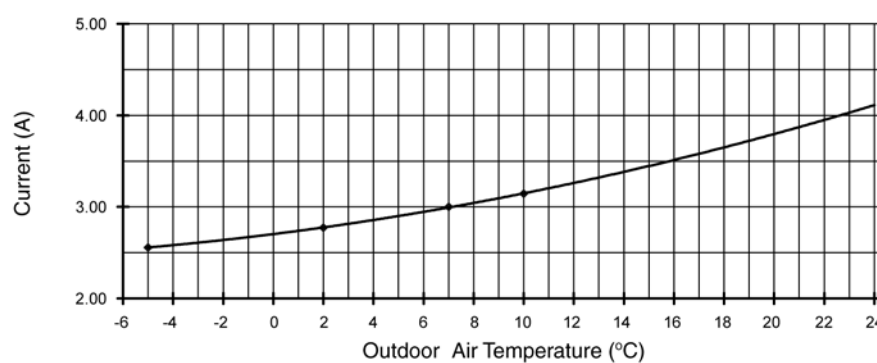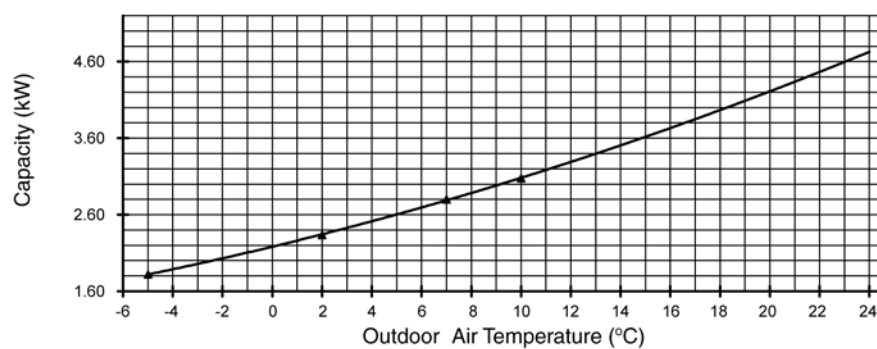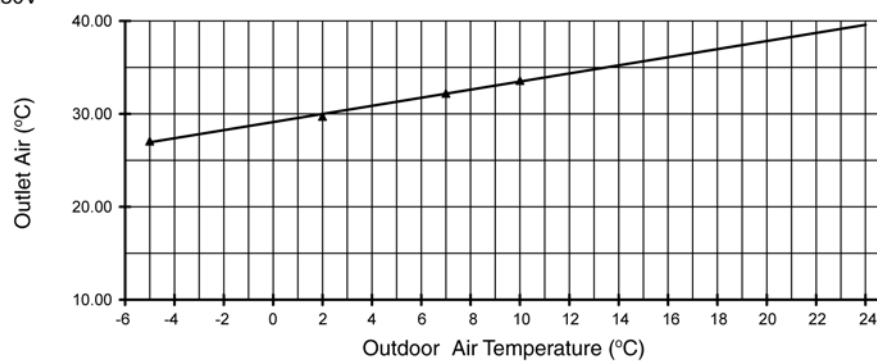

• Piping Length Characteristic

[Condition] Indoor temperature: 20/-°C, 7/6°C  
Remote condition: High fan speed, Heat 30°C  
Comp. Hz: F<sub>h</sub>  
Voltage: 230V

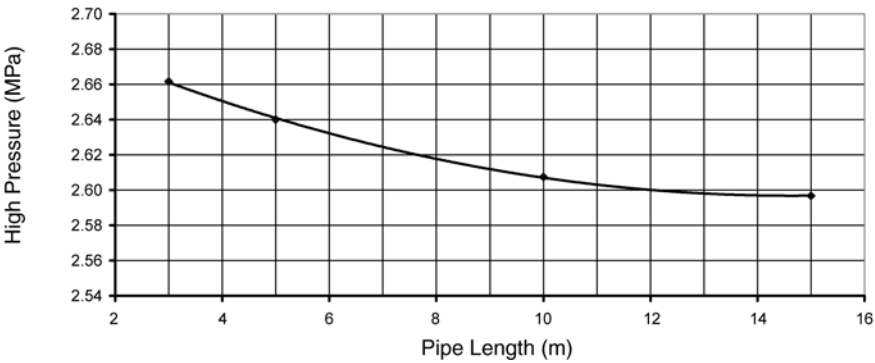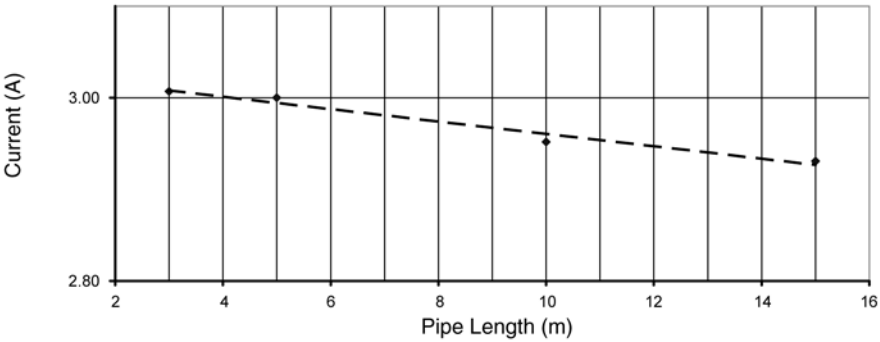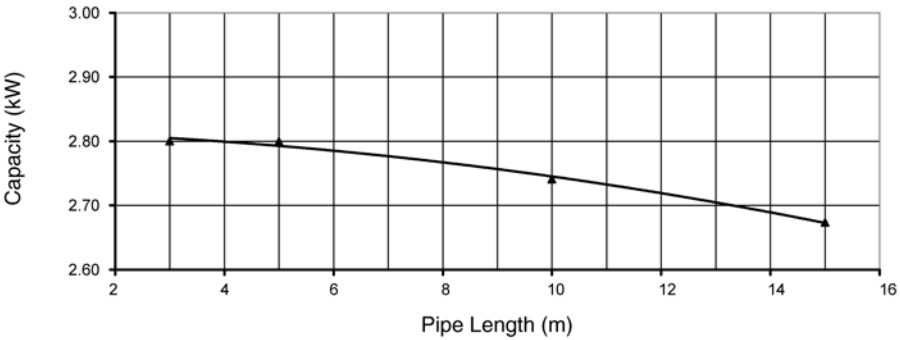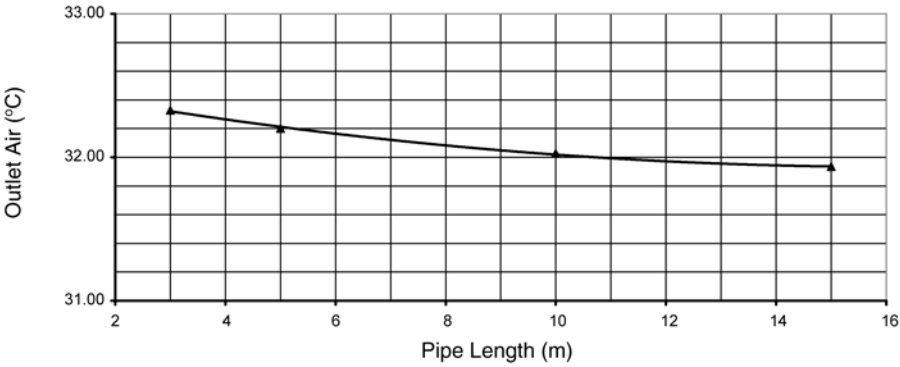

## 18.1.2. CU-E9LKE





### • Cooling Characteristic

[Condition] Indoor temperature: 27/19°C

Remote condition: High fan speed, Cool 16°C


Comp. Hz: F<sub>c</sub>

Voltage: 230V

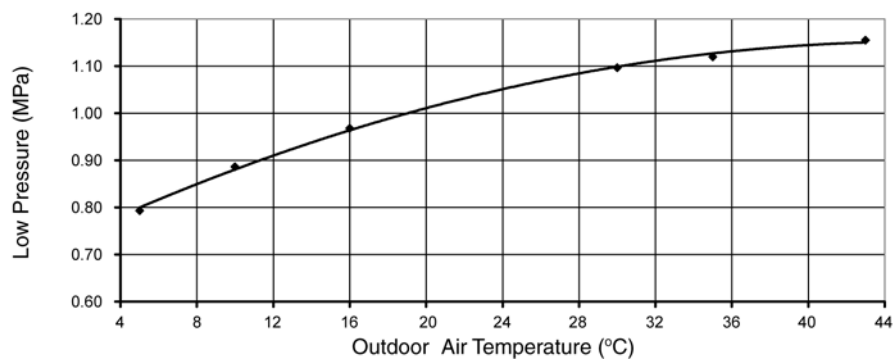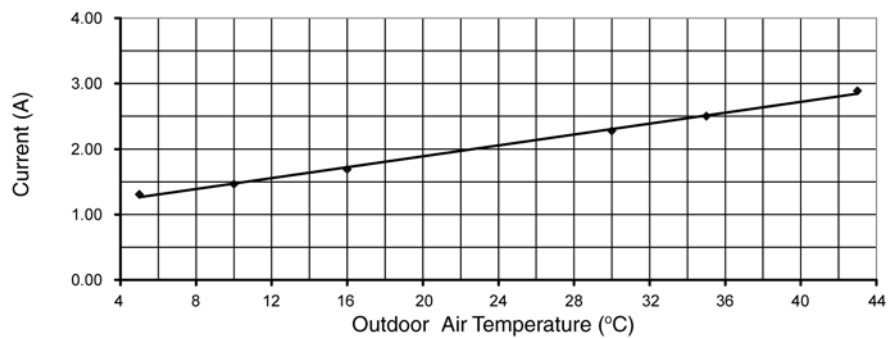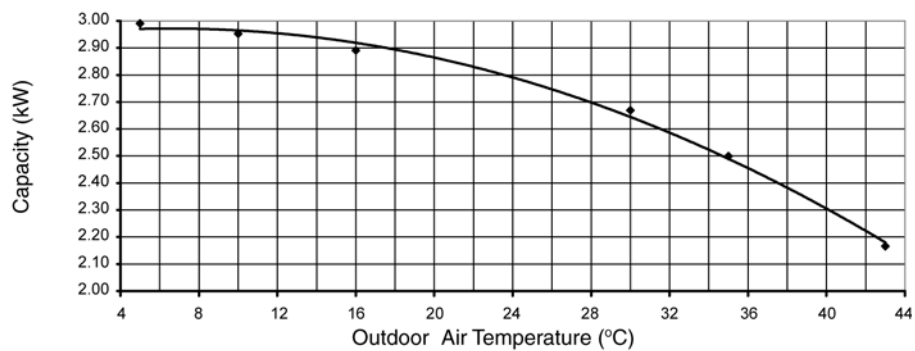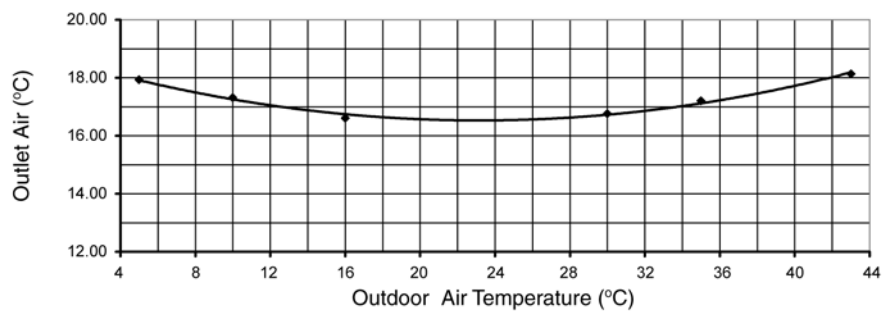

• Piping Length Characteristic

[Condition] Indoor temperature: 27/19°C, 35/-°C  
Remote condition: High fan speed, Cool 16°C  
Comp. Hz: F<sub>c</sub>  
Voltage: 230V

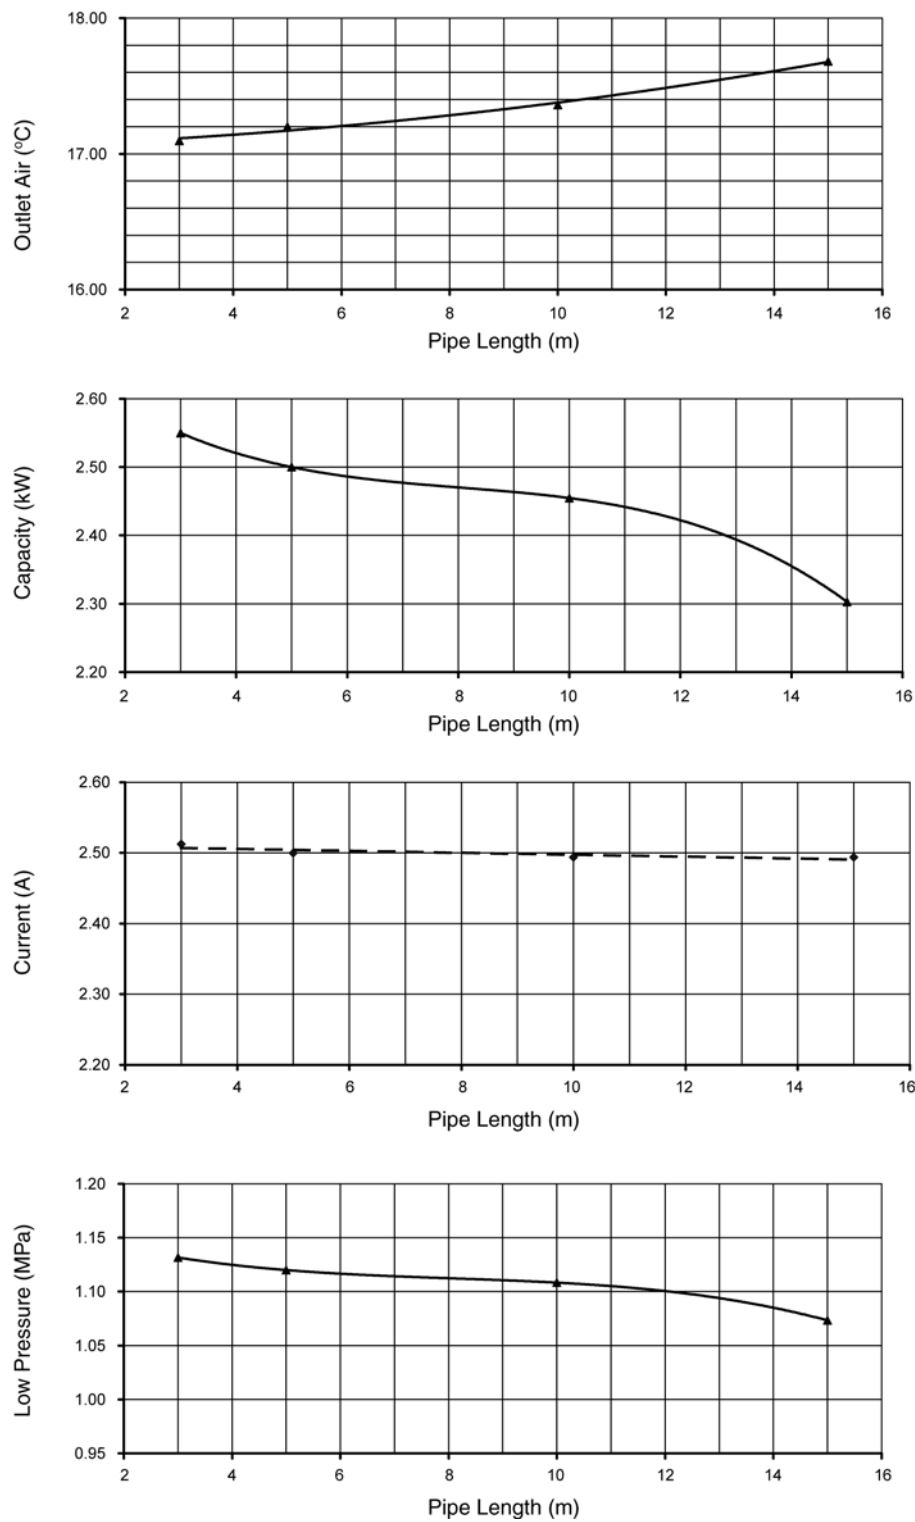







## • Heating Characteristic

[Condition] Indoor temperature: 20/-°C

Remote condition: High fan speed, Heat 30°C





Comp. Hz:  $F_h$

Voltage: 230V

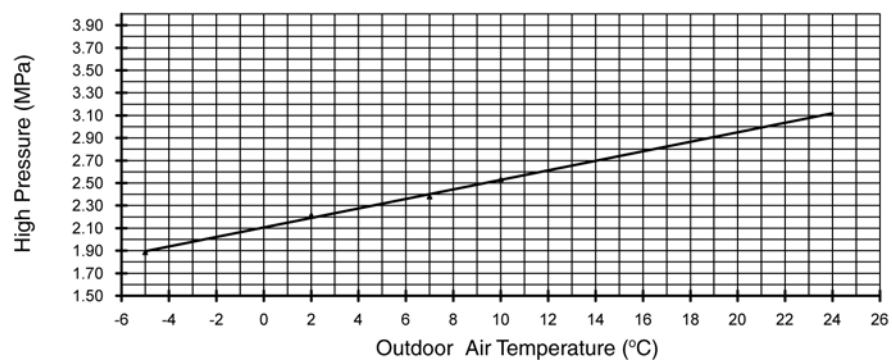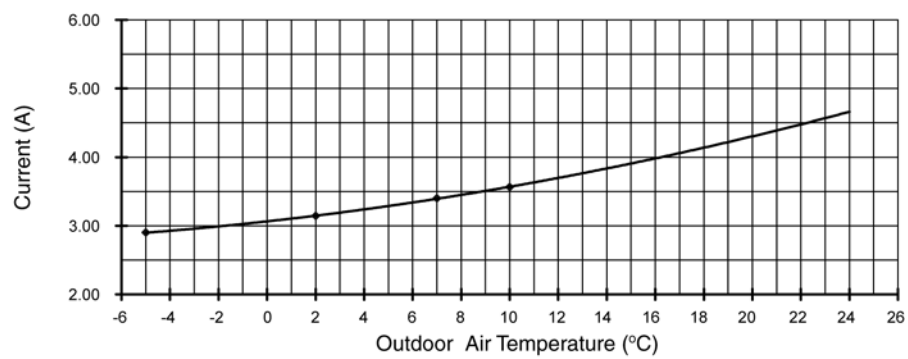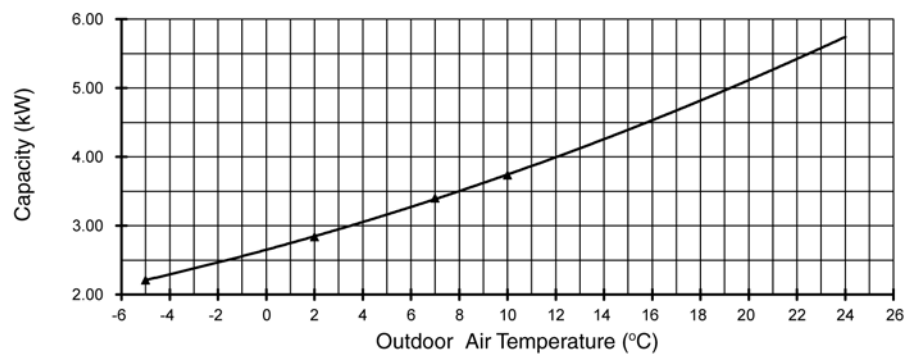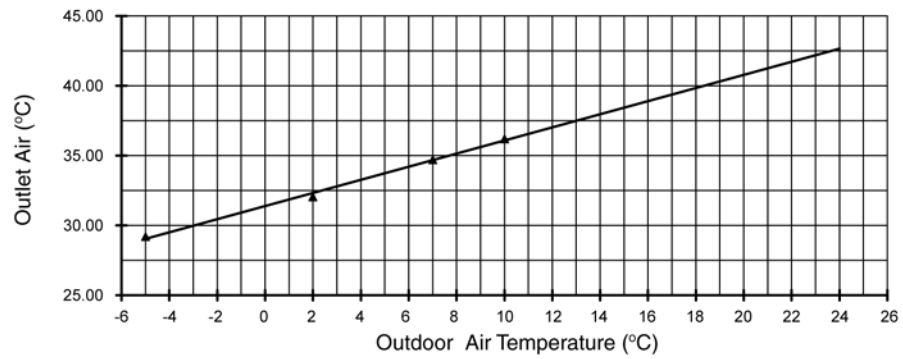

• Piping Length Characteristic


[Condition] Indoor temperature: 20/-°C, 7/6°C  
Remote condition: High fan speed, Heat 30°C  
Comp. Hz: F<sub>h</sub>  
Voltage: 230V

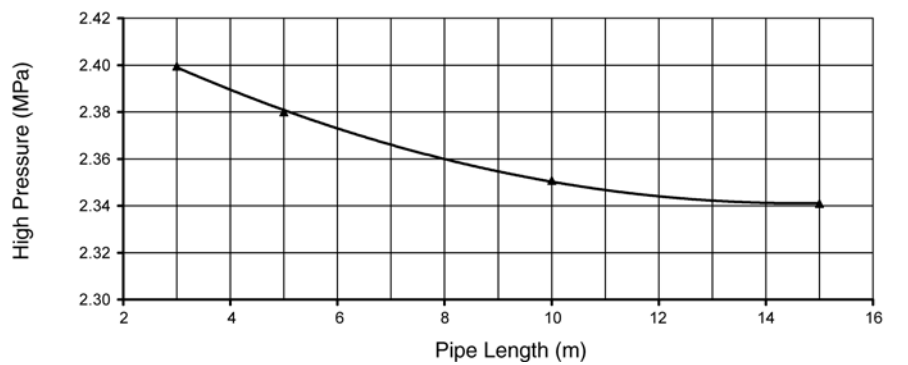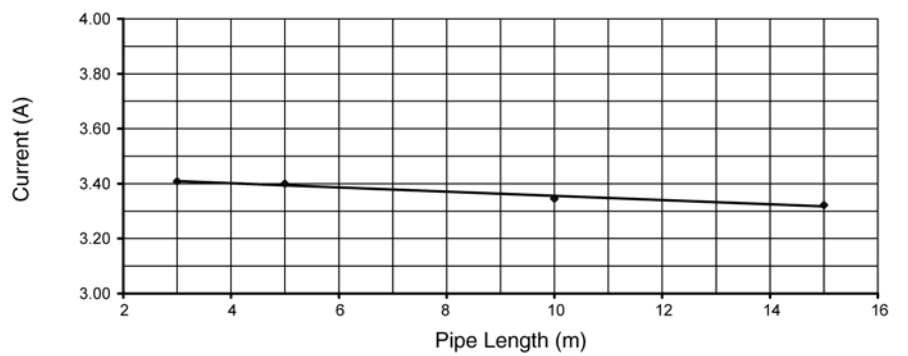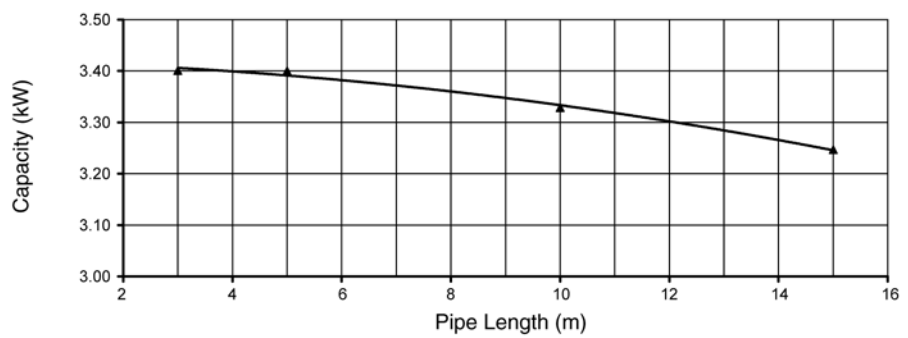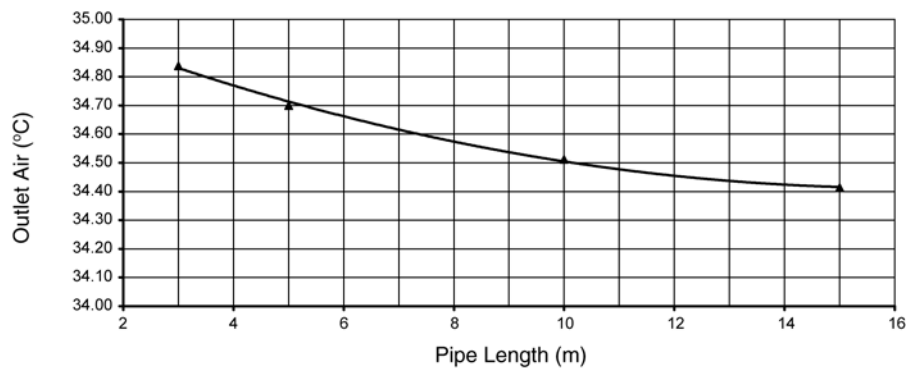

18.1.3. CU-E12LKE





• Cooling Characteristic

[Condition] Indoor temperature: 27/19°C  
Remote condition: High fan speed, Cool 16°C  
Comp. Hz: F<sub>c</sub>  
Voltage: 230V

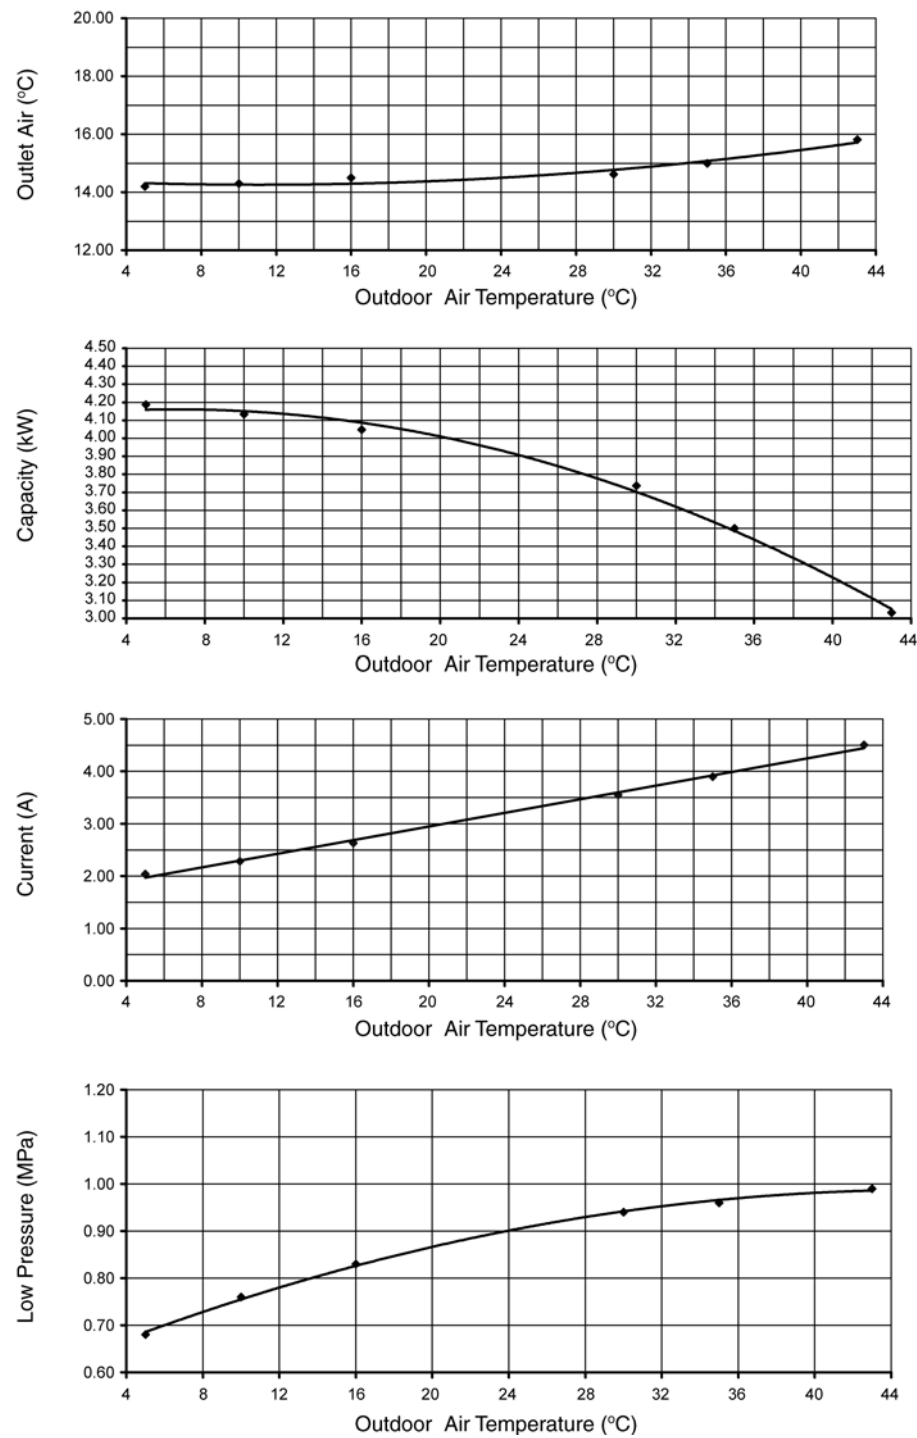

• Piping Length Characteristic

[Condition] Indoor temperature: 27/19°C, 35/-°C  
Remote condition: High fan speed, Cool 16°C  
Comp. Hz: F<sub>c</sub>  
Voltage: 230V

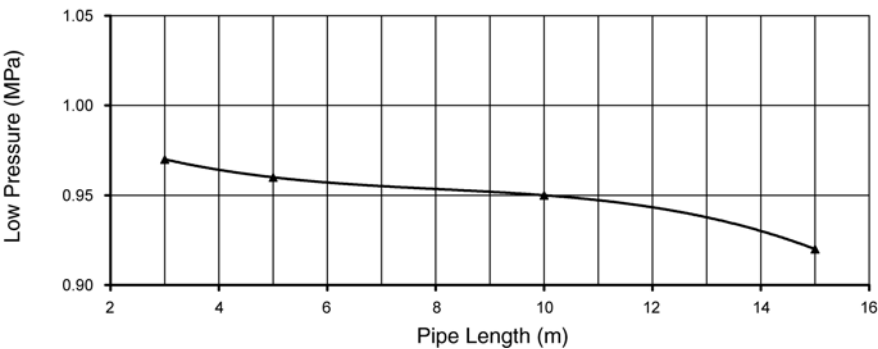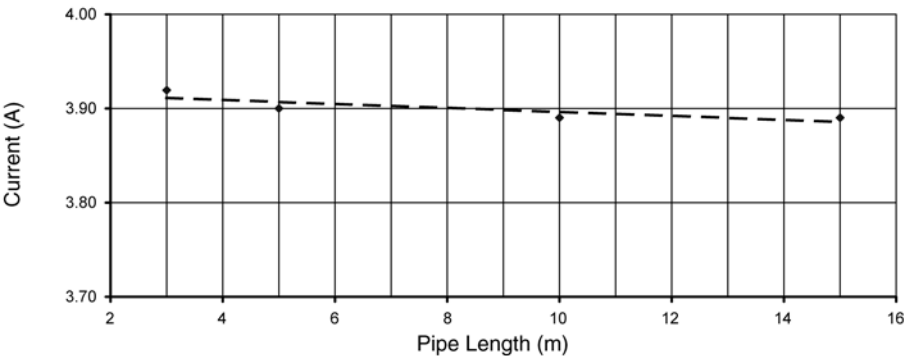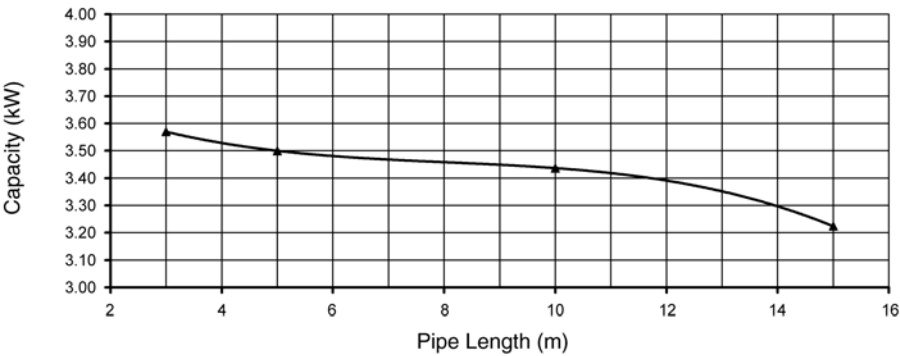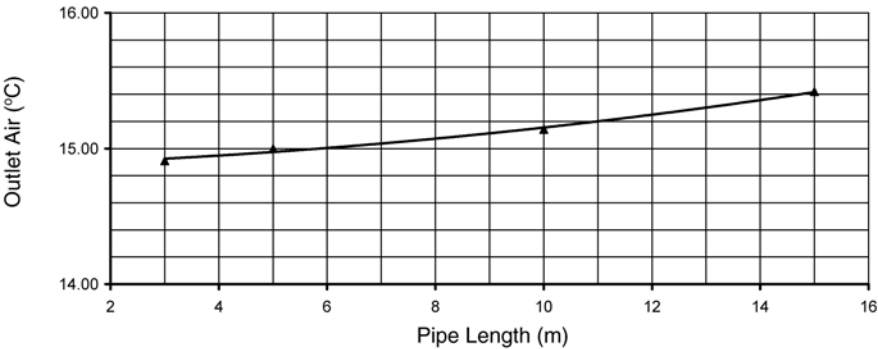





## • Heating Characteristic

[Condition] Indoor temperature: 20/-°C

Remote condition: High fan speed, Heat 30°C





Comp. Hz:  $F_h$

Voltage: 230V

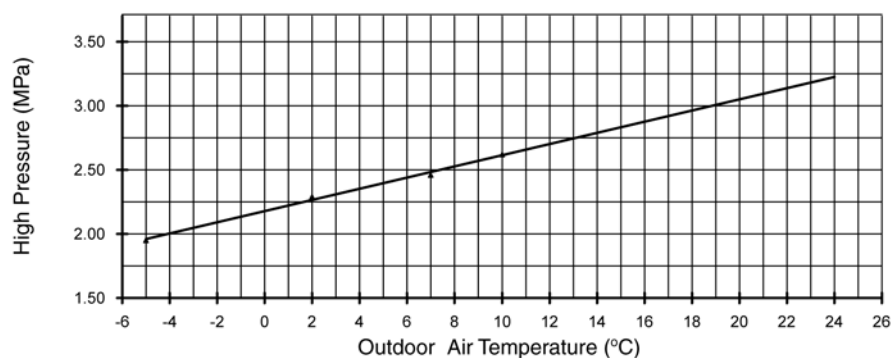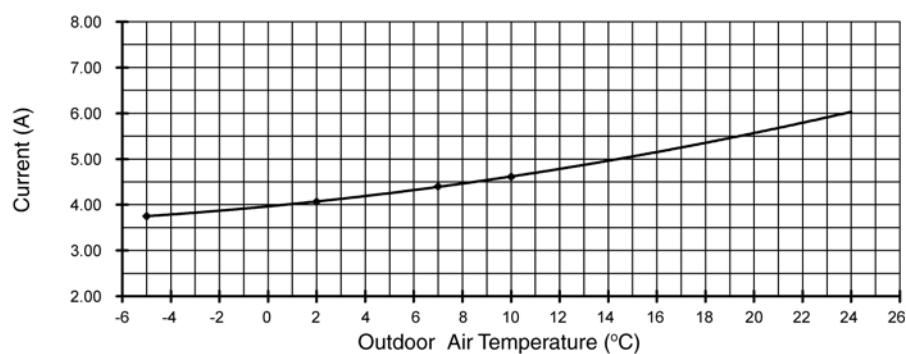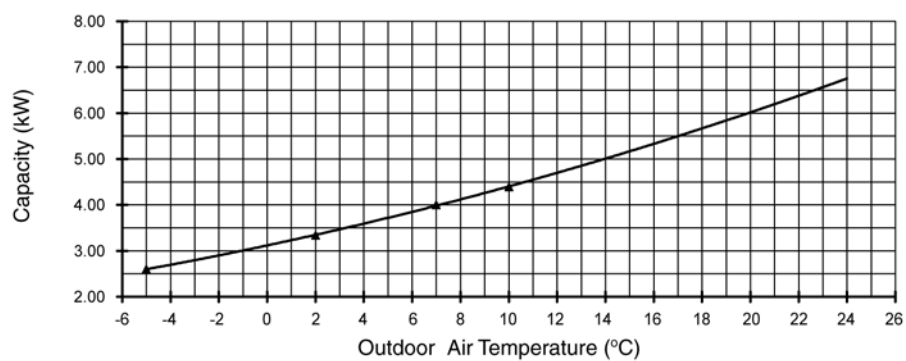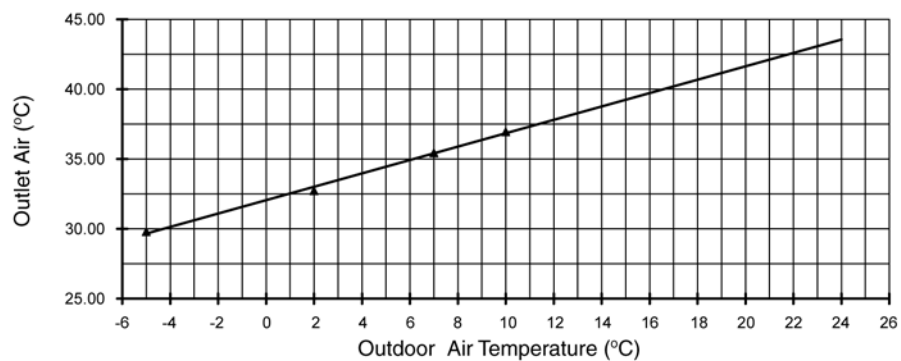

• Piping Length Characteristic


[Condition] Indoor temperature: 20/-°C, 7/6°C  
Remote condition: High fan speed, Heat 30°C  
Comp. Hz: F<sub>h</sub>  
Voltage: 230V

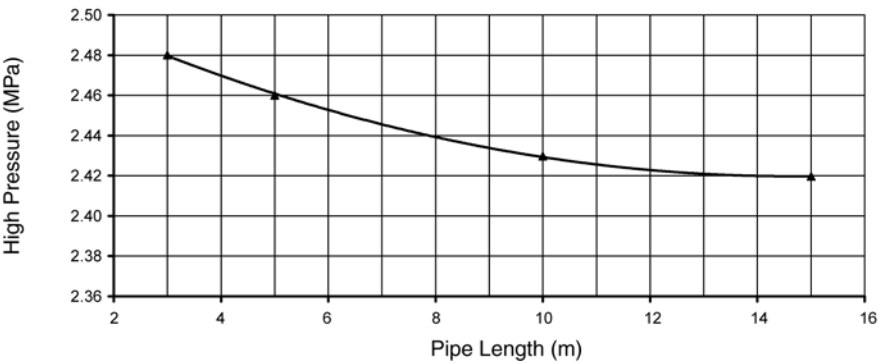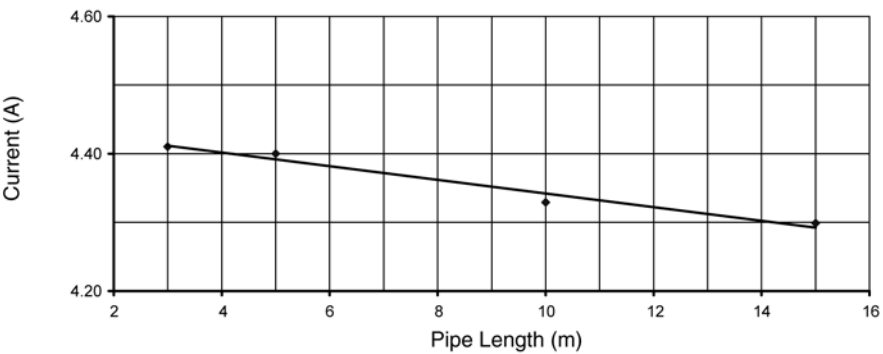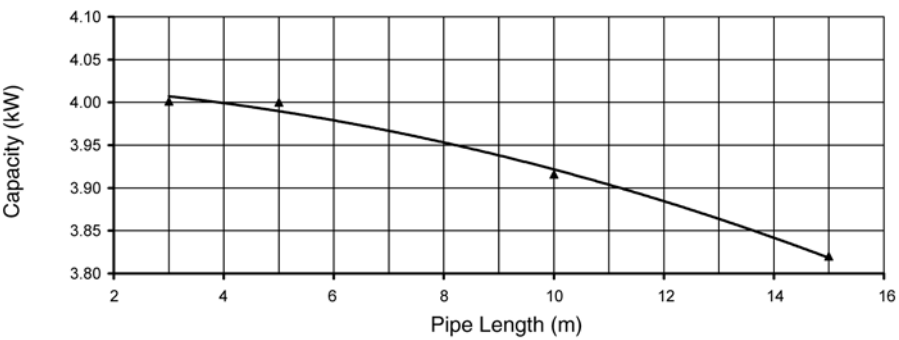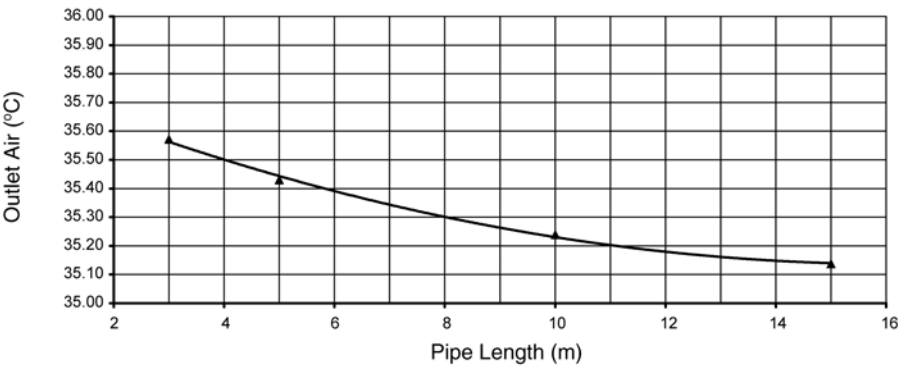

18.1.4. CU-E15LKE


• Cooling Characteristic

[Condition] Indoor temperature: 27/19°C  
Remote condition: High fan speed, Cool 16°C  
Comp. Hz: F<sub>c</sub>  
Voltage: 230V

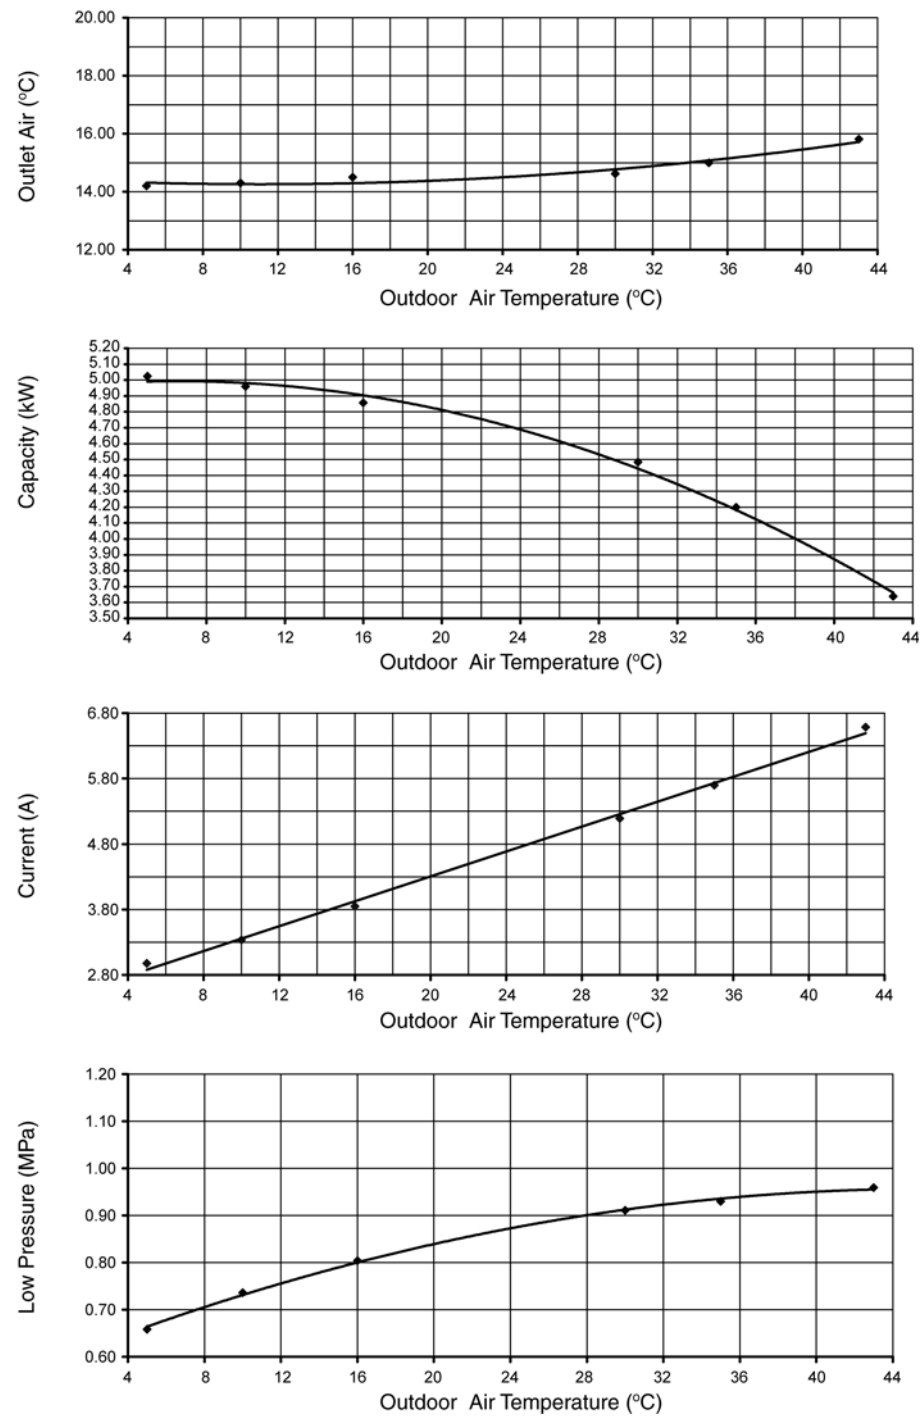

• Piping Length Characteristic (Cooling)

[Condition] Indoor temperature: 27/19°C, 35/-°C  
Remote condition: High fan speed, Cool 16°C  
Comp. Hz: F<sub>c</sub>  
Voltage: 230V

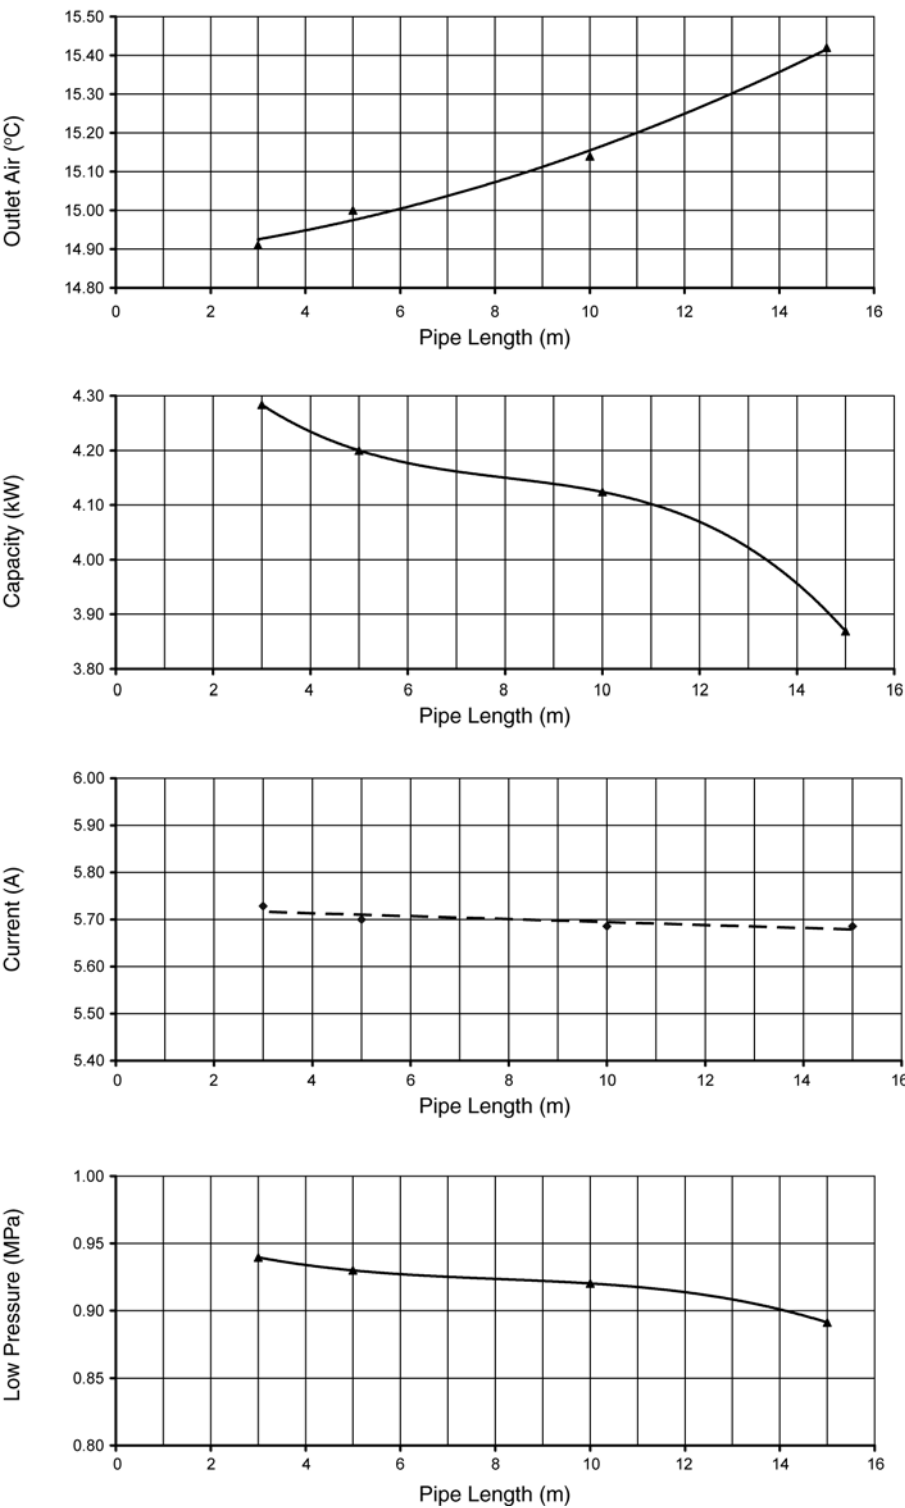







## • Heating Characteristic

[Condition] Indoor temperature: 20/-°C

Remote condition: High fan speed, Heat 30°C


Comp. Hz:  $F_h$

Voltage: 230V

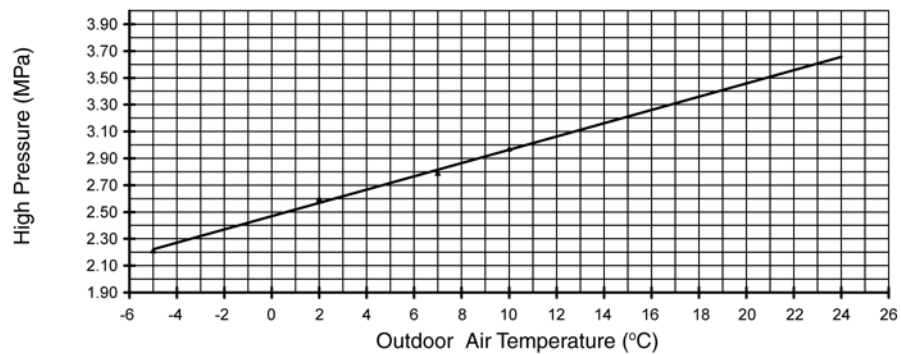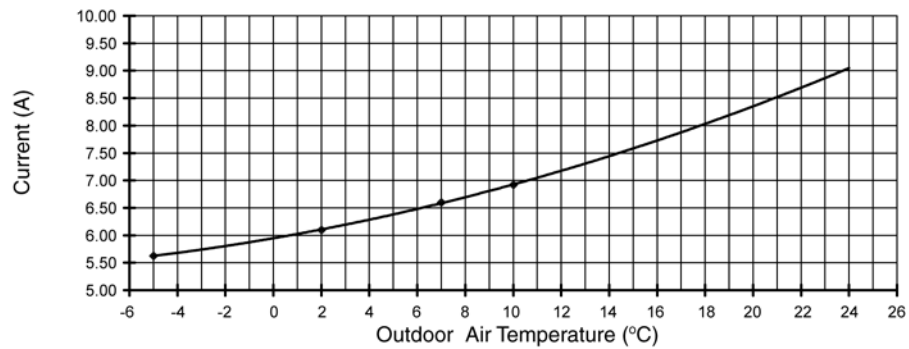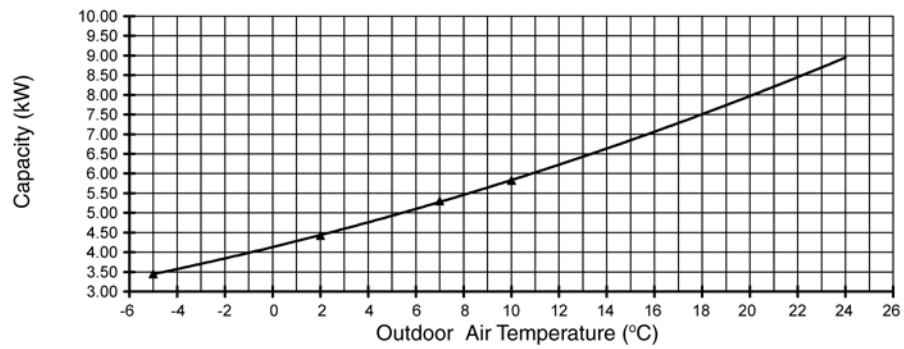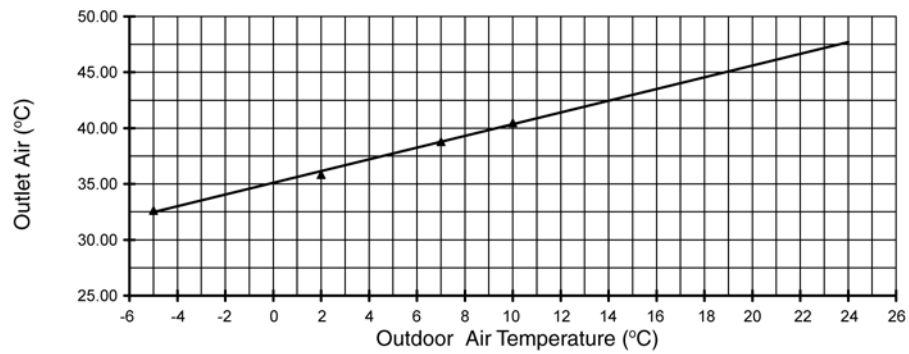

• Piping Length Characteristic (Heating)


[Condition] Indoor temperature: 20/-°C, 7/6°C  
Remote condition: High fan speed, Heat 30°C  
Comp. Hz: F<sub>h</sub>  
Voltage: 230V

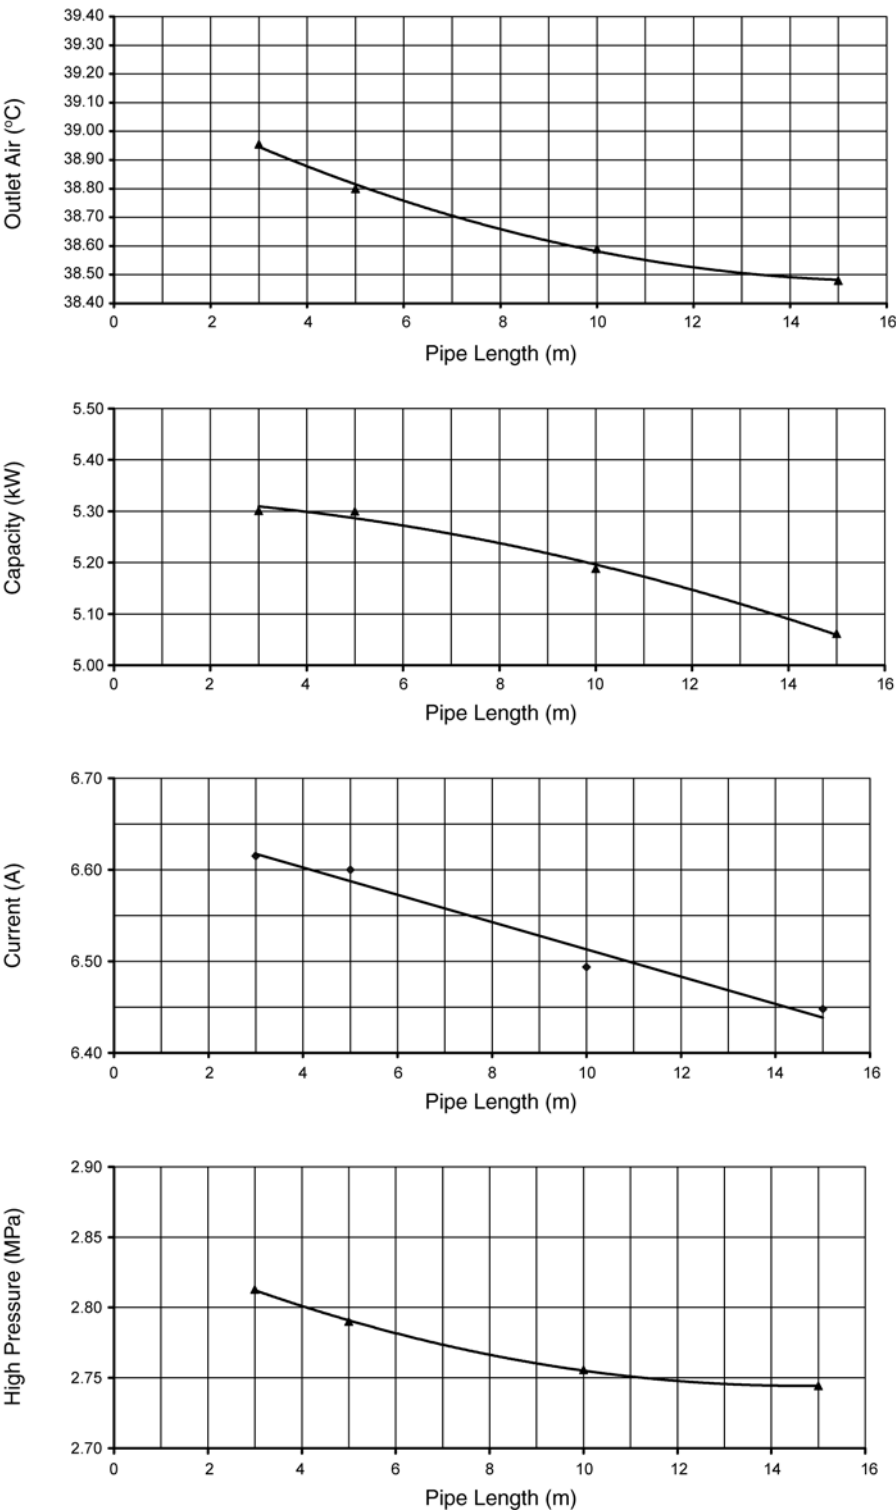

18.1.5. CU-E7LKE-3


• Cooling Characteristic

[Condition] Indoor temperature: 27/19°C  
Remote condition: High fan speed, Cool 16°C  
Comp. Hz: F<sub>c</sub>  
Voltage: 230V

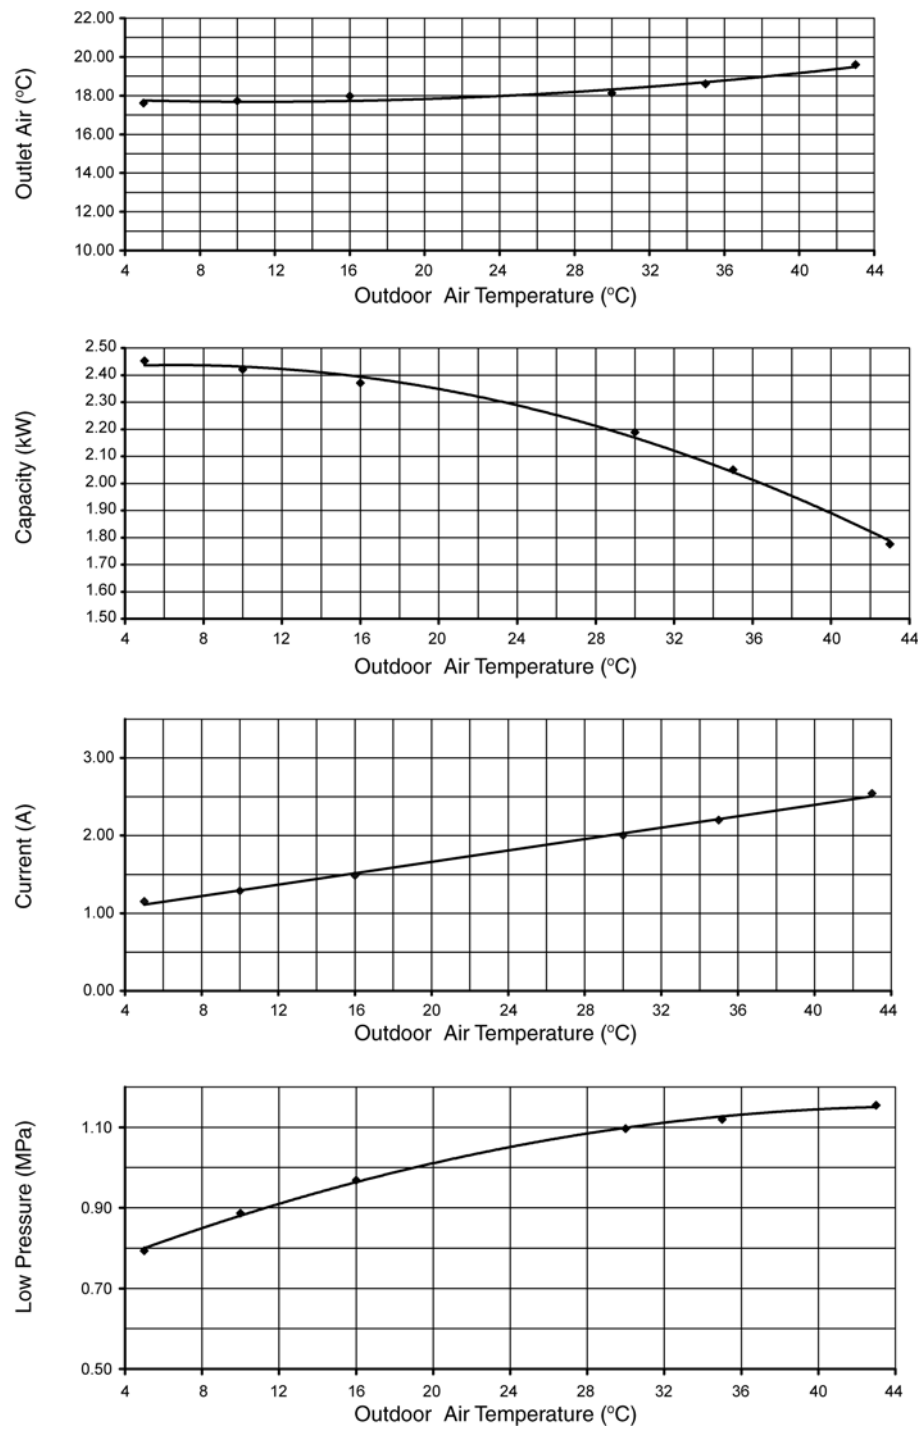

• Piping Length Characteristic

[Condition] Indoor temperature: 27/19°C, 35/-°C  
Remote condition: High fan speed, Cool 16°C  
Comp. Hz: F<sub>c</sub>  
Voltage: 230V

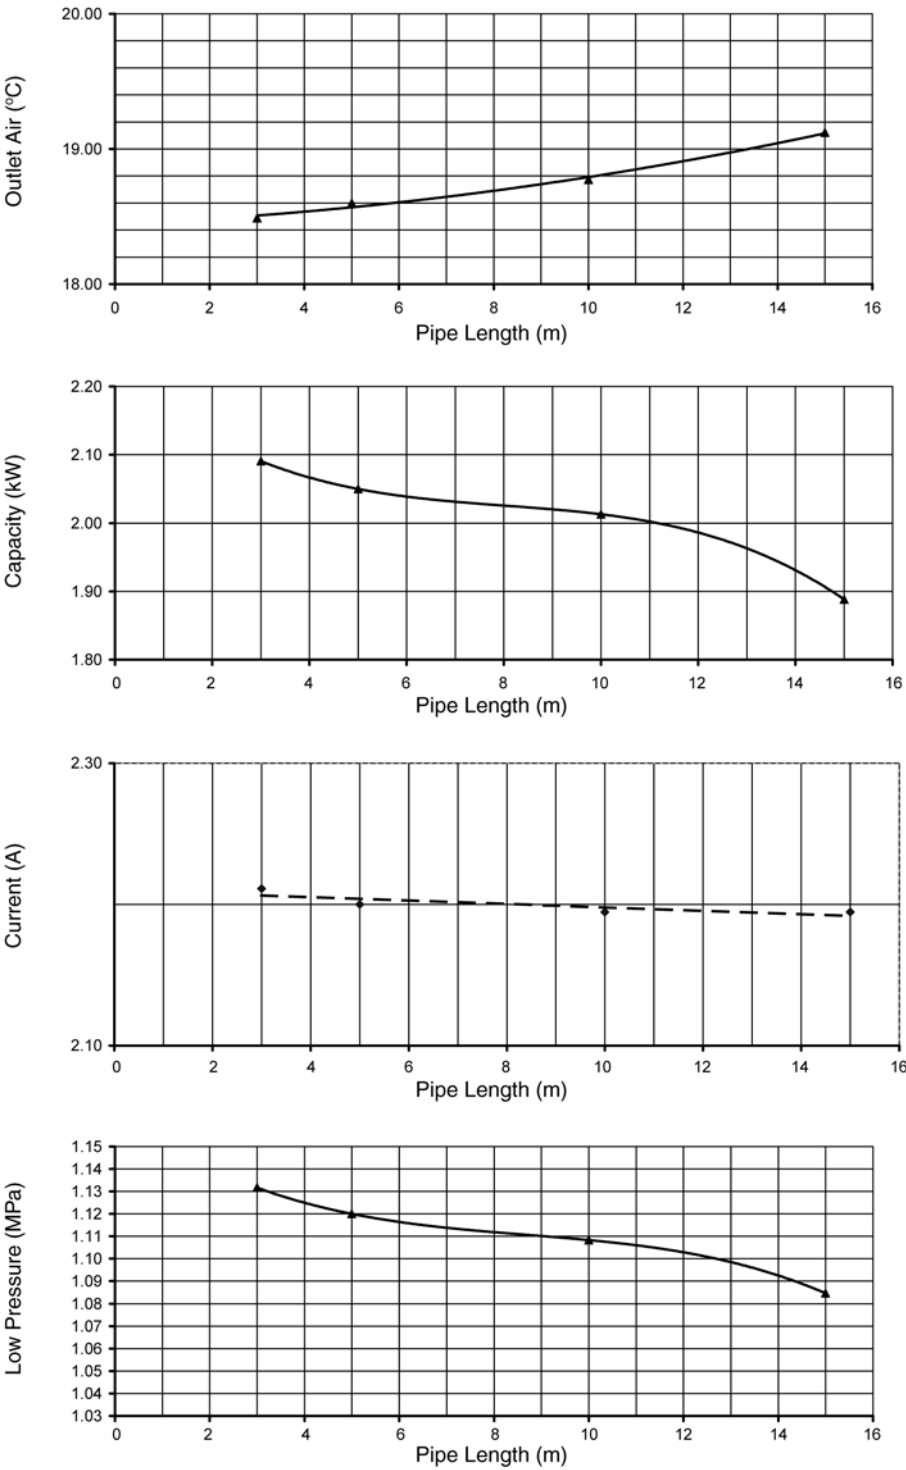





## • Heating Characteristic

[Condition] Indoor temperature: 20/-°C

Remote condition: High fan speed, Heat 30°C





Comp. Hz:  $F_h$

Voltage: 230V

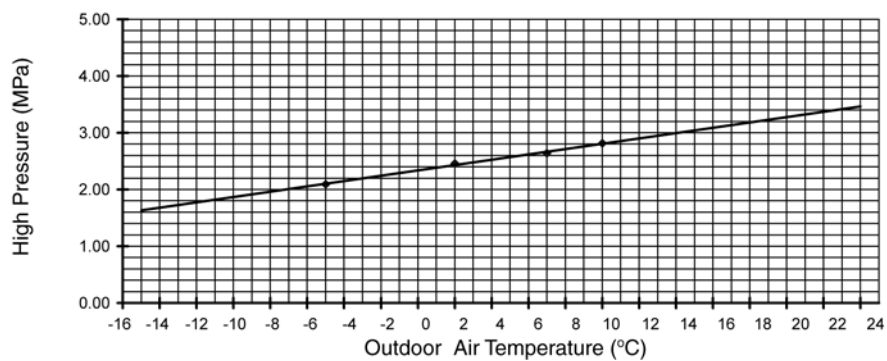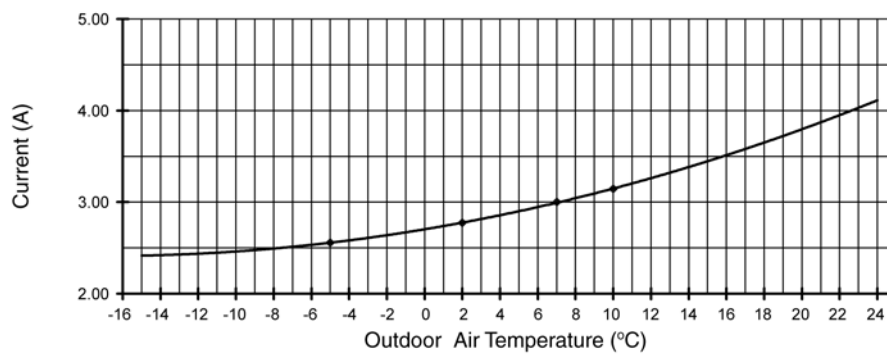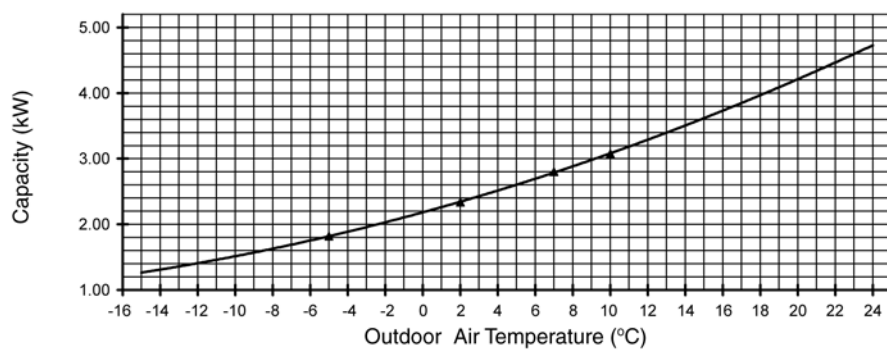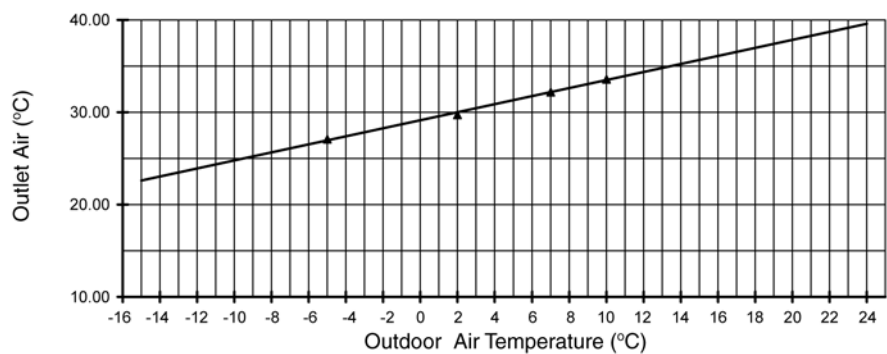

• Piping Length Characteristic

[Condition] Indoor temperature: 20/-°C, 7/6°C  
Remote condition: High fan speed, Heat 30°C  
Comp. Hz: F<sub>h</sub>  
Voltage: 230V

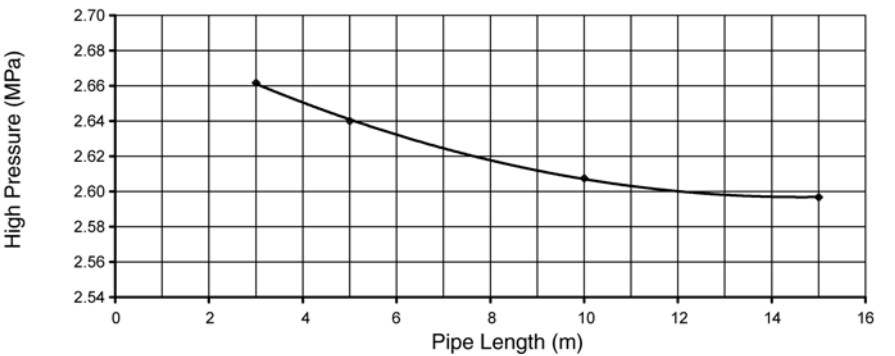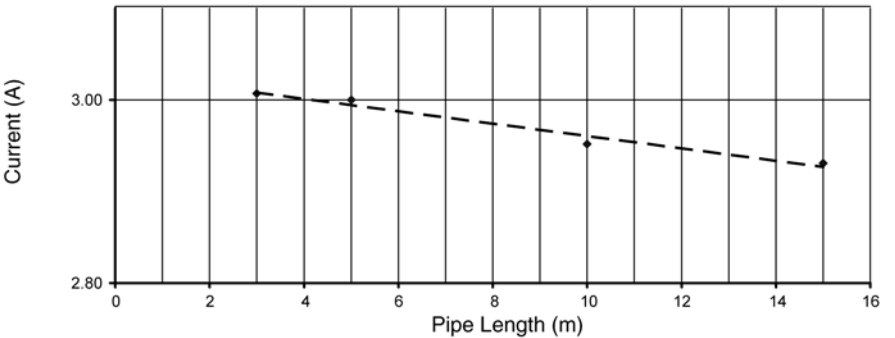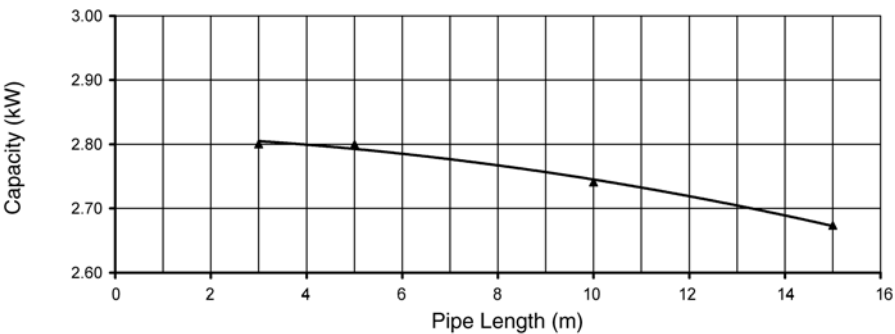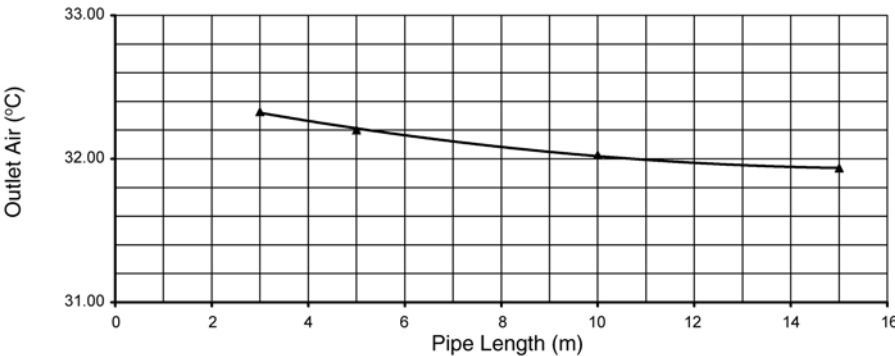

### 18.1.6. CU-E9LKE-3





#### • Cooling Characteristic

[Condition] Indoor temperature: 27/19°C

Remote condition: High fan speed, Cool 16°C


Comp. Hz: F<sub>c</sub>

Voltage: 230V

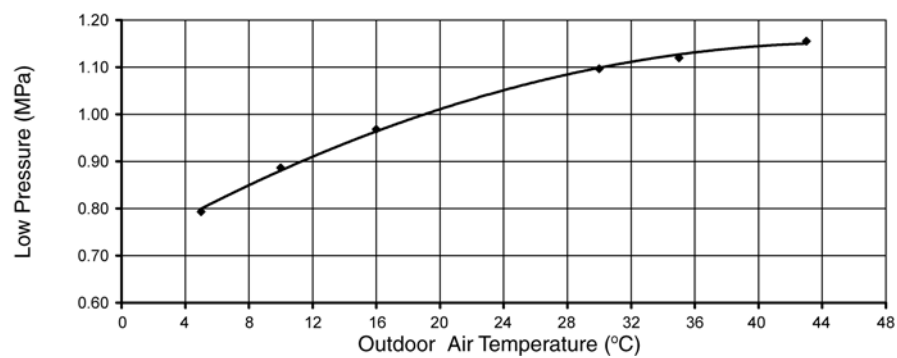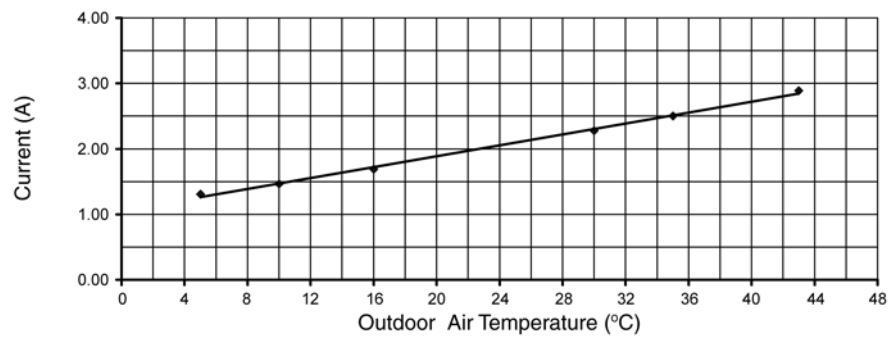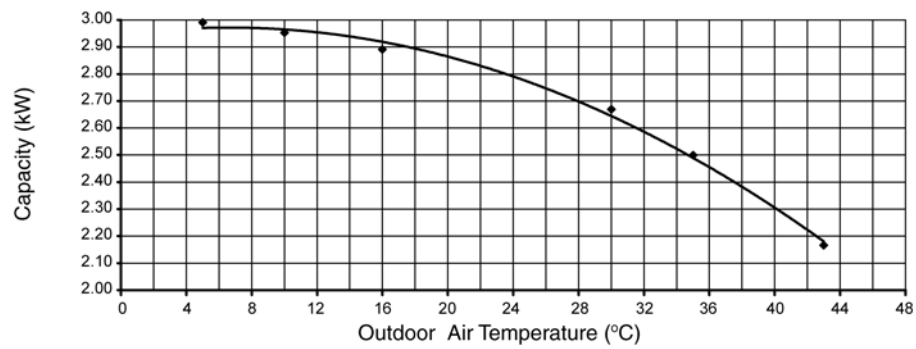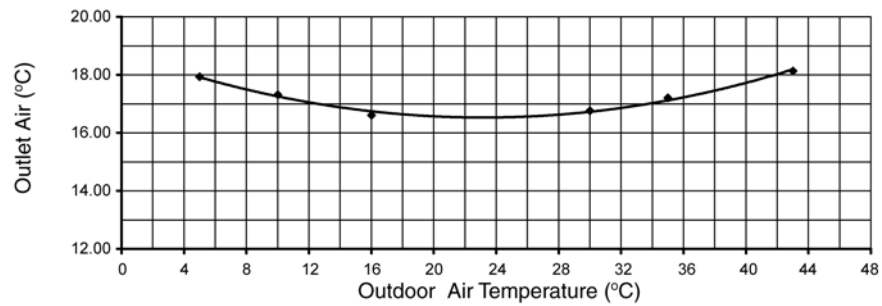

• Piping Length Characteristic

[Condition] Indoor temperature: 27/19°C, 35/°C  
Remote condition: High fan speed, Cool 16°C  
Comp. Hz: F<sub>c</sub>  
Voltage: 230V

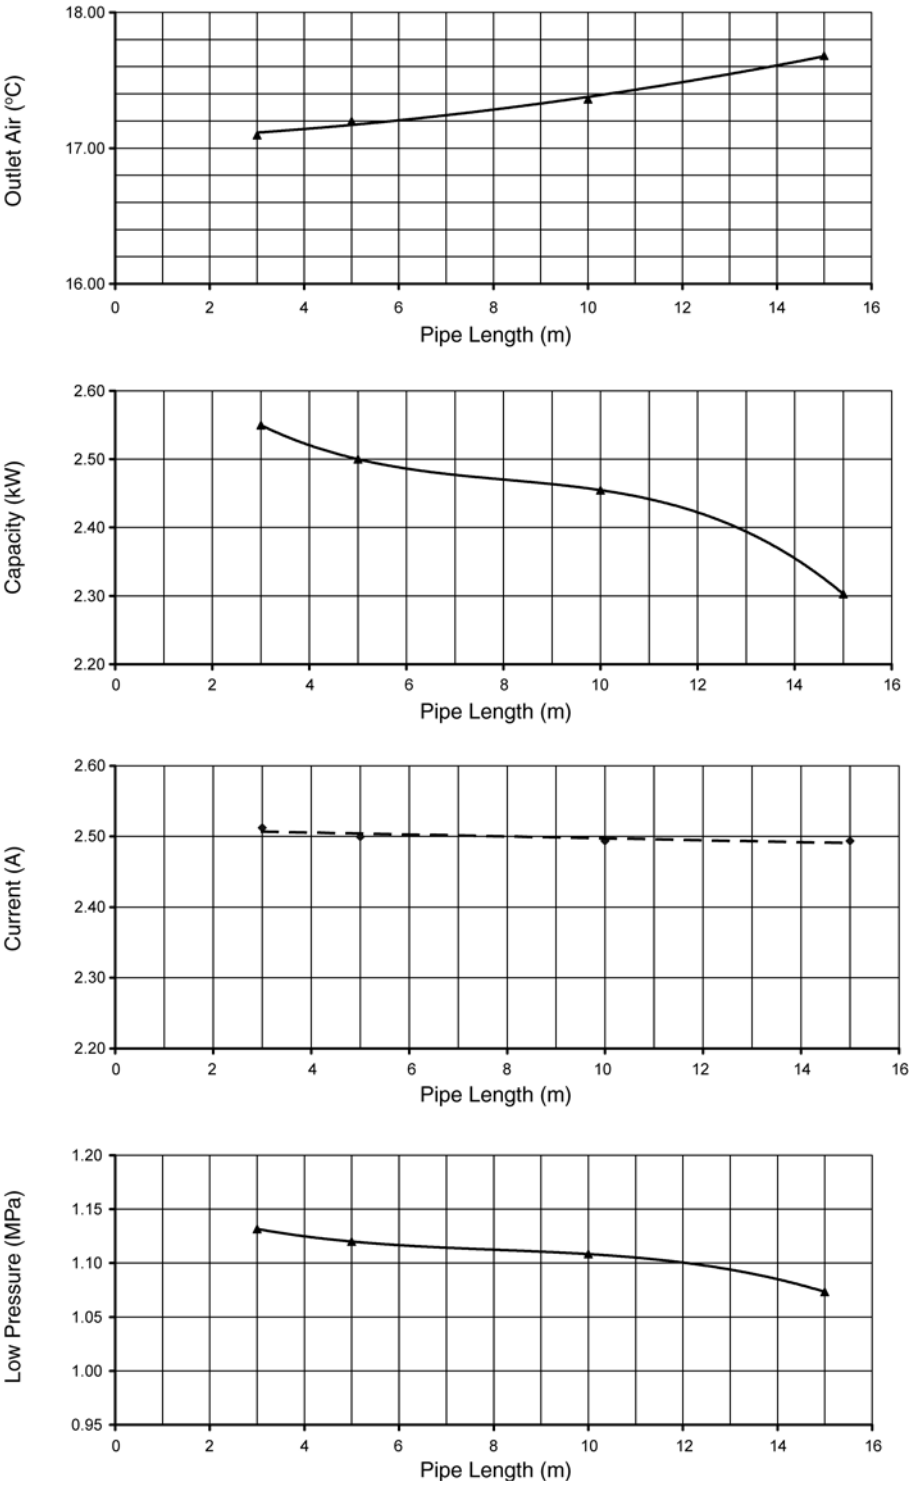







## • Heating Characteristic

[Condition] Indoor temperature: 20/-°C

Remote condition: High fan speed, Heat 30°C





Comp. Hz:  $F_h$

Voltage: 230V

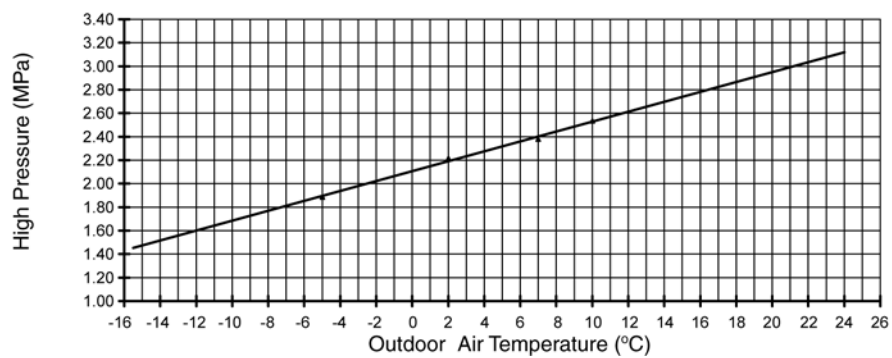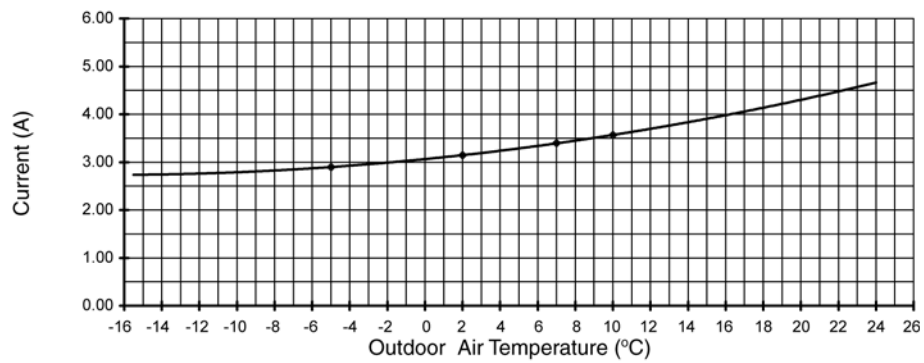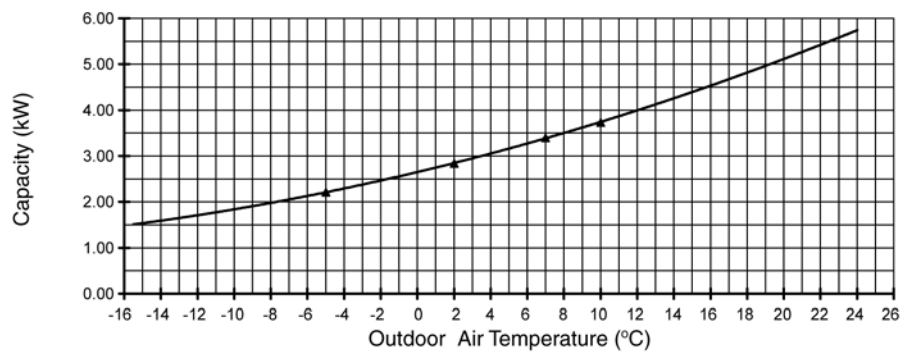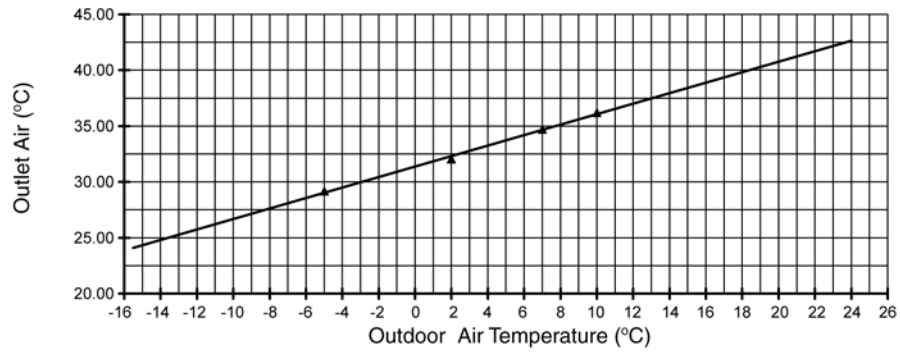

• Piping Length Characteristic


[Condition] Indoor temperature: 20/-°C, 7/6°C  
Remote condition: High fan speed, Heat 30°C  
Comp. Hz: F<sub>h</sub>  
Voltage: 230V

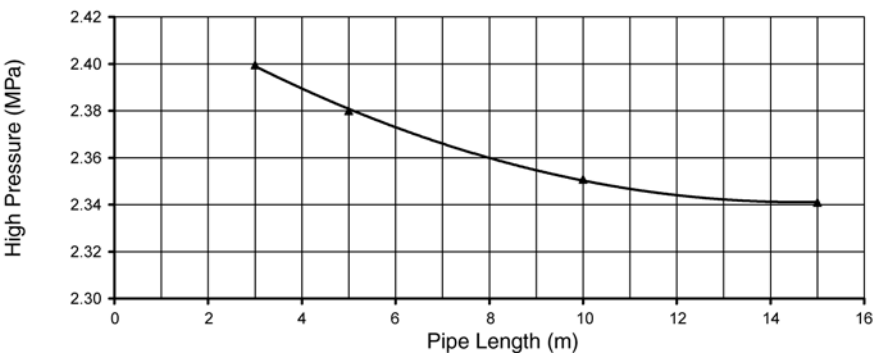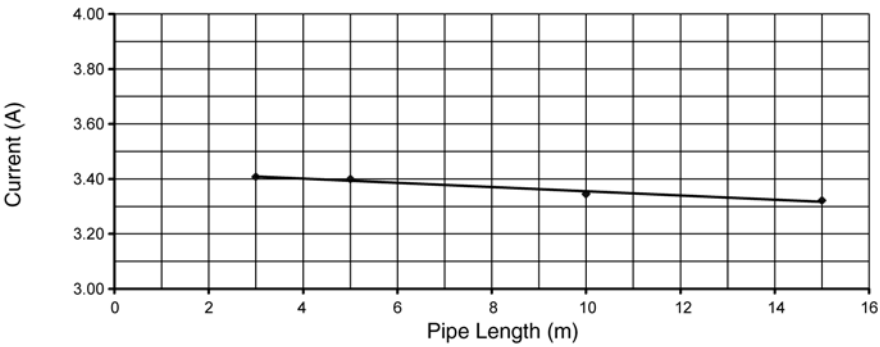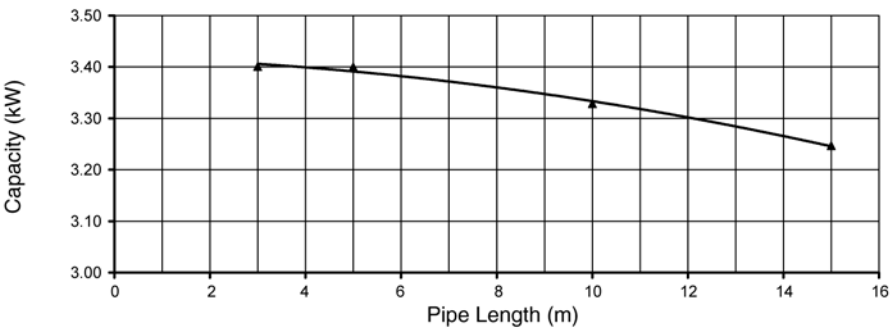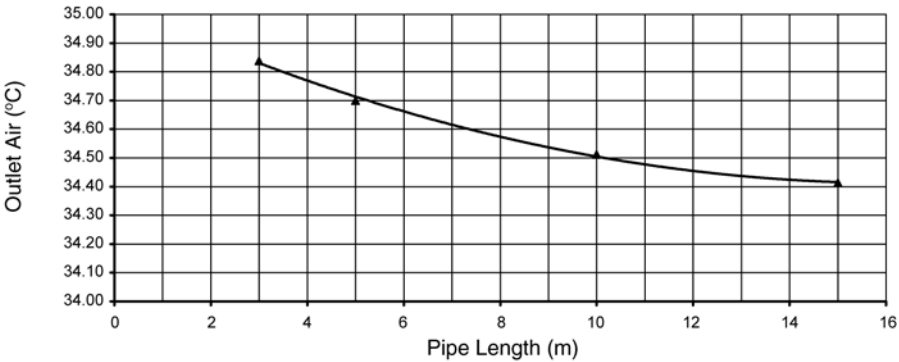

18.1.7. CU-E12LKE-3


• Cooling Characteristic

[Condition] Indoor temperature: 27/19°C  
Remote condition: High fan speed, Cool 16°C  
Comp. Hz: F<sub>c</sub>  
Voltage: 230V

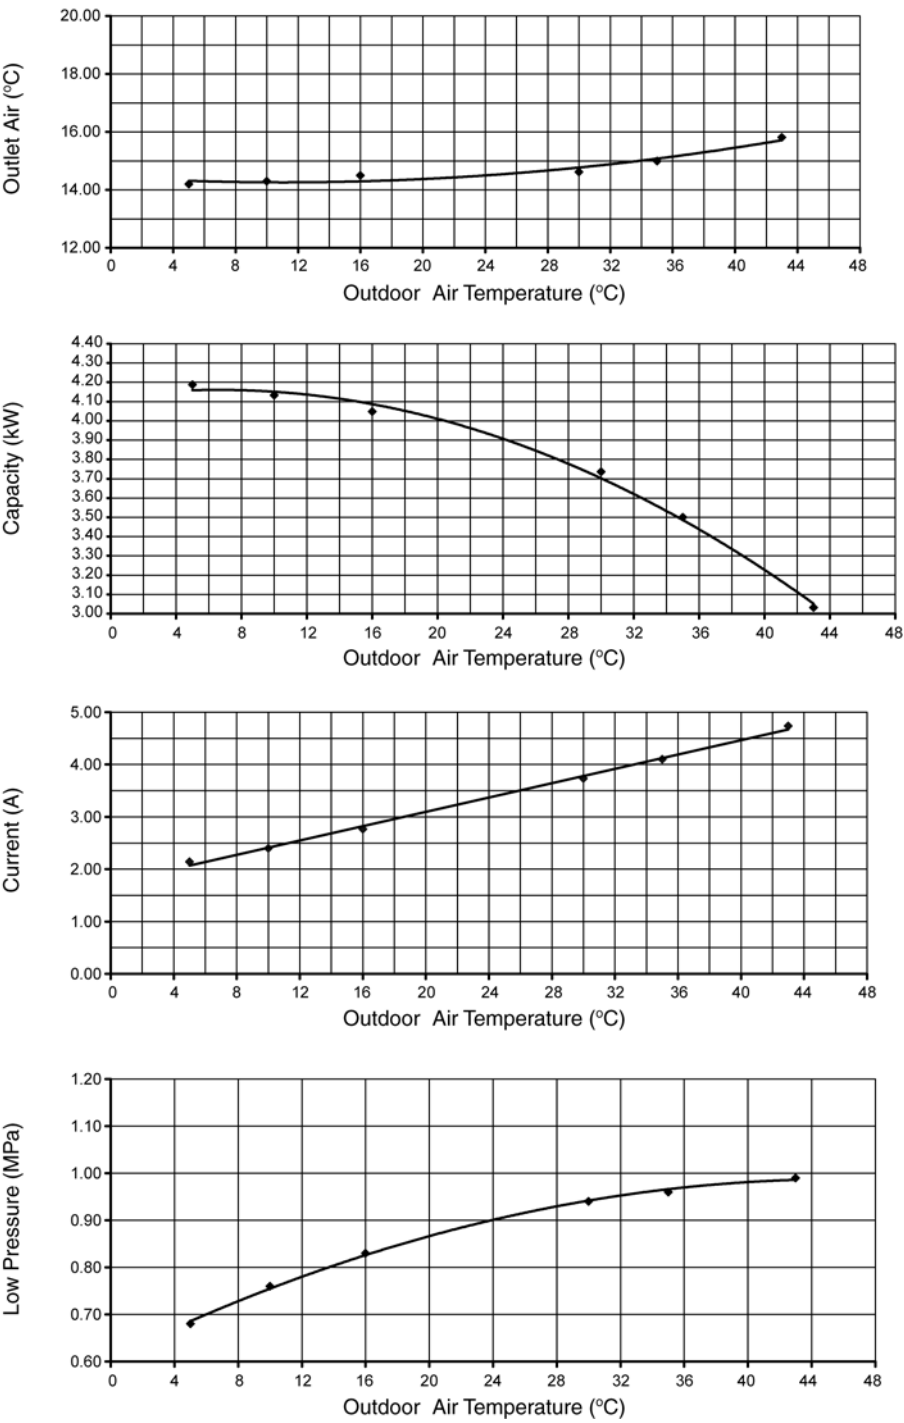

• Piping Length Characteristic

[Condition] Indoor temperature: 27/19°C, 35/-°C  
Remote condition: High fan speed, Cool 16°C  
Comp. Hz: F<sub>c</sub>  
Voltage: 230V

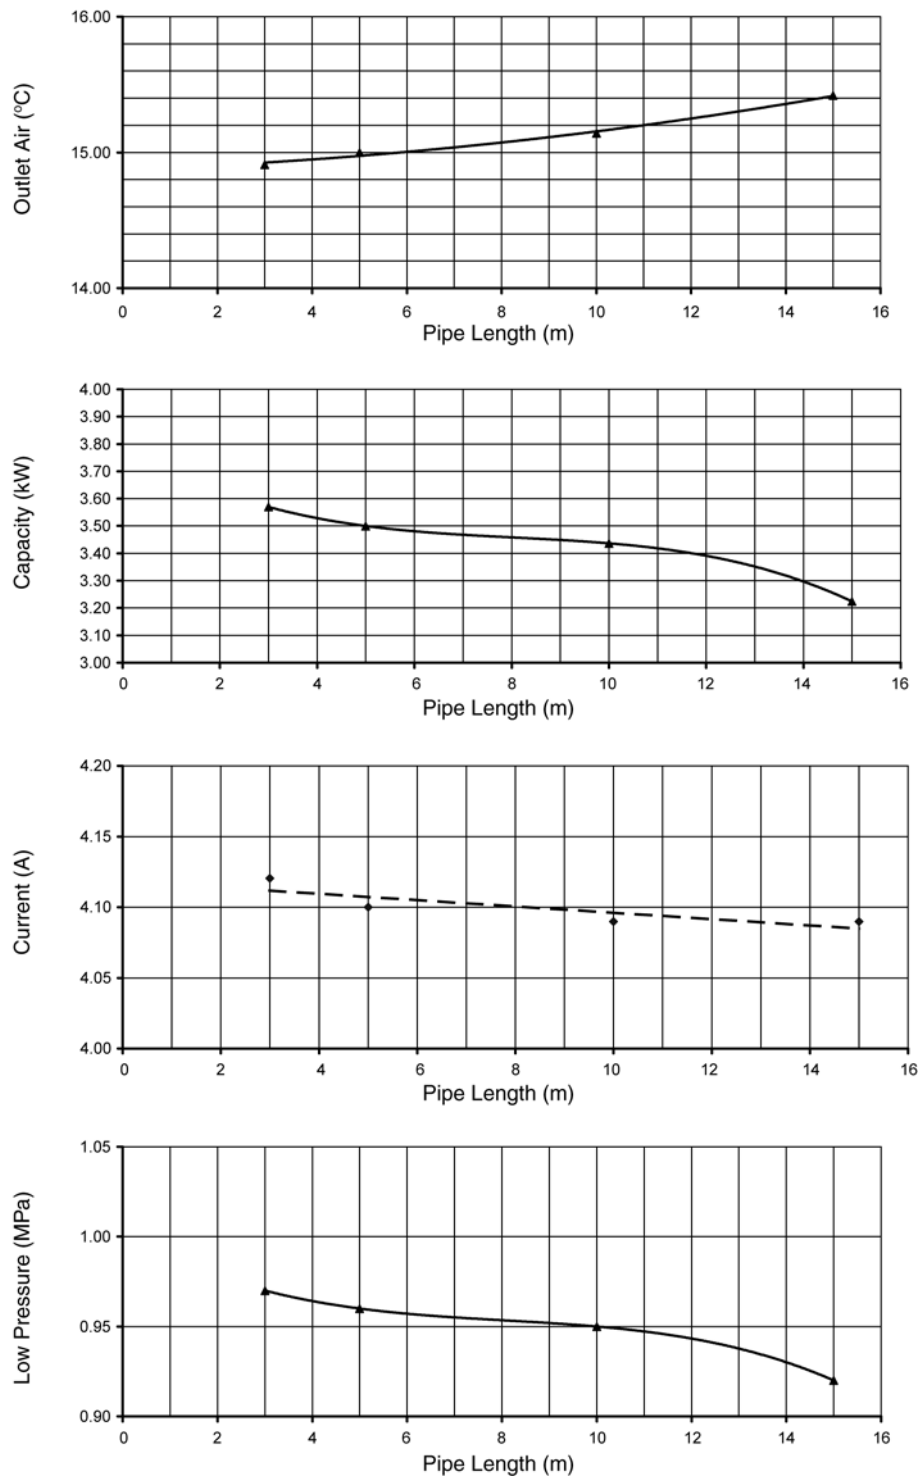





## • Heating Characteristic

[Condition] Indoor temperature: 20/-°C

Remote condition: High fan speed, Heat 30°C





Comp. Hz:  $F_h$

Voltage: 230V

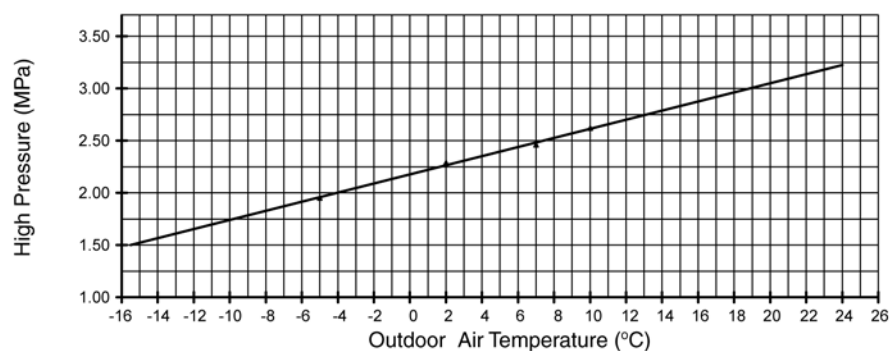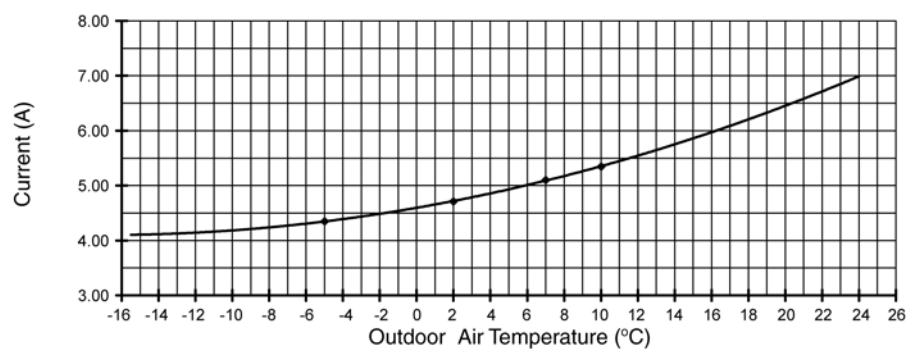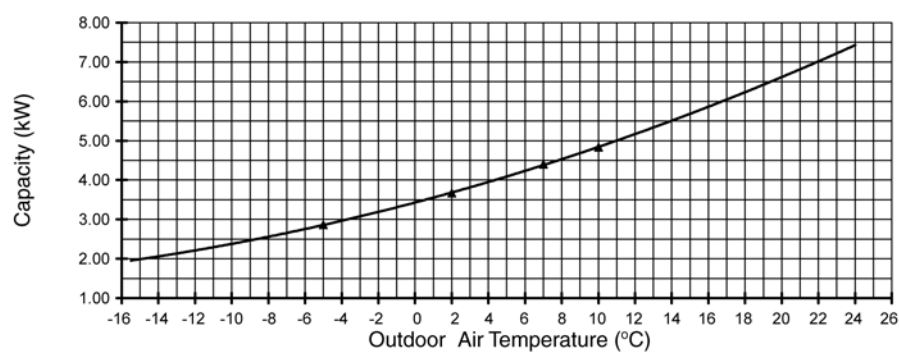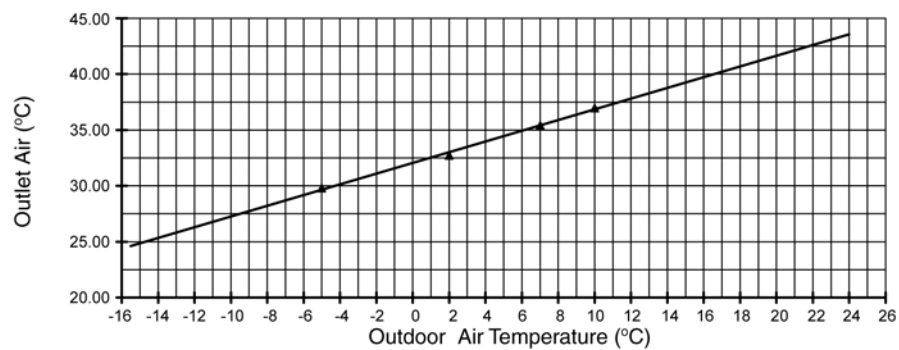

• Piping Length Characteristic

[Condition] Indoor temperature: 20/-°C, 7/6°C  
Remote condition: High fan speed, Heat 30°C  
Comp. Hz: F<sub>h</sub>  
Voltage: 230V

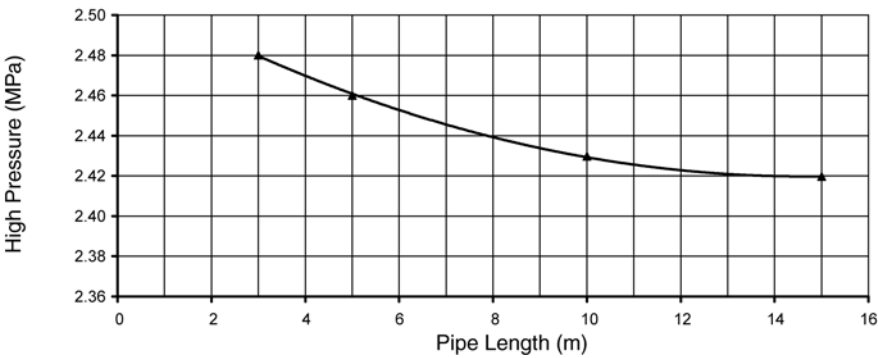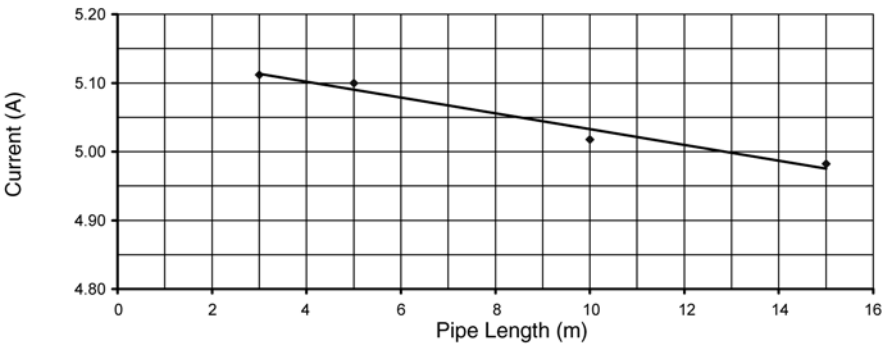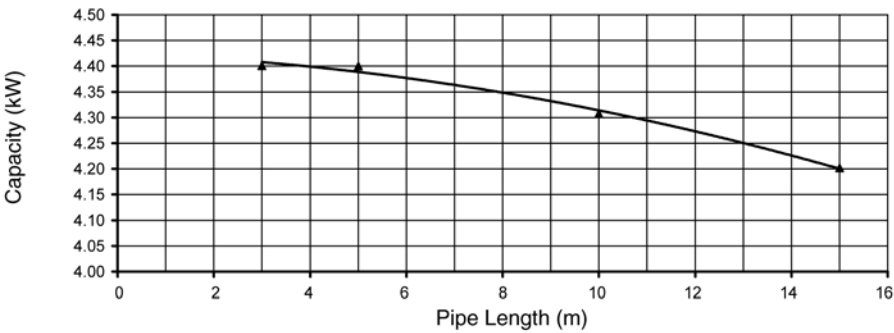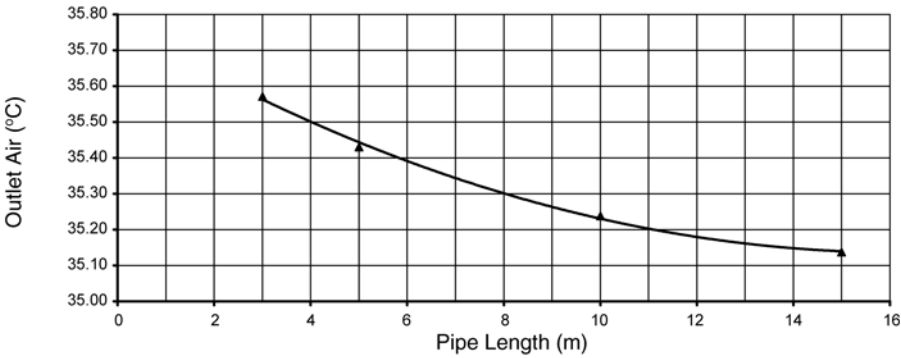

## 18.1.8. CU-E18LKE

### Cooling Characteristic at Different Outdoor Air Temperature


Condition

Indoor room temperature: 27/19°C

Remote control setting: HI FAN, COOL 16°C


Compressor frequency:  $F_c$

Voltage: 230 V

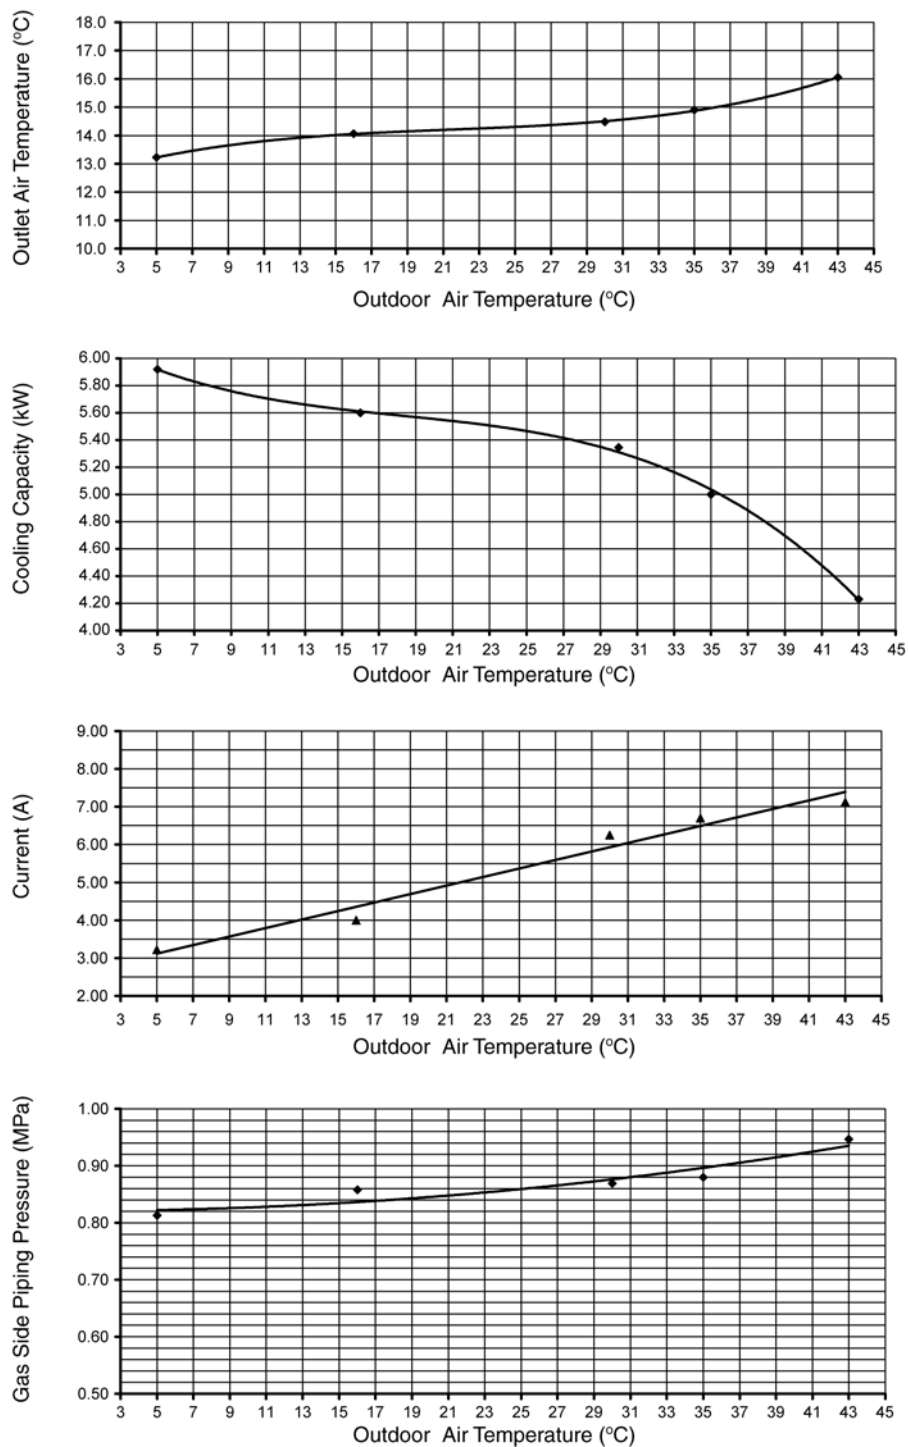

Cooling Characteristic at Different Piping Length

Condition  
Indoor room temperature: 27/19°C  
Remote control setting: HI FAN, COOL 16°C  
Compressor frequency: F<sub>C</sub>  
Voltage: 230 V

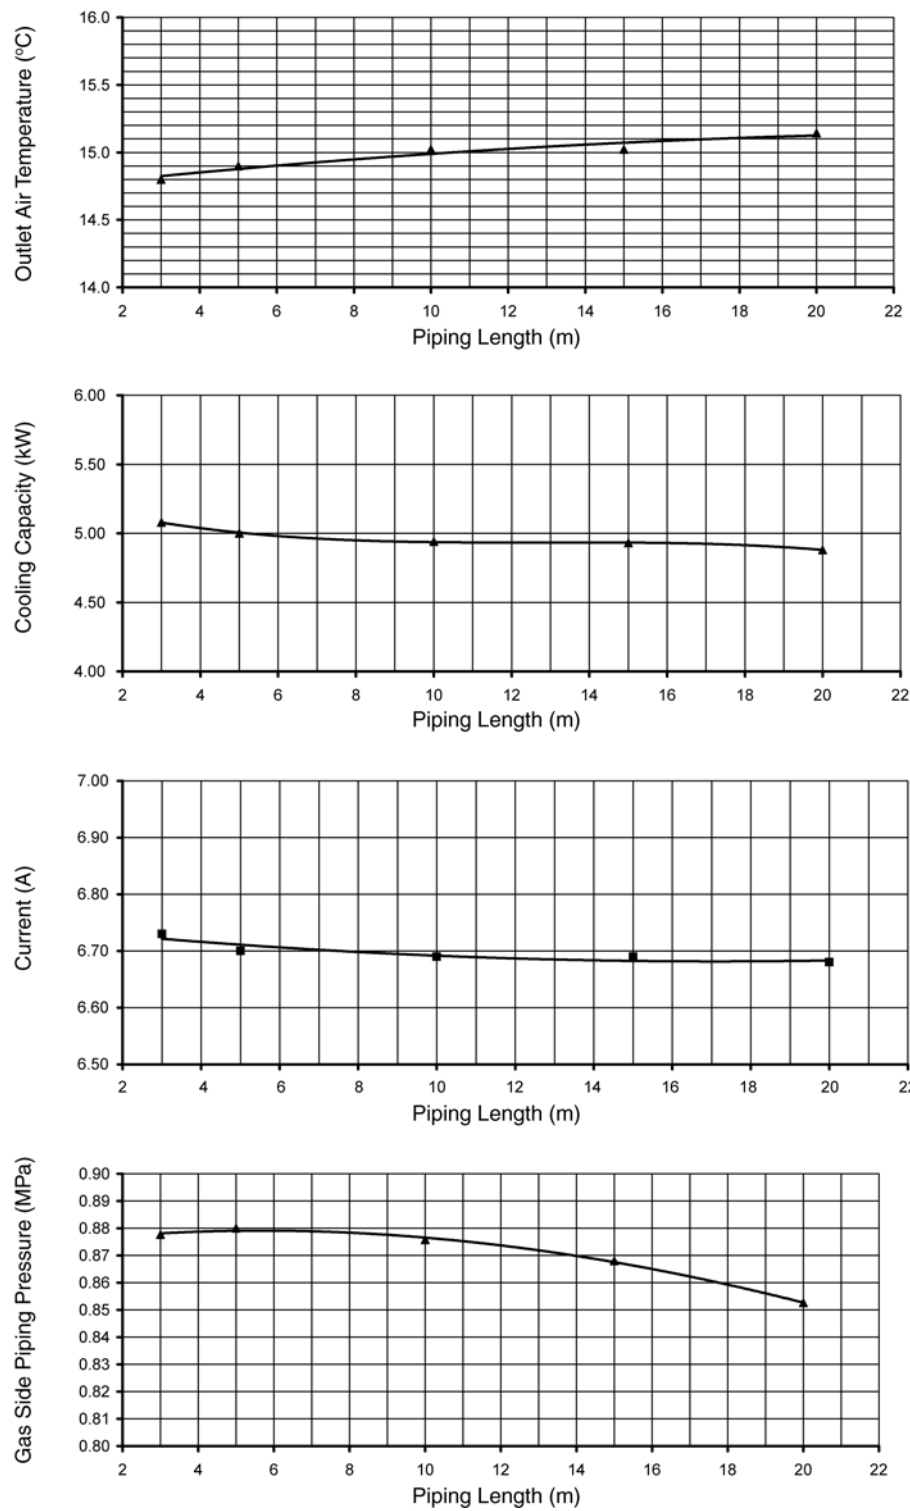



## Heating Characteristic at Different Outdoor Air Temperature





Condition

Indoor room temperature: 20/-°C

Remote control setting: HI FAN, HEAT 30°C


Compressor frequency:  $F_h$

Voltage: 230 V

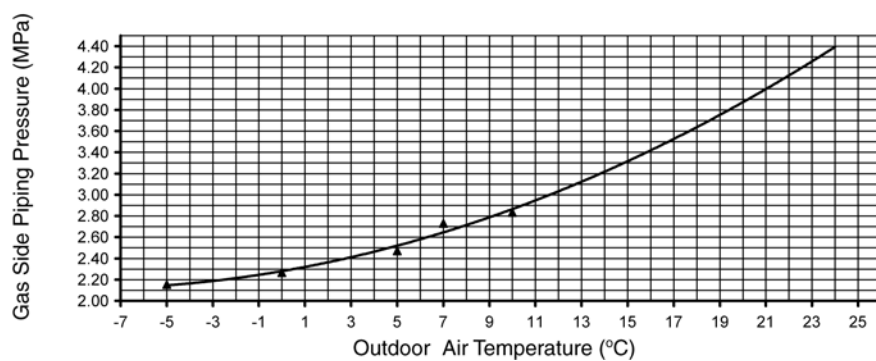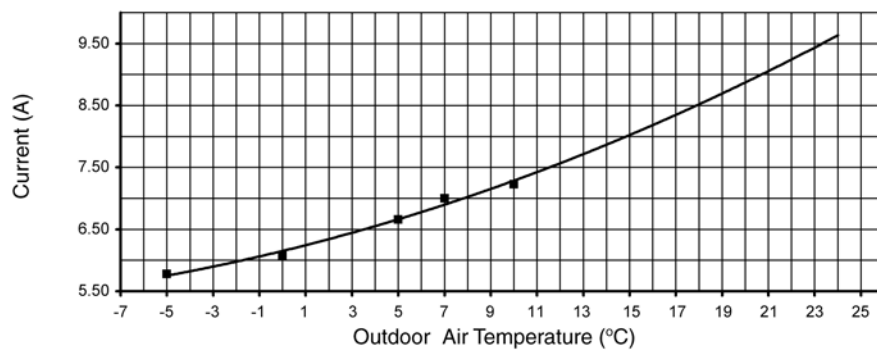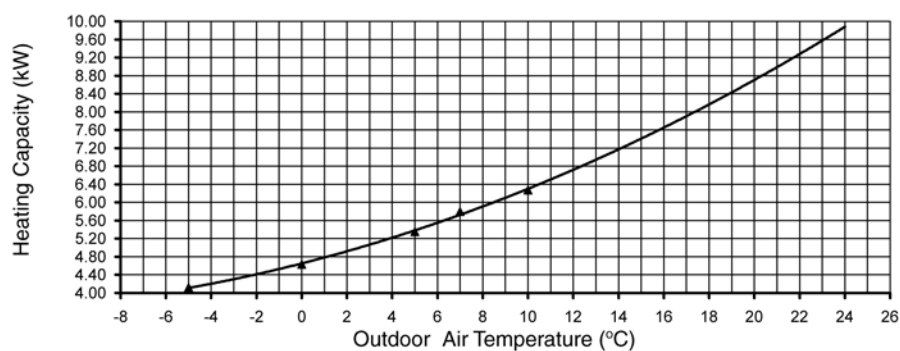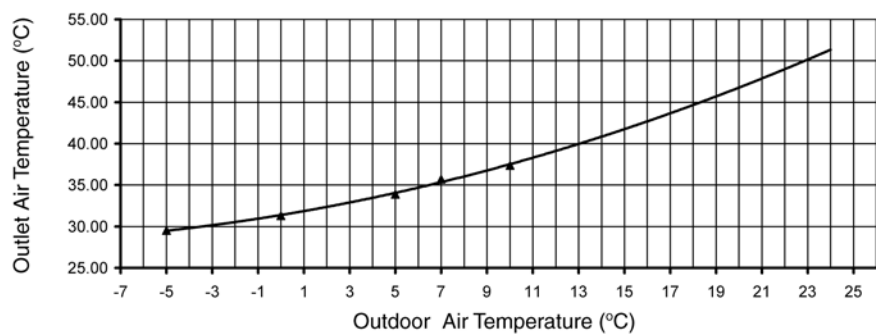

Heating Characteristic at Different Piping Length

Condition  
Indoor room temperature: 20/-°C. 7/6°C  
Remote control setting: HI FAN, HEAT 30°C  
Compressor frequency: F<sub>h</sub>  
Voltage: 230 V

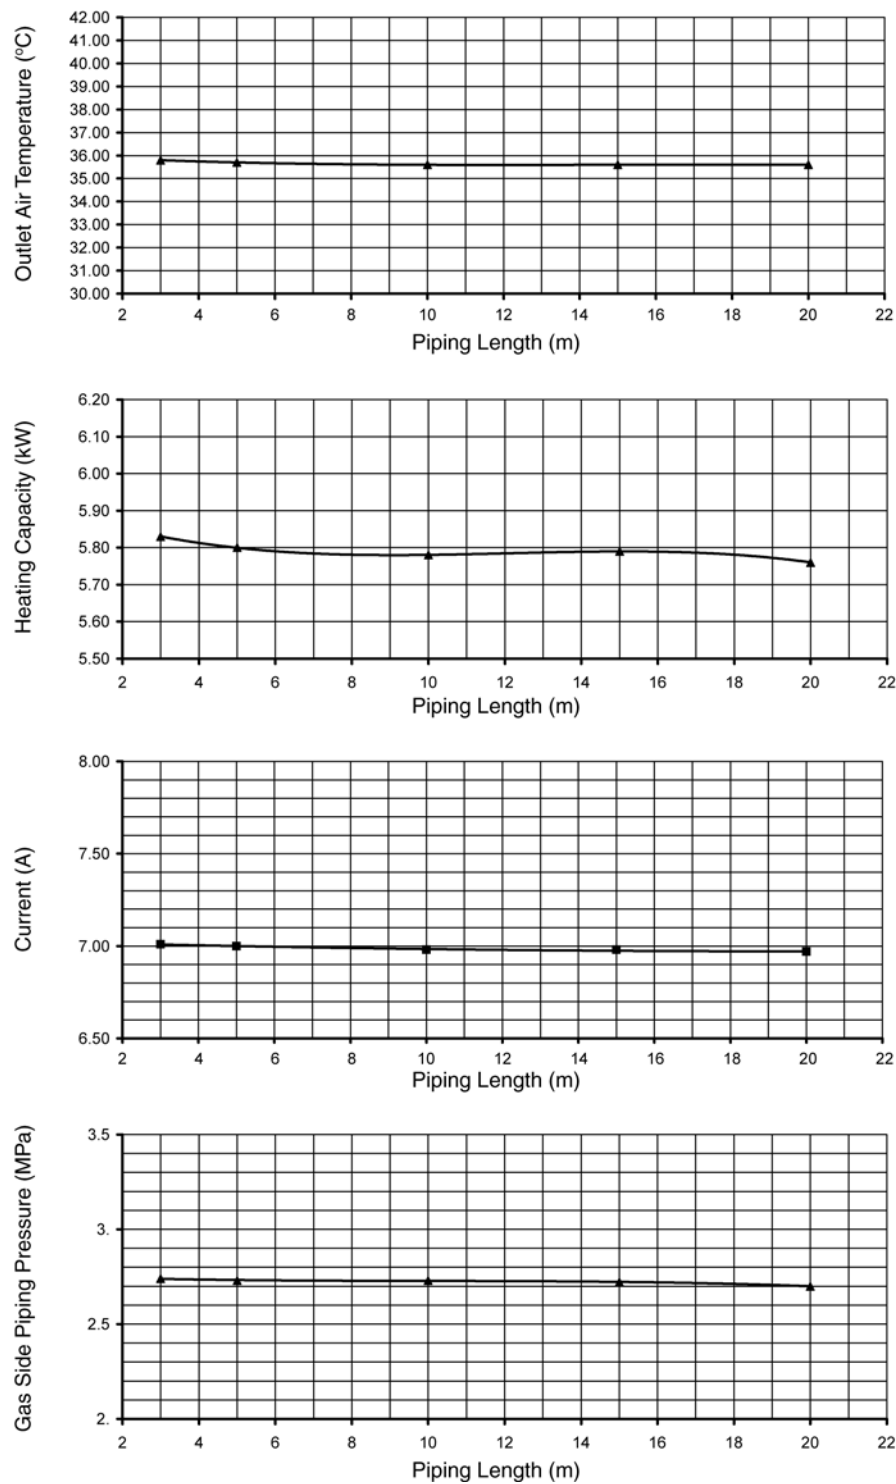

### 18.1.9. CU-E21LKE

#### Cooling Characteristic at Different Outdoor Air Temperature





Condition

Indoor room temperature: 27/19°C

Remote control setting: HI FAN, COOL 16°C


Compressor frequency:  $F_c$

Voltage: 230 V

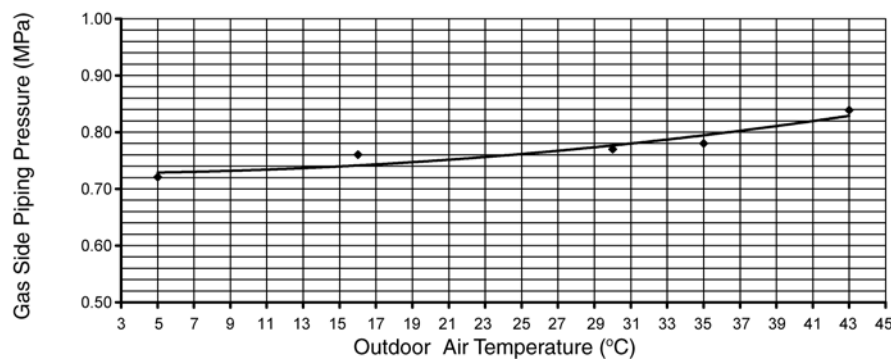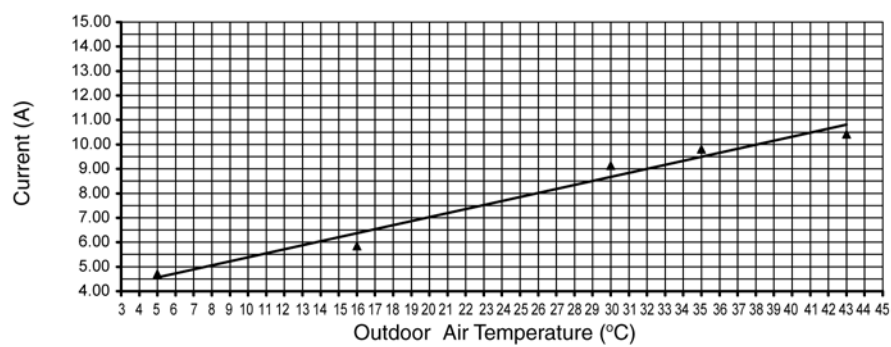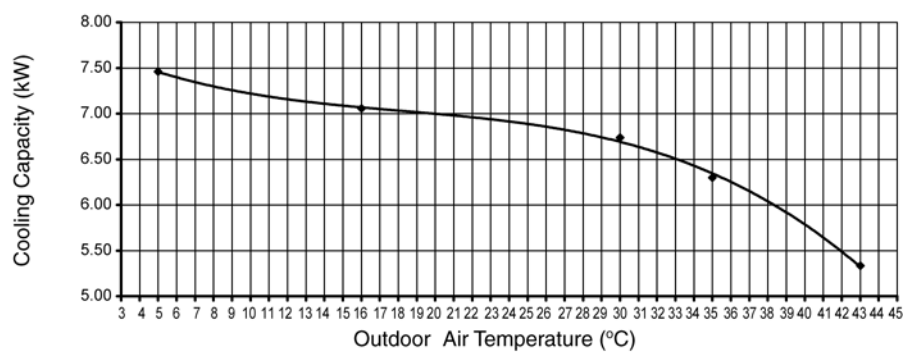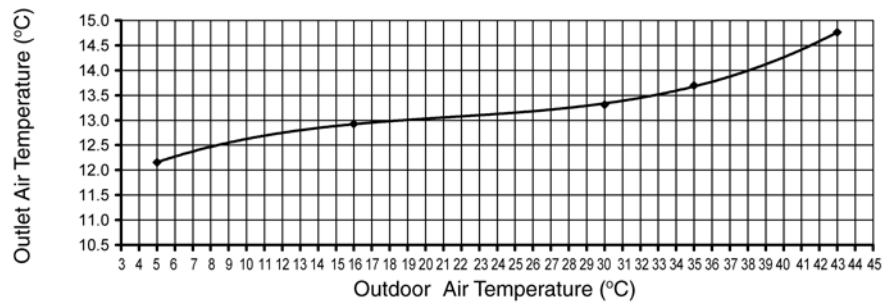

Cooling Characteristic at Different Piping Length

Condition  
Indoor room temperature: 27/19°C  
Remote control setting: HI FAN, COOL 16°C  
Compressor frequency:  $F_c$   
Voltage: 230 V

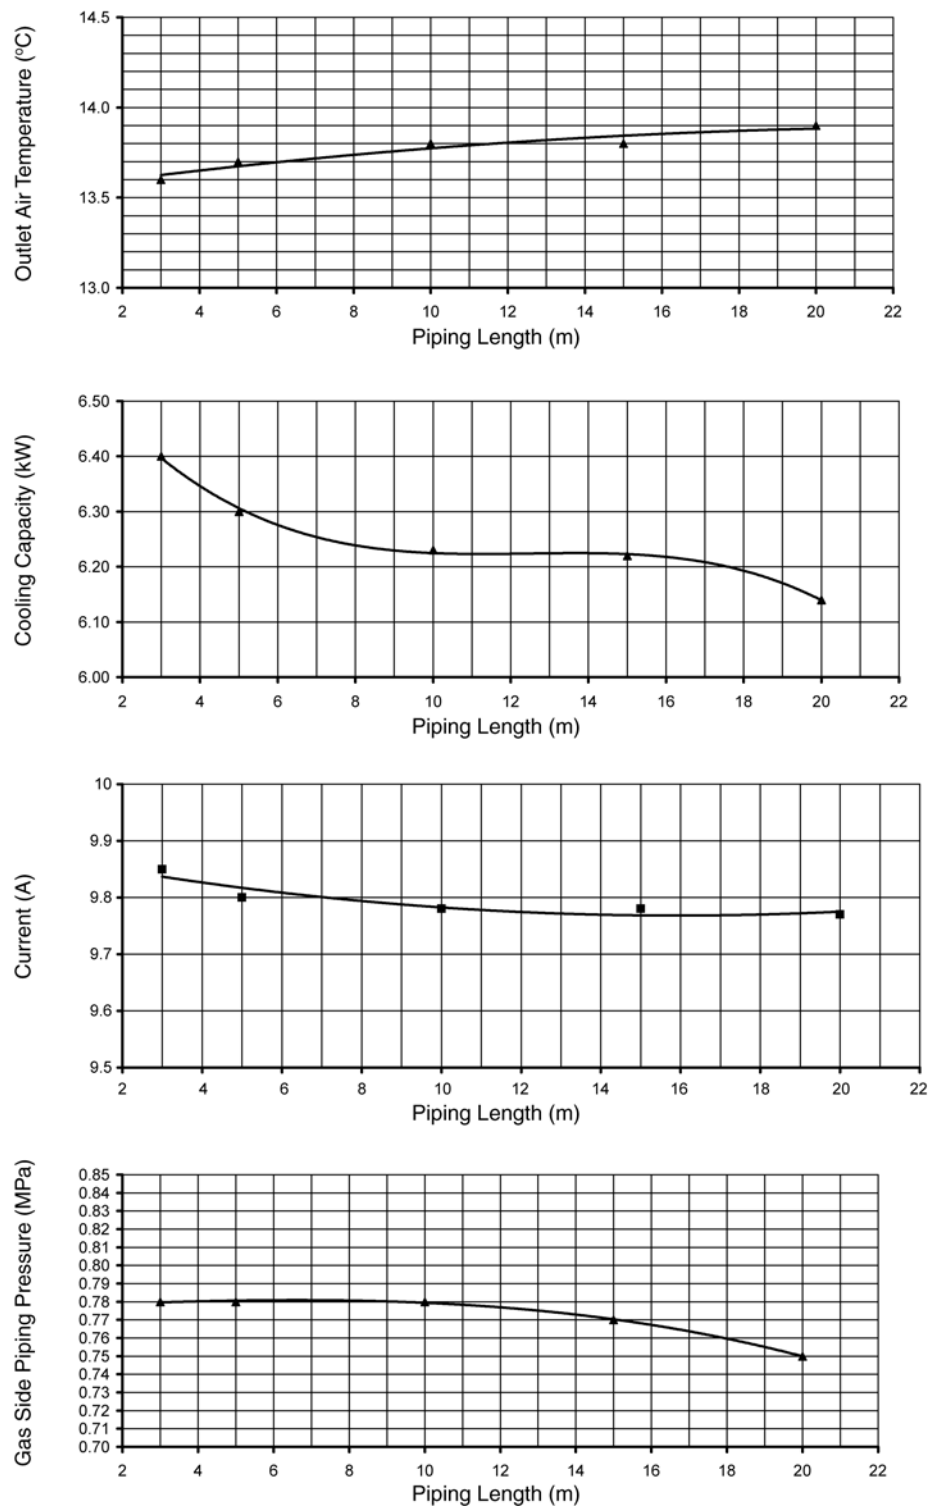

## Heating Characteristic at Different Outdoor Air Temperature





Condition

Indoor room temperature: 20/-°C

Remote control setting: HI FAN, HEAT 30°C


Compressor frequency:  $F_h$

Voltage: 230 V

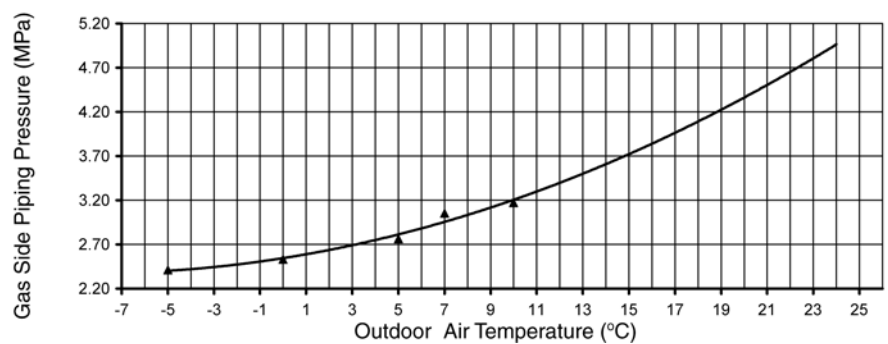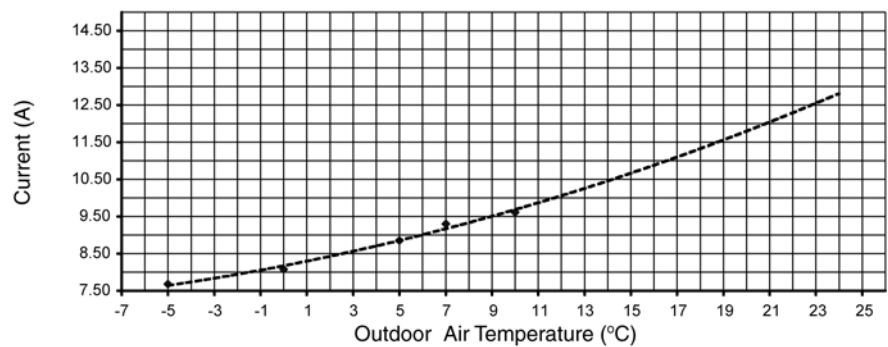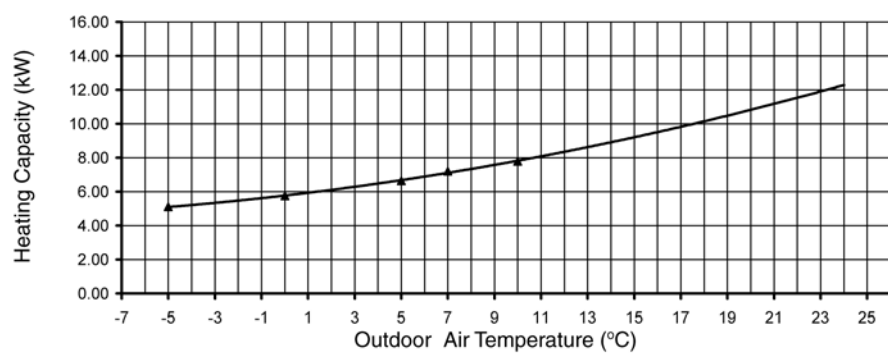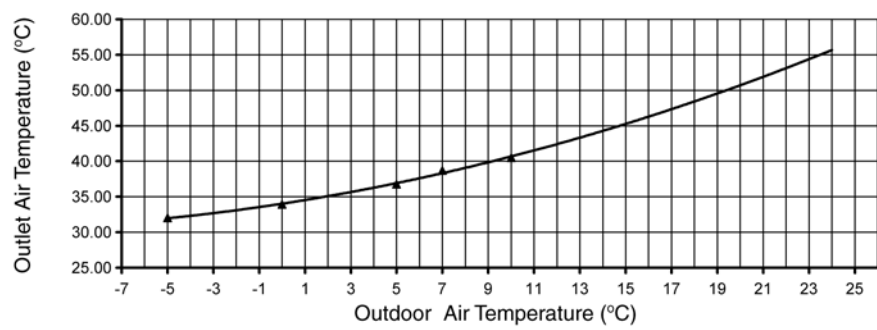

Heating Characteristic at Different Piping Length

Condition  
Indoor room temperature: 20/-°C. 7/6°C  
Remote control setting: HI FAN, HEAT 30°C  
Compressor frequency: F<sub>h</sub>  
Voltage: 230 V

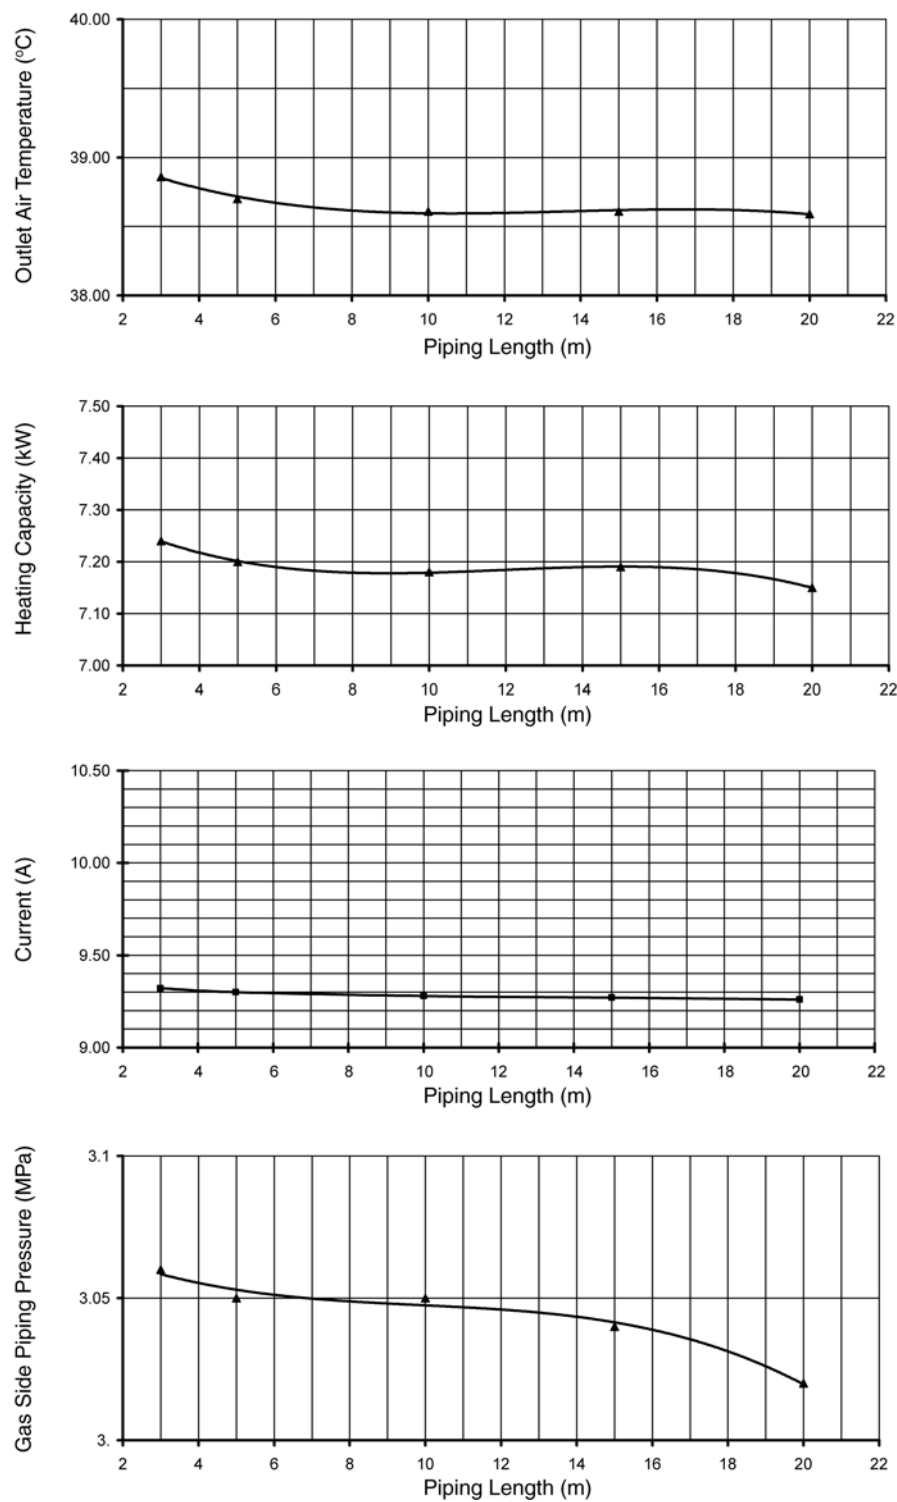

## 18.2. Sensible Capacity Chart

### ● CU-E7LKE CU-E7LKE-3

230V	Outdoor Temp. (°C)											
Indoor wet bulb temp.	30			35			40			46		
	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
17.0°C	2.03	1.54	0.43	1.90	1.48	0.46	1.77	1.42	0.50	1.61	1.35	0.53
19.0°C				2.05		0.47						
19.5°C	2.23	1.61	0.44	2.09	1.55	0.47	1.94	1.49	0.50	1.77	1.42	0.54
22.0°C	2.43	1.67	0.45	2.27	1.61	0.48	2.12	1.55	0.51	1.92	1.48	0.55

### ● CU-E9LKE CU-E9LKE-3

230V	Outdoor Temp. (°C)											
Indoor wet bulb temp.	30			35			40			46		
	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
17.0°C	2.48	1.88	0.49	2.32	1.80	0.53	2.16	1.73	0.57	1.96	1.65	0.61
19.0°C				2.50		0.54						
19.5°C	2.72	1.97	0.50	2.55	1.89	0.54	2.37	1.82	0.58	2.15	1.73	0.63
22.0°C	2.97	2.04	0.51	2.77	1.96	0.55	2.58	1.89	0.59	2.35	1.81	0.64

### ● CU-E12LKE

230V	Outdoor Temp. (°C)											
Indoor wet bulb temp.	30			35			40			46		
	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
17.0°C	3.47	2.63	0.79	3.24	2.52	0.85	3.02	2.43	0.91	2.74	2.30	0.98
19.0°C				3.50		0.86						
19.5°C	3.81	2.76	0.80	3.56	2.65	0.86	3.31	2.55	0.92	3.01	2.43	1.00
22.0°C	4.15	2.86	0.82	3.88	2.75	0.88	3.61	2.65	0.94	3.28	2.53	1.01

### ● CU-E12LKE-3

230V	Outdoor Temp. (°C)											
Indoor wet bulb temp.	30			35			40			46		
	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
17.0°C	3.47	2.63	0.83	3.24	2.52	0.90	3.02	2.43	0.96	2.74	2.30	1.03
19.0°C				3.50		0.91						
19.5°C	3.81	2.76	0.85	3.56	2.65	0.91	3.31	2.55	0.98	3.01	2.43	1.05
22.0°C	4.15	2.86	0.86	3.88	2.75	0.93	3.61	2.65	0.99	3.28	2.53	1.07

### ● CU-E15LKE

230V	Outdoor Temp. (°C)											
Indoor wet bulb temp.	30			35			40			46		
	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
17.0°C	4.17	3.16	1.15	3.89	3.03	1.24	3.62	2.91	1.33	3.29	2.77	1.43
19.0°C				4.20		1.26						
19.5°C	4.57	3.31	1.18	4.28	3.18	1.27	3.98	3.06	1.35	3.62	2.91	1.46
22.0°C	4.99	3.43	1.20	4.66	3.30	1.29	4.33	3.18	1.38	3.94	3.03	1.49

● CU-E18LKE

230V	Outdoor Temp. (°C)											
Indoor wet bulb temp.	30			35			40			46		
	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
17.0°C	4.96	3.76	1.35	4.64	3.61	1.45	4.31	3.47	1.55	3.92	3.29	1.67
19.0°C				5.00		1.47						
19.5°C	5.45	3.94	1.37	5.09	3.78	1.48	4.74	3.64	1.58	4.31	3.47	1.70
22.0°C	5.94	4.08	1.40	5.55	3.93	1.50	5.16	3.79	1.61	4.69	3.61	1.73

● CU-E21LKE

230V	Outdoor Temp. (°C)											
Indoor wet bulb temp.	30			35			40			46		
	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
17.0°C	6.25	4.74	2.02	5.84	4.54	2.18	5.43	4.37	2.33	4.94	4.15	2.51
19.0°C				6.30		2.21						
19.5°C	6.86	4.96	2.06	6.41	4.77	2.22	5.97	4.59	2.37	5.42	4.37	2.56
22.0°C	7.48	5.14	2.10	6.99	4.95	2.26	6.50	4.77	2.42	5.91	4.55	2.61

TC - Total Cooling Capacity (kW)

SHC - Sensible Heat Capacity (kW)

IP - Input Power (kW)

Indoor 27°C/19°C


Outdoor 35°C/24°C



# 19 Exploded View and Replacement Parts List

## 19.1. Indoor Unit

### 19.1.1. CS-E7LKEW CS-E9LKEW CS-E12LKEW CS-E15LKEW CS-XE7LKEW CS-XE9LKEW CS-XE12LKEW CS-XE15LKEW

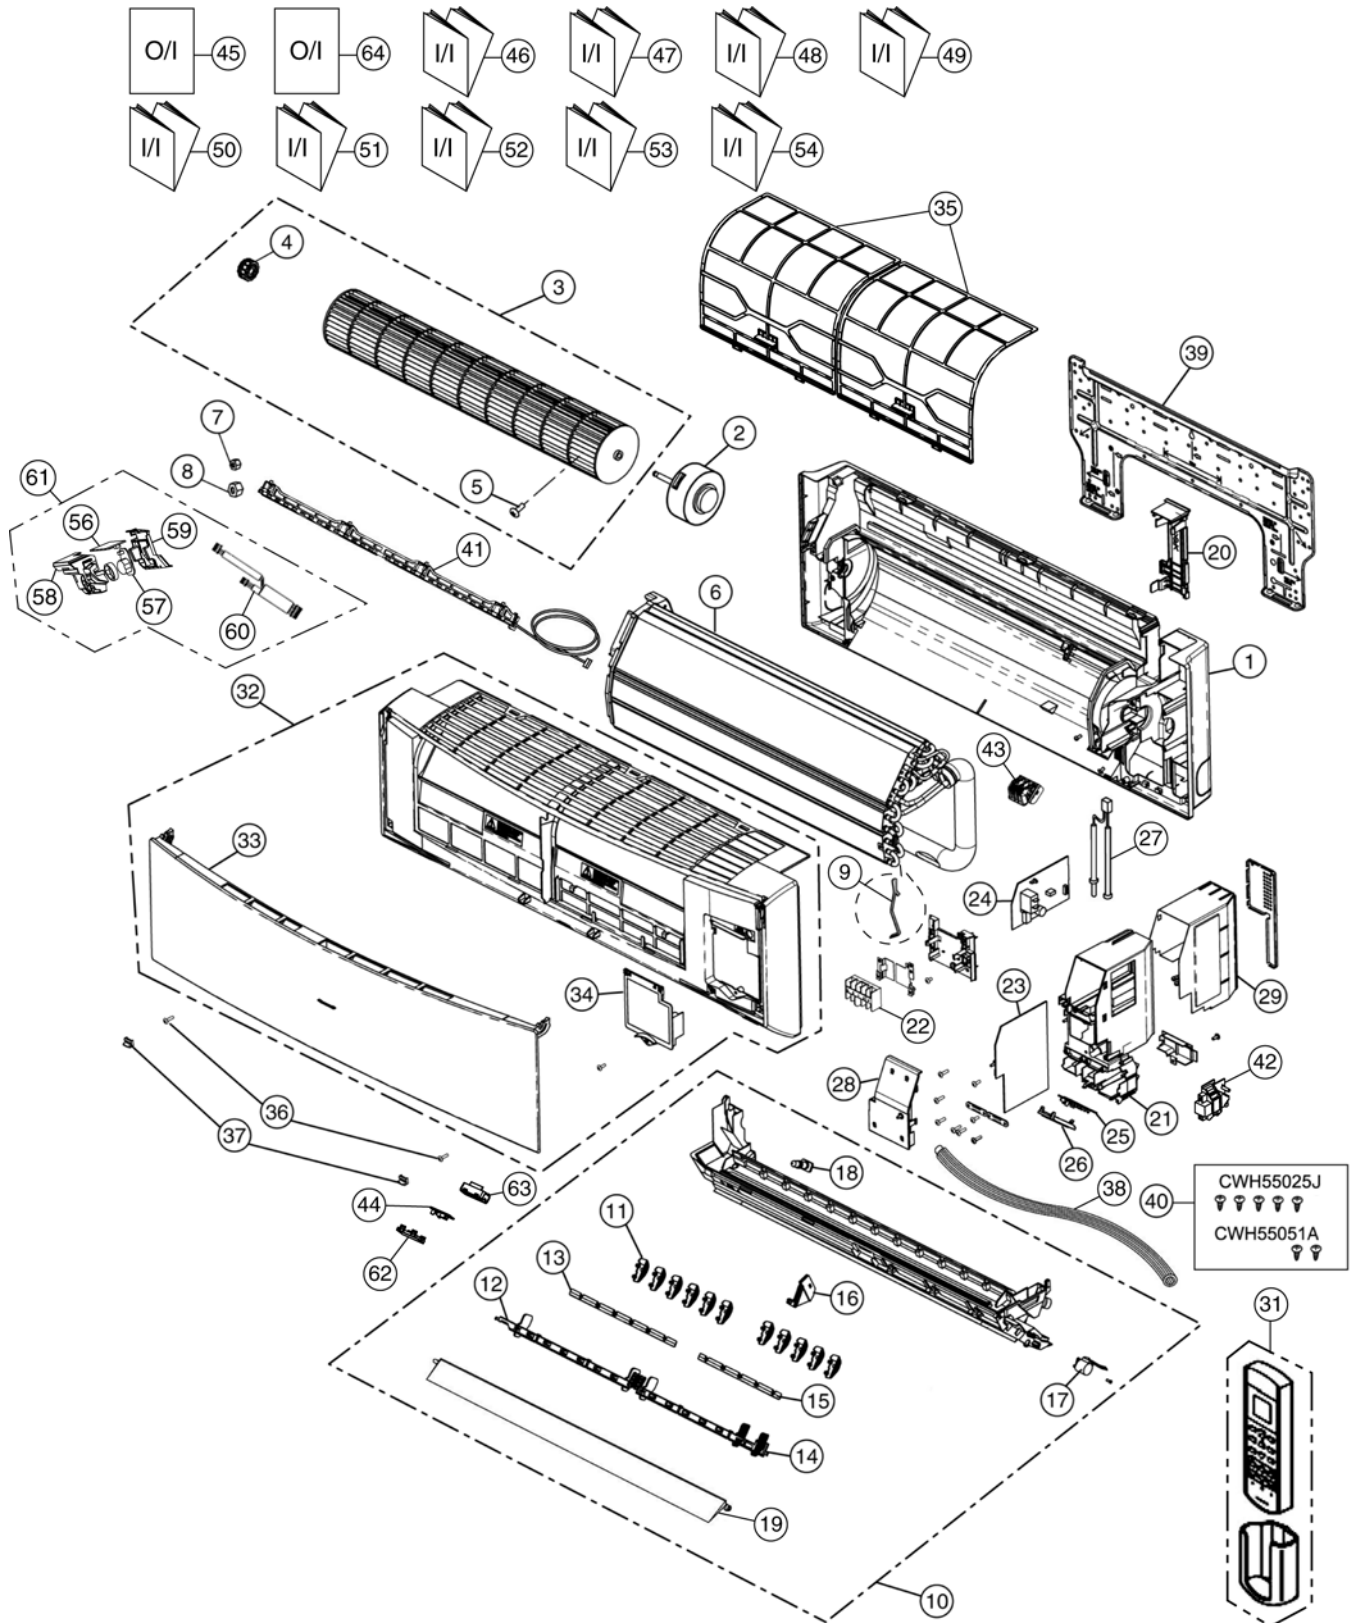

#### Note

The above exploded view is for the purpose of parts disassembly and replacement.  
The non-numbered parts are not kept as standard service parts.

REF. NO.	PART NAME & DESCRIPTION	QTY.	CS-E7LKEW	CS-E9LKEW	CS-E12LKEW	CS-E15LKEW	REMARKS
1	CHASSY COMPLETE	1	CWD50C1653	←	←	←	
2	FAN MOTOR	1	L6CBYYL0037	←	←	←	O
3	CROSS FLOW FAN COMPLETE	1	CWH02C1076	←	←	←	
4	BEARING ASSY	1	CWH64K007	←	←	←	
5	SCREW - CROSS FLOW FAN	1	CWH551146	←	←	←	
6	EVAPORATOR CO.	1	CWB30C2960	CWB30C2755	CWB30C2803	CWB30C2945	
7	FLARE NUT (LIQUID)	1	CWT251030	←	←	←	
8	FLARE NUT (GAS)	1	CWT251031	←	←	CWT251032	
9	CLIP FOR SENSOR	1	CWH32143	←	←	←	
10	DISCHARGE GRILLE COMPLETE	1	CWE20C3084	←	←	←	
11	VERTICAL VANE	11	CWE241287	←	←	←	
12	CONNECTING BAR	1	CWE261152	←	←	←	
13	CONNECTING BAR	1	CWE261153	←	←	←	
14	CONNECTING BAR	1	CWE261154	←	←	←	
15	CONNECTING BAR	1	CWE261155	←	←	←	
16	FULCRUM	1	CWH621102	←	←	←	
17	AIR SWING MOTOR	1	CWA981240	←	←	←	O
18	CAP - DRAIN TRAY	1	CWH521096	←	←	←	
19	HORIZONTAL VANE COMPLETE	1	CWE24C1268	←	←	←	
20	BACK COVER CHASSIS	1	CWD933019	←	←	←	
21	CONTROL BOARD CASING	1	CWH102370	←	←	←	
22	TERMINAL BOARD COMPLETE	1	CWA28C2357	←	←	←	O
23	ELECTRONIC CONTROLLER - MAIN	1	CWA73C4404	CWA73C4405	CWA73C4406	CWA73C4407	O
24	ELECTRONIC CONTROLLER - POWER	1	CWA745837	←	←	←	O
25	ELECTRONIC CONTROLLER - INDICATOR	1	CWA745634	←	←	←	O
26	INDICATOR HOLDER	1	CWD933021	←	←	←	
27	SENSOR COMPLETE	1	CWA50C2401	←	←	←	O
28	CONTROL BOARD FRONT COVER	1	CWH13C1183	←	←	←	
29	CONTROL BOARD TOP COVER	1	CWH131350	←	←	←	
31	REMOTE CONTROL COMPLETE	1	CWA75C3566	←	←	←	O
32	FRONT GRILLE COMPLETE	1	CWE11C4574	←	←	←	O
33	INTAKE GRILLE COMPLETE	1	CWE22C1507	←	←	←	
34	GRILLE DOOR COMPLETE	1	CWE14C1029	←	←	←	
35	E-ION FILTER	2	CWD00K1014	←	←	←	
36	SCREW - FRONT GRILLE	2	XTT4+16CFJ	←	←	←	
37	CAP - FRONT GRILLE	2	CWH521194	←	←	←	
38	DRAIN HOSE	1	CWH851173	←	←	←	
39	INSTALLATION PLATE	1	CWH361097	←	←	←	
40	BAG COMPLETE - INSTALLATION SCREW	1	CWH82C1705	←	←	←	
41	E-ION AIR PURIFYING SYSTEM	1	CWD93C1090	←	←	←	
42	ELECTRONIC CONTROLLER - HVU	1	CWA745348	←	←	←	O
43	GENERATOR COMPLETE	1	CWH94C0028	←	←	←	O
44	ELECTRONIC CONTROLLER - RECEIVER	1	CWA745288	←	←	←	
45	OPERATION INSTRUCTIONS	1	CWF567264	←	←	←	
46	INSTALLATION INSTRUCTIONS	1	CWF614346	←	←	←	
47	INSTALLATION INSTRUCTIONS	1	CWF614204	←	←	←	
48	INSTALLATION INSTRUCTIONS	1	CWF614205	←	←	←	
49	INSTALLATION INSTRUCTIONS	1	CWF614206	←	←	←	
50	INSTALLATION INSTRUCTIONS	1	CWF614207	←	←	←	
51	INSTALLATION INSTRUCTIONS	1	CWF614208	←	←	←	
52	INSTALLATION INSTRUCTIONS	1	CWF614209	←	←	←	
53	INSTALLATION INSTRUCTIONS	1	CWF614210	←	←	←	
54	INSTALLATION INSTRUCTIONS	1	CWF614211	←	←	←	
56	ELECTRONIC CONTROLLER - COMPARATOR	1	CWA745790	←	←	←	

REF. NO.	PART NAME & DESCRIPTION	QTY.	CS-E7LKEW	CS-E9LKEW	CS-E12LKEW	CS-E15LKEW	REMARKS
57	ELECTRONIC CONTROLLER - ECO PATROL	1	CWA745791	←	←	←	
58	COVER FOR PCB ECO (UPPER)	1	CWD933192	←	←	←	
59	COVER FOR PCB ECO (BOTTOM)	1	CWD933193	←	←	←	
60	LEAD WIRE - PCB ECO	1	CWA67C8483	←	←	←	
61	SENSOR COMPLETE (ECO)	1	CWA50C2708	←	←	←	
62	COVER FOR RECEIVER (UPPER)	1	CWD933022	←	←	←	
63	COVER FOR RECEIVER (BOTTOM)	1	CWD933209	←	←	←	
64	OPERATION INSTRUCTIONS	1	CWF567265	←	←	←	

(NOTE)

- All parts are supplied from PHAAM, Malaysia (Vendor Code: 00029488).
- "O" marked parts are recommended to be kept in stock.


REF. NO.	PART NAME & DESCRIPTION	QTY.	CS-XE7LKEW	CS-XE9LKEW	CS-XE12LKEW	CS-XE15LKEW	REMARKS
1	CHASSY COMPLETE	1	CWD50C1605	←	←	←	
2	FAN MOTOR	1	L6CBYYYL0037	←	←	←	O
3	CROSS FLOW FAN COMPLETE	1	CWH02C1076	←	←	←	
4	BEARING ASSY	1	CWH64K007	←	←	←	
5	SCREW - CROSS FLOW FAN	1	CWH551146	←	←	←	
6	EVAPORATOR CO.	1	CWB30C2960	CWB30C2755	CWB30C2803	CWB30C2945	
7	FLARE NUT (LIQUID)	1	CWT251030	←	←	←	
8	FLARE NUT (GAS)	1	CWT251031	←	←	CWT251032	
9	CLIP FOR SENSOR	1	CWH32143	←	←	←	
10	DISCHARGE GRILLE COMPLETE	1	CWE20C3083	←	←	←	
11	VERTICAL VANE	11	CWE241287	←	←	←	
12	CONNECTING BAR	1	CWE261152	←	←	←	
13	CONNECTING BAR	1	CWE261153	←	←	←	
14	CONNECTING BAR	1	CWE261154	←	←	←	
15	CONNECTING BAR	1	CWE261155	←	←	←	
16	FULCRUM	1	CWH621102	←	←	←	
17	AIR SWING MOTOR	1	CWA981240	←	←	←	O
18	CAP - DRAIN TRAY	1	CWH521096	←	←	←	
19	HORIZONTAL VANE COMPLETE	1	CWE24C1288	←	←	←	
20	BACK COVER CHASSIS	1	CWD933019A	←	←	←	
21	CONTROL BOARD CASING	1	CWH102370	←	←	←	
22	TERMINAL BOARD COMPLETE	1	CWA28C2357	←	←	←	O
23	ELECTRONIC CONTROLLER - MAIN	1	CWA73C4404	CWA73C4405	CWA73C4406	CWA73C4407	O
24	ELECTRONIC CONTROLLER - POWER	1	CWA745837	←	←	←	O
25	ELECTRONIC CONTROLLER - INDICATOR	1	CWA745634	←	←	←	O
26	INDICATOR HOLDER	1	CWD933021	←	←	←	
27	SENSOR COMPLETE	1	CWA50C2401	←	←	←	O
28	CONTROL BOARD FRONT COVER	1	CWH13C1183	←	←	←	
29	CONTROL BOARD TOP COVER	1	CWH131350	←	←	←	
31	REMOTE CONTROL COMPLETE	1	CWA75C3566	←	←	←	O
32	FRONT GRILLE COMPLETE	1	CWE11C4573	←	←	←	O
33	INTAKE GRILLE COMPLETE	1	CWE22C1482	←	←	←	
34	GRILLE DOOR COMPLETE	1	CWE14C1038	←	←	←	
35	E-ION FILTER	2	CWD00K1014	←	←	←	
36	SCREW - FRONT GRILLE	2	XTT4+16CFJ	←	←	←	
37	CAP - FRONT GRILLE	2	CWH521194A	←	←	←	
38	DRAIN HOSE	1	CWH851173	←	←	←	
39	INSTALLATION PLATE	1	CWH361097	←	←	←	
40	BAG COMPLETE - INSTALLATION SCREW	1	CWH82C1705	←	←	←	
41	E-ION AIR PURIFYING SYSTEM	1	CWD93C1090	←	←	←	
42	ELECTRONIC CONTROLLER - HVU	1	CWA745348	←	←	←	O
43	GENERATOR COMPLETE	1	CWH94C0028	←	←	←	O
44	ELECTRONIC CONTROLLER - RECEIVER	1	CWA745288	←	←	←	
45	OPERATION INSTRUCTIONS	1	CWF567264	←	←	←	
46	INSTALLATION INSTRUCTIONS	1	CWF614346	←	←	←	
47	INSTALLATION INSTRUCTIONS	1	CWF614204	←	←	←	
48	INSTALLATION INSTRUCTIONS	1	CWF614205	←	←	←	
49	INSTALLATION INSTRUCTIONS	1	CWF614206	←	←	←	
50	INSTALLATION INSTRUCTIONS	1	CWF614207	←	←	←	
51	INSTALLATION INSTRUCTIONS	1	CWF614208	←	←	←	
52	INSTALLATION INSTRUCTIONS	1	CWF614209	←	←	←	
53	INSTALLATION INSTRUCTIONS	1	CWF614210	←	←	←	
54	INSTALLATION INSTRUCTIONS	1	CWF614211	←	←	←	
56	ELECTRONIC CONTROLLER - COMPARATOR	1	CWA745790	←	←	←	

REF. NO.	PART NAME & DESCRIPTION	QTY.	CS-XE7LKEW	CS-XE9LKEW	CS-XE12LKEW	CS-XE15LKEW	REMARKS
57	ELECTRONIC CONTROLLER - ECO PATROL	1	CWA745791	←	←	←	
58	COVER FOR PCB ECO (UPPER)	1	CWD933192	←	←	←	
59	COVER FOR PCB ECO (BOTTOM)	1	CWD933193	←	←	←	
60	LEAD WIRE - PCB ECO	1	CWA67C8483	←	←	←	
61	SENSOR COMPLETE (ECO)	1	CWA50C2708	←	←	←	
62	COVER FOR RECEIVER (UPPER)	1	CWD933022	←	←	←	
63	COVER FOR RECEIVER (BOTTOM)	1	CWD933209	←	←	←	
64	OPERATION INSTRUCTIONS	1	CWF567265	←	←	←	

(NOTE)

- All parts are supplied from PHAAM, Malaysia (Vendor Code: 00029488).
- "O" marked parts are recommended to be kept in stock.

## 19.1.2. CS-E18LKEW CS-E21LKEW CS-XE18LKEW CS-XE21LKEW

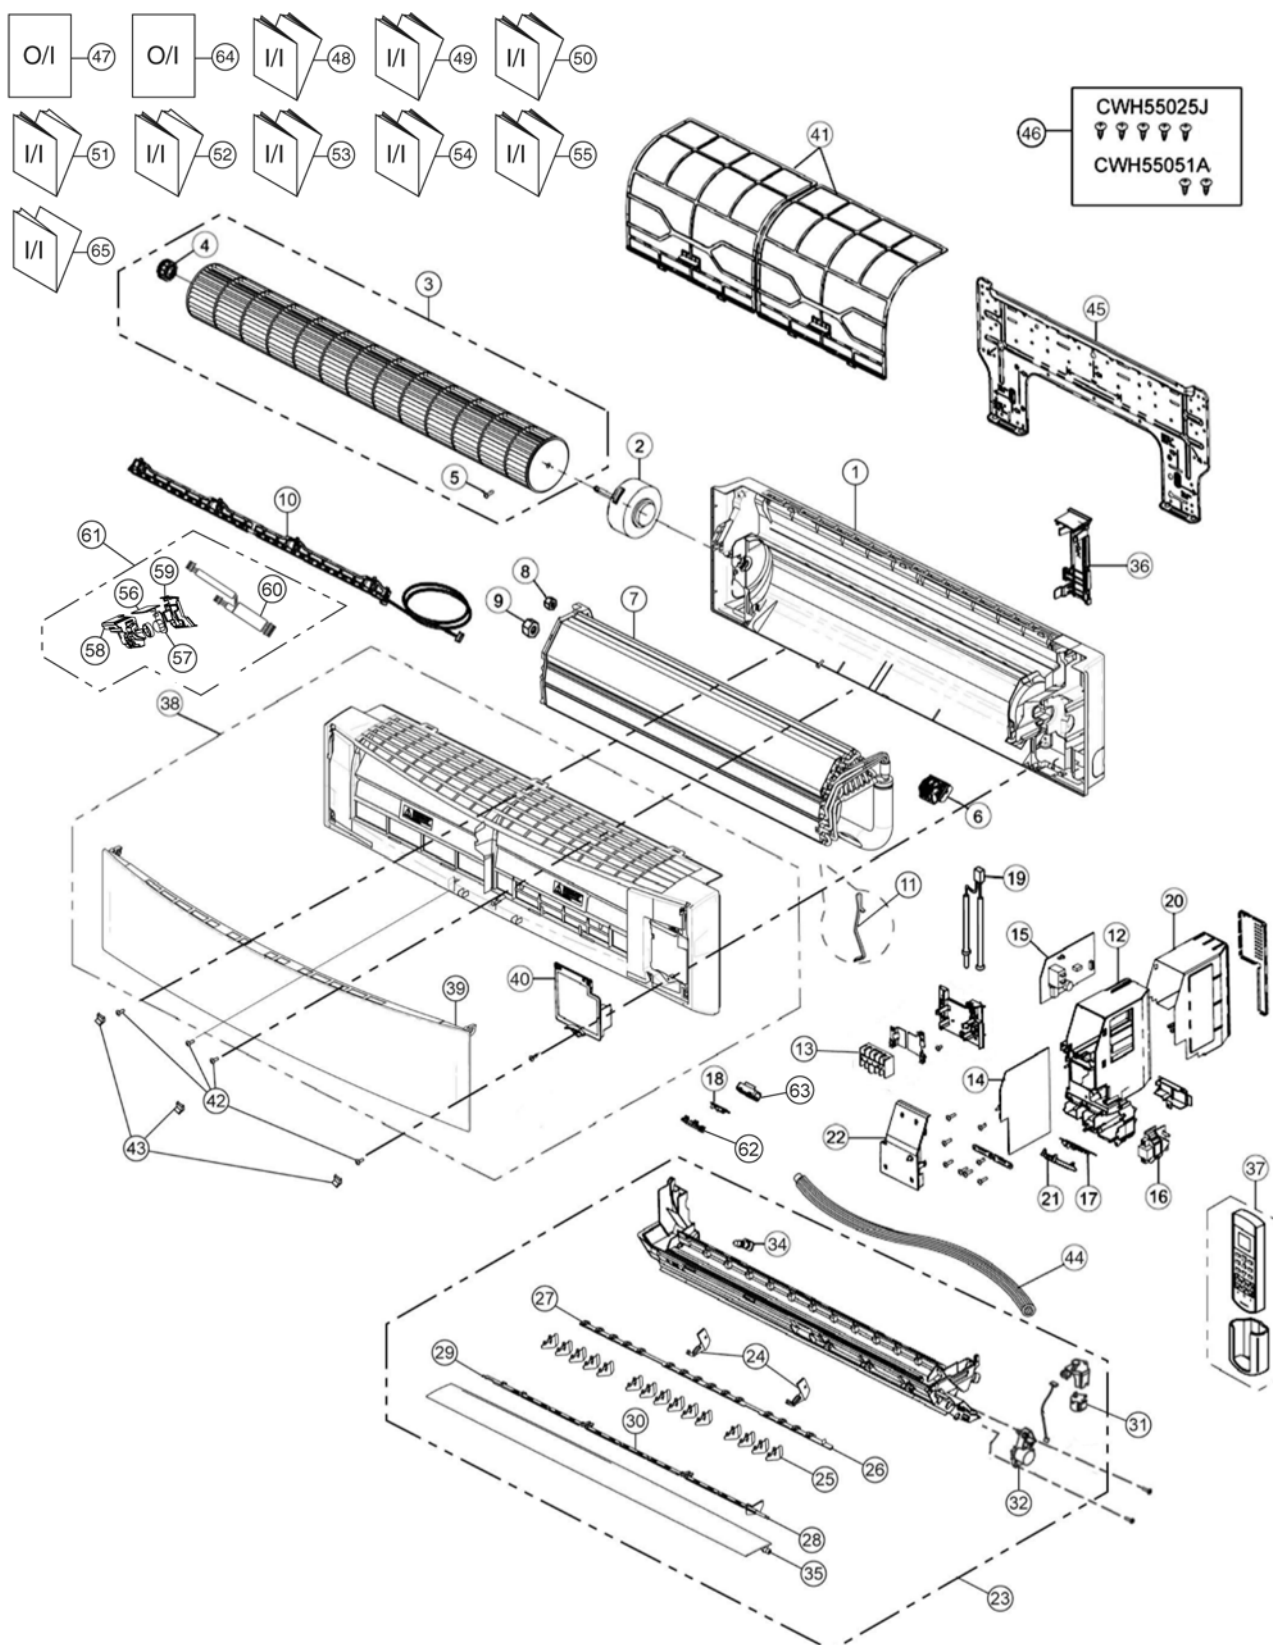

### Note

The above exploded view is for the purpose of parts disassembly and replacement.  
The non-numbered parts are not kept as standard service parts.

REF NO.	PART NAME & DESCRIPTION	QTY.	CS-E18LKEW	CS-E21LKEW	CS-XE18LKEW	CS-XE21LKEW	REMARKS
1	CHASSY COMPLETE	1	CWD50C1654	←	CWD50C1604	←	
2	FAN MOTOR	1	L6CBYYL0039	←	←	←	O
3	CROSS FLOW FAN COMPLETE	1	CWH02C1077	←	←	←	
4	BEARING ASS'Y	1	CWH64K007	←	←	←	
5	SCREW - CROSS FLOW FAN	1	CWH551146	←	←	←	
6	GENERATOR COMPLETE	1	CWH94C0028	←	←	←	
7	EVAPORATOR	1	CWB30C2900	←	←	←	
8	FLARE NUT (LIQUID)	1	CWT251030	←	←	←	
9	FLARE NUT (GAS)	1	CWT251032	←	←	←	
10	E-ION AIR PURIFYING SYSTEM	1	CWD93C1090	←	←	←	
11	HOLDER SENSOR	1	CWH32143	←	←	←	
12	CONTROL BOARD CASING	1	CWH102370	←	←	←	
13	TERMINAL BOARD COMPLETE	1	CWA28C2357	←	←	←	O
14	ELECTRONIC CONTROLLER - MAIN	1	CWA73C4408	CWA73C4409	CWA73C4408	CWA73C4409	O
15	ELECTRONIC CONTROLLER - POWER	1	CWA745837	←	←	←	O
16	ELECTRONIC CONTROLLER - HVU	1	CWA745348	←	←	←	O
17	ELECTRONIC CONTROLLER - INDICATOR	1	CWA745634	←	←	←	O
18	ELECTRONIC CONTROLLER - RECEIVER	1	CWA745288	←	←	←	O
19	SENSOR COMPLETE	1	CWA50C2401	←	←	←	O
20	CONTROL BOARD TOP COVER	1	CWH131350	←	←	←	
21	INDICATOR HOLDER	1	CWD933021	←	←	←	
22	CONTROL BOARD FRONT COVER	1	CWH13C1183	←	←	←	
23	DISCHARGE GRILLE COMPLETE	1	CWE20C3007	←	CWE20C2922	←	
24	FULCRUM	2	CWH621103	←	←	←	
25	VERTICAL VANE	15	CWE241289	←	←	←	
26	CONNECTING BAR	1	CWE261156	←	←	←	
27	CONNECTING BAR	1	CWE261158	←	←	←	
28	CONNECTING BAR	1	CWE261157	←	←	←	
29	CONNECTING BAR	1	CWE261159	←	←	←	
30	CONNECTING BAR	1	CWE261160	←	←	←	
31	AIR SWING MOTOR	1	CWA98K1014	←	←	←	O
32	AIR SWING MOTOR	1	CWA981241	←	←	←	O
34	CAP - DRAIN TRAY	1	CWH521096	←	←	←	
35	HORIZONTAL VANE	1	CWE24C1295	←	CWE24C1296	←	
36	BACK COVER CHASSIS	1	CWD933031	←	CWD933031A	←	
37	REMOTE CONTROL COMPLETE	1	CWA75C3556	←	←	←	O
38	FRONT GRILLE COMPLETE	1	CWE11C4583	←	CWE11C4582	←	O
39	INTAKE GRILLE COMPLETE	1	CWE22C1483	←	CWE22C1526	←	O
40	GRILLE DOOR	1	CWE14C1029	←	CWE14C1038	←	
41	E-ION FILTER	2	CWD00K1017	←	←	←	
42	SCREW - FRONT GRILLE	4	XTT4+16CFJ	←	←	←	
43	CAP - FRONT GRILLE	3	CWH521194	←	CWH521194A	←	
44	DRAIN HOSE	1	CWH851173	←	←	←	
45	INSTALLATION PLATE	1	CWH361098	←	←	←	
46	BAG COMPLETE - INSTALLATION SCREW	1	CWH82C1705	←	←	←	
47	OPERATING INSTRUCTION	1	CWF567264	←	←	←	
48	INSTALLATION INSTRUCTION	1	CWF614346	←	←	←	
49	INSTALLATION INSTRUCTION	1	CWF614204	←	←	←	
50	INSTALLATION INSTRUCTION	1	CWF614205	←	←	←	
51	INSTALLATION INSTRUCTION	1	CWF614206	←	←	←	
52	INSTALLATION INSTRUCTION	1	CWF614207	←	←	←	
53	INSTALLATION INSTRUCTION	1	CWF614208	←	←	←	
54	INSTALLATION INSTRUCTION	1	CWF614209	←	←	←	
55	INSTALLATION INSTRUCTION	1	CWF614210	←	←	←	

REF NO.	PART NAME & DESCRIPTION	QTY.	CS-E18LKEW	CS-E21LKEW	CS-XE18LKEW	CS-XE21LKEW	REMARKS
56	ELECTRONIC CONTROLLER - COMPARATOR	1	CWA745790	←	←	←	O
57	ELECTRONIC CONTROLLER - ECO PATROL	1	CWA745791	←	←	←	O
58	COVER FOR PCB ECO (UPPER)	1	CWD933192	←	←	←	O
59	COVER FOR PCB ECO (BOTTOM)	1	CWD933193	←	←	←	O
60	LEAD WIRE - PCB ECO	1	CWA67C8484	←	←	←	O
61	SENSOR COMPLETE (ECO)	1	CWA50C2709	←	←	←	O
62	COVER FOR RECEIVER (UPPER)	1	CWD933022	←	←	←	O
63	COVER FOR RECEIVER (BOTTOM)	1	CWD933209	←	←	←	O
64	OPERATING INSTRUCTION	1	CWF567265	←	←	←	
65	INSTALLATION INSTRUCTION	1	CWF614211	←	←	←	


(Note)

- All parts are supplied from PHAAM, Malaysia (Vendor Code: 00029488).
- “O” marked parts are recommended to be kept in stock.



## 19.2. Outdoor Unit

### 19.2.1. CU-E7LKE CU-E9LKE CU-E12LKE CU-E15LKE CU-E7LKE-3 CU-E9LKE-3 CU-E12LKE-3

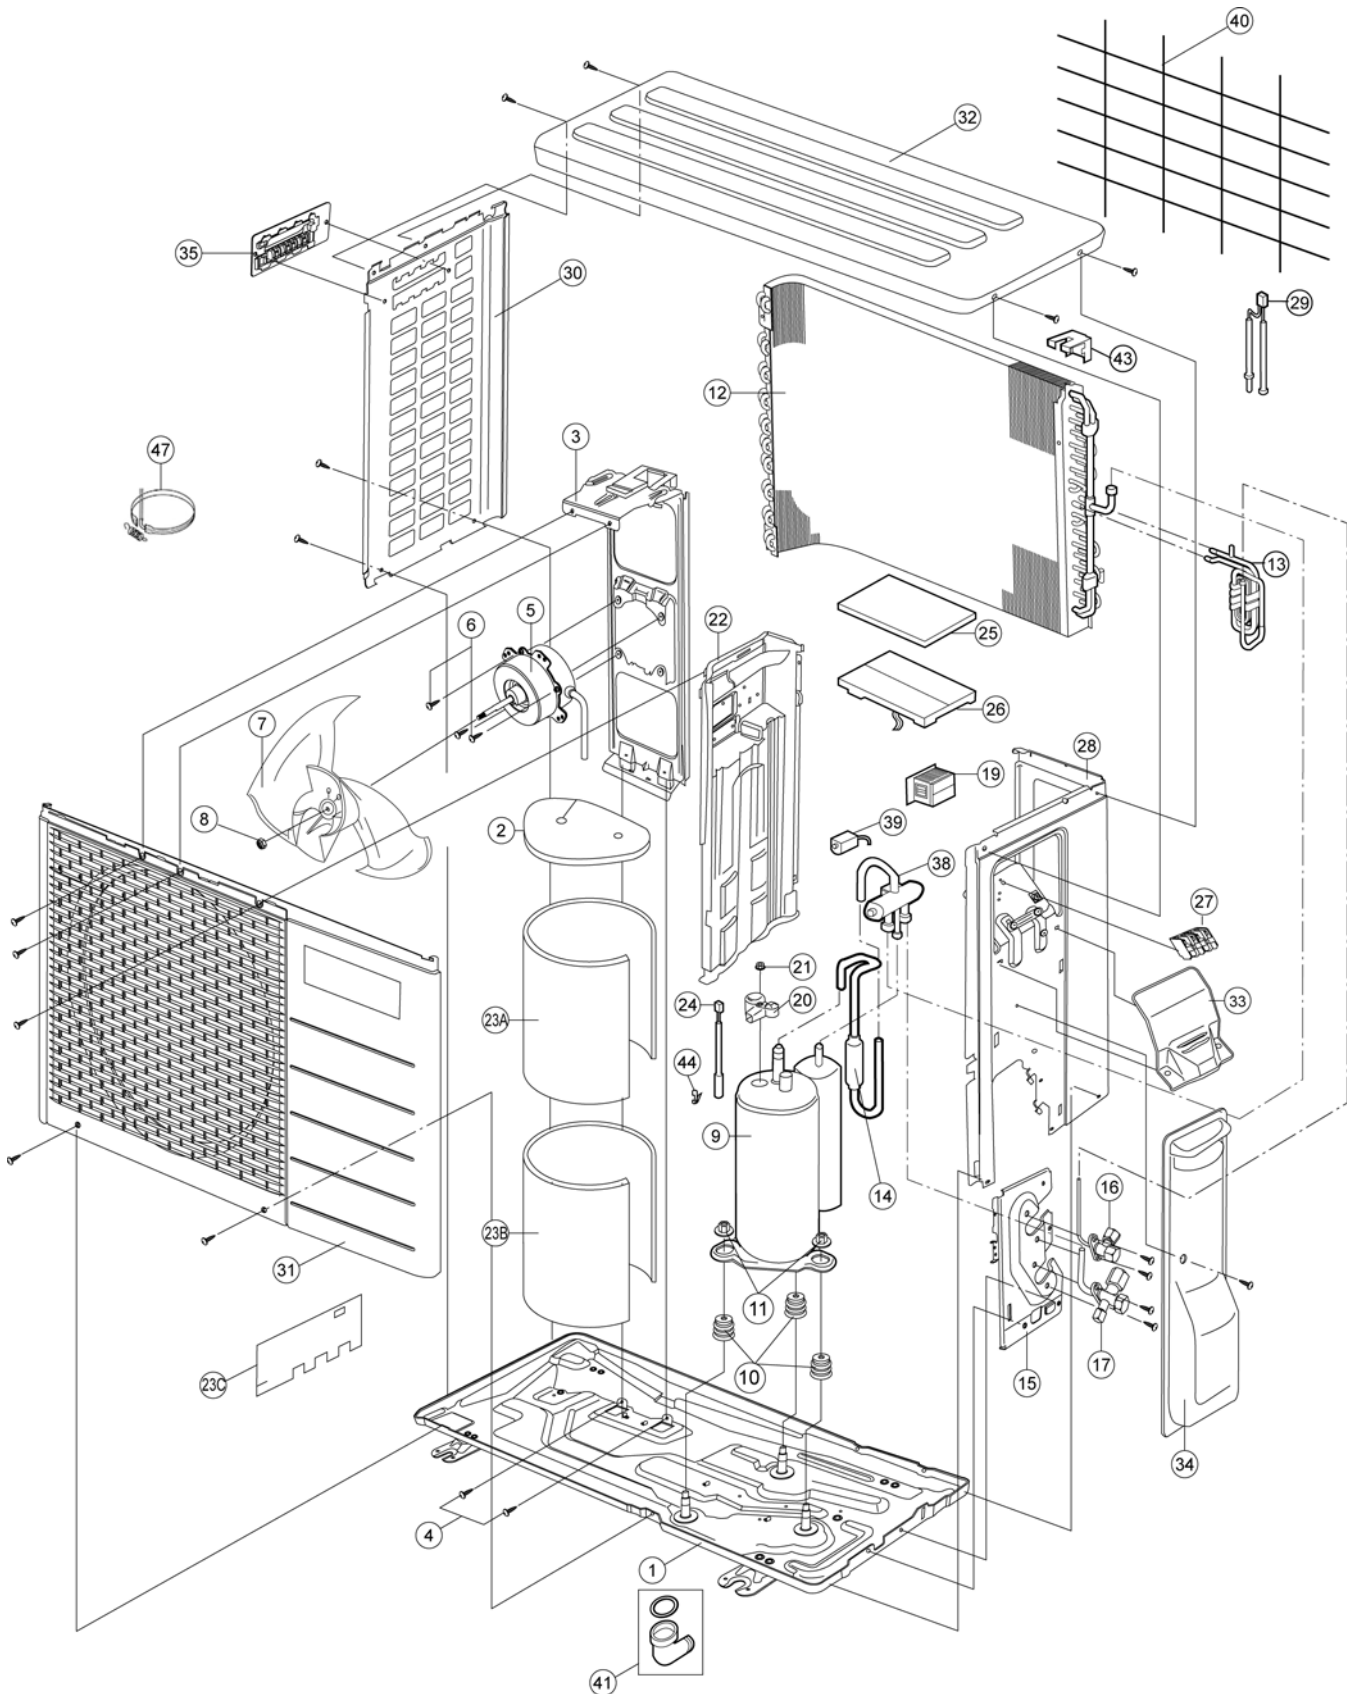

#### Note

The above exploded view is for the purpose of parts disassembly and replacement.  
The non-numbered parts are not kept as standard service parts.

REF. NO.	PART NAME & DESCRIPTION	QTY.	CU-E7LKE	CU-E9LKE	CU-E12LKE	CU-E15LKE	REMARKS
1	CHASSY ASS'Y	1	CWD50K2073	←	←	←	
2	SOUND PROOF MATERIAL	1	CWG302447	—	CWG302570	—	
3	FAN MOTOR BRACKET	1	CWD541089	←	←	←	
4	SCREW - FAN MOTOR BRACKET	2	CWH551217	←	←	←	
5	FAN MOTOR	1	CWA951553	CWA951553	ARW44W8P40AC	CWA951555	O
6	SCREW - FAN MOTOR MOUNT	4	CWH55252J	←	←	←	
7	PROPELLER FAN ASS'Y	1	CWH03K1010	←	CWH03K1014	CWH03K1010	
8	NUT - PROPELLER FAN	1	CWH56053J	←	←	←	
9	COMPRESSOR	1	5RS092XCD21	5RS102XBC21	5RS102XHA21	5RS102XBC21	O
10	ANTI - VIBRATION BUSHING	3	CWH50077	←	←	←	
11	NUT - COMPRESSOR MOUNT	3	CWH56000J	←	←	←	
12	CONDENSER	1	CWB32C2924	CWB32C2448	CWB32C2874	CWB32C2448	
13	TUBE ASS'Y CO. (CAP. / CHK VALVE)	1	CWT01C5214	CWT01C4850	CWT01C5215	CWT01C4852	
14	DISCHARGE MUFFLER	1	CWB121010	←	←	←	
15	HOLDER COUPLING	1	CWH351023	←	←	←	
16	2-WAYS VALVE (LIQUID)	1	CWB021400	CWB021301	CWB021400	CWB021301	O
17	3-WAYS VALVE (GAS)	1	CWB011374	←	←	CWB011367	O
19	REACTOR	1	G0C193J00002	←	G0C193J00004	←	O
20	TERMINAL COVER	1	CWH171039A	←	←	←	
21	NUT - TERMINAL COVER	1	CWH7080300J	←	←	←	
22	SOUND PROOF BOARD	1	CWH151172	←	←	←	
23A	SOUND PROOF MATERIAL	1	CWG302443	CWG302292	←	←	
23B	SOUND PROOF MATERIAL	1	—	CWG302293	CWG302569	CWG302293	
24	SENSOR COMPLETE	1	CWA50C2205	←	←	←	O
25	CONTROL BOARD COVER	1	CWH131264	←	←	←	
26	ELECTRONIC CONTROLLER - MAIN	1	CWA73C4585R	CWA73C4586R	CWA73C4587R	CWA73C4588R	O
27	TERMINAL BOARD ASS'Y	1	CWA28K1110J	←	←	←	O
28	CABINET SIDE PLATE CO.	1	CWE04C1116	←	←	←	
29	SENSOR COMPLETE	1	CWA50C2559	←	←	←	O
30	CABINET SIDE PLATE	1	CWE041248A	←	←	←	
31	CABINET FRONT PLATE CO.	1	CWE06C1039	←	←	←	
32	CABINET TOP PLATE	1	CWE031014A	←	←	←	
33	PLATE - C. B. COVER	1	CWH131301	←	←	←	
34	CONTROL BOARD COVER CO.	1	CWH13C1211	←	←	←	
35	HANDLE	1	CWE161010	←	←	←	
38	4-WAYS VALVE	1	CWB001037J	←	←	←	O
39	V - COIL COMPLETE	1	CWA43C2144J	←	←	←	O
40	WIRE NET	1	CWD041111A	←	←	←	
41	ACCESSORY CO. (DRAIN ELBOW)	1	CWG87C900	←	←	←	
43	HOLDER SENSOR	1	CWH321023	←	←	←	
44	HOLDER SENSOR	2	CWH32143	←	←	←	

(NOTE)


- All parts are supplied from PHAAM, Malaysia (Vendor Code: 00029488).
- "O" marked parts are recommended to be kept in stock.

REF. NO.	PART NAME & DESCRIPTION	QTY.	CU-E7LKE-3	CU-E9LKE-3	CU-E12LKE-3	REMARKS
1	CHASSY ASS'Y	1	CWD50K2073	←	←	
2	SOUND PROOF MATERIAL	1	CWG302314	←	←	
3	FAN MOTOR BRACKET	1	CWD541089	←	←	
4	SCREW - FAN MOTOR BRACKET	2	CWH551217	←	←	
5	FAN MOTOR	1	CWA951553	←	CWA951542	O
6	SCREW - FAN MOTOR MOUNT	4	CWH55252J	←	←	
7	PROPELLER FAN ASS'Y	1	CWH03K1010	←	←	
8	NUT - PROPELLER FAN	1	CWH56053J	←	←	
9	COMPRESSOR	1	5RS092XCD21	5RS102XBC21	5RS102XBC21	O
10	ANTI - VIBRATION BUSHING	3	CWH50077	←	←	
11	NUT - COMPRESSOR MOUNT	3	CWH56000J	←	←	
12	CONDENSER	1	CWB32C2924	CWB32C2448	←	
13	TUBE ASS'Y CO. (CAP. / CHK VALVE)	1	CWT01C5214	CWT01C4850	CWT01C4851	
14	DISCHARGE MUFFLER	1	CWB121010	←	←	
15	HOLDER COUPLING	1	CWH351023	←	←	
16	2-WAYS VALVE (LIQUID)	1	CWB021400	CWB021301	←	O
17	3-WAYS VALVE (GAS)	1	CWB011374	←	←	O
19	REACTOR	1	G0C193J00002	←	G0C193J00004	O
20	TERMINAL COVER	1	CWH171039A	←	←	
21	NUT - TERMINAL COVER	1	CWH7080300J	←	←	
22	SOUND PROOF BOARD	1	CWH151172	←	←	
23A	SOUND PROOF MATERIAL	1	CWG302316	←	←	
23B	SOUND PROOF MATERIAL	1	CWG302317	←	←	
23C	SOUND PROOF MATERIAL	1	CWG302315	←	←	
24	SENSOR COMPLETE	1	CWA50C2205	←	←	O
25	CONTROL BOARD COVER	1	CWH131264	←	←	
26	ELECTRONIC CONTROLLER - MAIN	1	CWA73C4589R	CWA73C4590R	CWA73C4591R	O
27	TERMINAL BOARD ASS'Y	1	CWA28K1110J	←	←	O
28	CABINET SIDE PLATE CO.	1	CWE04C1116	←	←	
29	SENSOR COMPLETE	1	CWA50C2559	←	←	O
30	CABINET SIDE PLATE	1	CWE041248A	←	←	
31	CABINET FRONT PLATE CO.	1	CWE06C1039	CWE06C1136	←	
32	CABINET TOP PLATE	1	CWE031014A	←	←	
33	PLATE - C. B. COVER	1	CWH131301	←	←	
34	CONTROL BOARD COVER CO.	1	CWH13C1211	←	←	
35	HANDLE	1	CWE161010	←	←	
38	4-WAYS VALVE	1	CWB001037J	←	←	O
39	V - COIL COMPLETE	1	CWA43C2144J	←	←	O
40	WIRE NET	1	CWD041111A	←	←	
41	ACCESSORY CO. (DRAIN ELBOW)	1	CWG87C900	←	←	
43	HOLDER SENSOR	1	CWH321023	←	←	
44	HOLDER SENSOR	2	CWH32143	←	←	
47	CRANKCASE HEATER	1	CWA341044	←	←	

(NOTE)

- All parts are supplied from PHAAM, Malaysia (Vendor Code: 00029488).
- "O" marked parts are recommended to be kept in stock.

## 19.2.2. CU-E18LKE CU-E21LKE

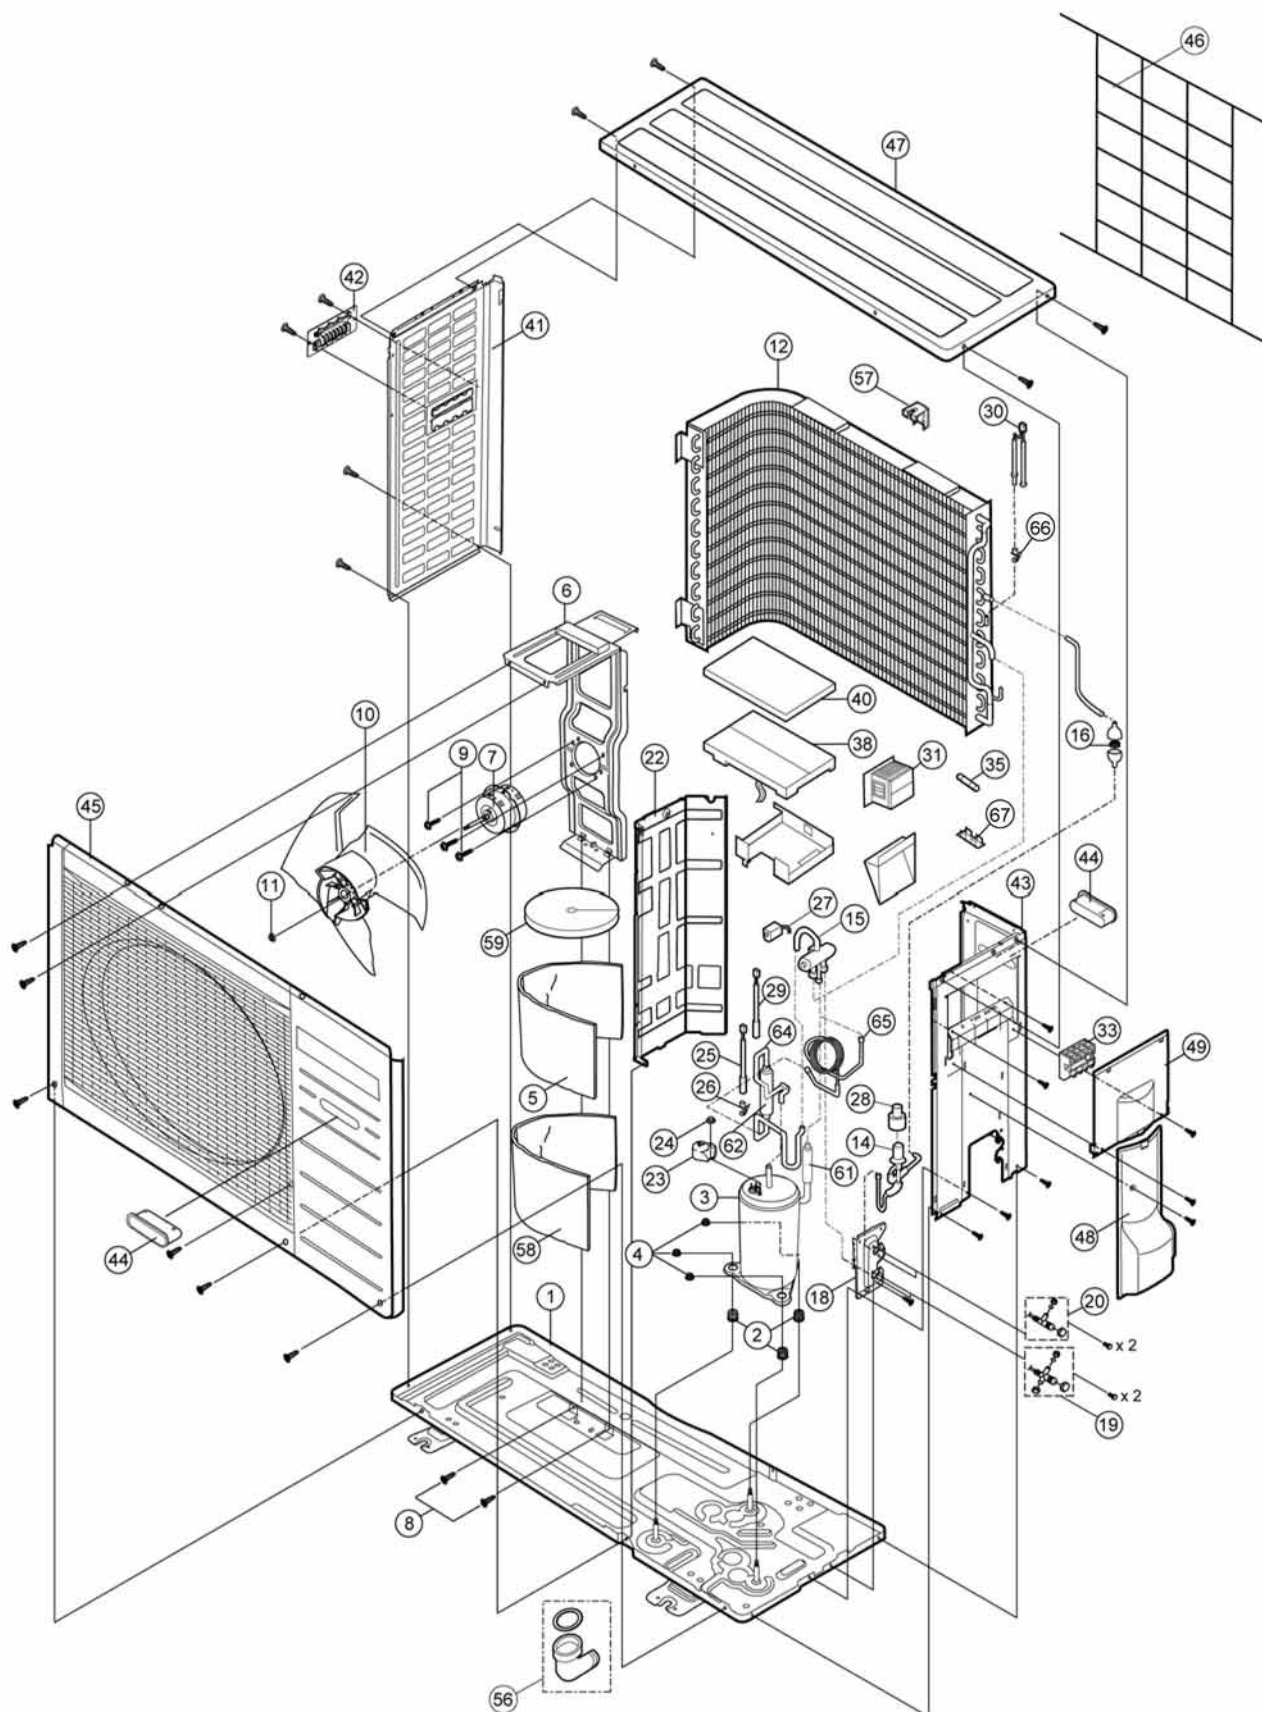

### Note

The above exploded view is for the purpose of parts disassembly and replacement.  
The non-numbered parts are not kept as standard service parts.

REF. NO.	DESCRIPTION & NAME	QTY.	CU-E18LKE	CU-E21LKE	REMARKS
1	CHASSY ASS'Y	1	CWD50K2085	←	
2	ANTI-VIBRATION BUSHING	3	CWH50077	←	
3	COMPRESSOR	1	5CS130XAD04	←	O
4	NUT-COMPRESSOR MOUNT	3	CWH56000J	←	
5	SOUND PROOF MATERIAL	1	CWG302302	←	
6	FAN MOTOR BRACKET	1	CWD541054	←	
7	FAN MOTOR	1	CWA981166J	←	O
8	SCREW - FAN MOTOR BRACKET	2	CWH551217	←	
9	SCREW - FAN MOTOR MOUNT	3	CWH551106J	←	
10	PROPELLER FAN ASSY	1	CWH03K1016	←	
11	NUT - PROPELLER FAN	1	CWH56053J	←	
12	CONDENSER COMPLETE	1	CWB32C2816	CWB32C2818	
14	TUBE ASS'Y (EXP. VALVE)	1	CWT023679	←	O
15	4 WAYS VALVE	1	CWB001026J	←	
16	STRAINER	1	CWB11094	←	
18	HOLDER - COUPLING	1	CWH351056	←	
19	3 WAYS VALVE (GAS)	1	CWB011361	←	O
20	2 WAYS VALVE (LIQUID)	1	CWB021292	←	O
22	SOUND PROOF BOARD	1	CWH151050	←	
23	TERMINAL COVER	1	CWH171039A	←	
24	NUT-TERMINAL COVER	1	CWH7080300J	←	
25	SENSOR COMPLETE (COMP. TOP)	1	CWA50C2185	←	
26	HOLDER SENSOR	1	CWH32074	←	
27	V-COIL COMPLETE (4 - WAYS VALVE)	1	CWA43C2168J	←	
28	V-COIL COMPLETE (EXPAND VALVE)	1	CWA43C2058J	←	
29	SENSOR COMPLETE (COMP. DISC.)	1	CWA50C2180	←	
30	SENSOR COMPLETE	1	CWA50C2181	←	
31	REACTOR	1	G0C203J00003	←	
33	TERMINAL BOARD ASSY	1	CWA28K1110J	←	
35	FUSE CAP TERMINAL	1	K5D303BBA002	←	
38	ELECTRONIC CONTROLLER - MAIN	1	CWA73C4476R	CWA73C4477R	O
40	CONTROL BOARD COVER (TOP PCB)	1	CWH131167	←	
41	CABINET SIDE PLATE (LEFT)	1	CWE041255A	←	
42	HANDLE	1	CWE161010	←	
43	CABINET SIDE PLATE (RIGHT)	1	CWE041158A	←	
44	HANDLE	2	CWE16000E	←	
45	CABINET FRONT PLATE CO.	1	CWE06K1043	←	
46	WIRE NET	1	CWD041041A	←	
47	CABINET TOP PLATE	1	CWE031031A	←	
48	CONTROL BOARD COVER (BOTTOM)	1	CWH131168	←	
49	CONTROL BOARD COVER (TOP)	1	CWH131169A	←	
56	ACCESSORY CO. (DRAIN ELBOW)	1	CWG87C900	←	
57	HOLDER SENSOR	1	CWMH320001	←	
58	SOUND PROOF MATERIAL	1	CWG302270	←	
59	SOUND PROOF MATERIAL	1	CWG302300	←	
61	ACCUMULATOR	1	CWB131024	←	
62	RECEIVER	1	CWB14011	-	
64	OIL SEPERATER ASS'Y	1	—	CWB16K1008	
65	TUBE ASS'Y (CAP. TUBE)	1	—	CWT022997	
66	HOLDER SENSOR	1	CWH321025	←	
67	FUSE HOLDER	1	K3GB1PH00016	←	

(NOTE)

- All parts are supplied from PHAAM, Malaysia (Vendor Code: 00029488).
- "O" marked parts are recommended to be kept in stock.